



fieldserver

Driver Manual

FS-8700-102 Honeywell Zellweger IR-148

APPLICABILITY & EFFECTIVITY

Effective for all systems manufactured after March 2021.



Driver Revision: 1.02
Document Revision: 4.A



MSA Safety
1991 Tarob Court
Milpitas, CA 95035
Website: www.MSAafety.com

U.S. Support Information:
+1 408 964-4443
+1 800 727-4377
Email: smc-support@msasafety.com

EMEA Support Information:
+31 33 808 0590
Email: smc-support.emea@msasafety.com

Contents

| | | |
|----------|--|-----------|
| 1 | Description..... | 4 |
| 2 | Driver Scope of Supply..... | 4 |
| 2.1 | Supplied by MSA Safety..... | 4 |
| 3 | Hardware Connections | 5 |
| 3.1 | Connection Notes | 5 |
| 4 | Data Array Parameters..... | 6 |
| 5 | Client Side Configuration | 7 |
| 5.1 | Client Side Connection Parameters | 7 |
| 5.2 | Client Side Node Parameters..... | 8 |
| 5.3 | Client Side Map Descriptor Parameters | 8 |
| 5.3.1 | FieldServer Specific Map Descriptor Parameters | 8 |
| 5.3.2 | Driver Related Map Descriptor Parameters | 8 |
| 5.3.3 | Timing Parameters | 8 |
| 5.4 | Map Descriptor Example | 9 |
| 6 | Server Side Configuration | 10 |
| 6.1 | Server Side Connection Parameters | 10 |
| 6.2 | Server Side Node Parameters..... | 11 |
| 6.3 | Server Side Map Descriptor Parameters..... | 11 |
| 6.3.1 | FieldServer Specific Map Descriptor Parameters | 11 |
| 6.3.2 | Driver Specific Map Descriptor Parameters | 12 |
| 6.4 | Map Descriptor Examples | 13 |
| 6.4.1 | Server Using Data Array | 13 |
| 6.4.2 | Server Using INI File | 13 |
| 7 | Useful Features | 14 |
| 7.1 | How Data is Stored by the Driver | 14 |
| 7.1.1 | One Set of Consecutive Data Array Elements per Point/Sensor..... | 14 |
| 7.1.2 | Extended Storage | 15 |
| 8 | Reference | 16 |
| 8.1 | Supported Functions at a Glance | 16 |
| 8.2 | Driver Error Messages..... | 16 |
| 8.3 | Driver Stats | 18 |

Description

1 Description

The Honeywell Infrared Gas Monitor (Model IR-148) detects solvents and gases such as HCFCs, HFCs and PFCs. IR-148 can have 1, 4 or 8 sampling points. This InfraTox driver reports gas values, alarms and troubles for each point.

The serial driver can emulate a Client or a Server. The FieldServer and Zellweger device are connected using a RS-485 network.

As a Client

The driver listens passively for messages from the IR-148 unit and stores data extracted from the messages. The driver cannot poll the IR-148 device for Data. The driver records some additional data age information (which is stored in the FieldServer's Data Arrays) because messages do not always contain information about all sensors and depending on the IR-148 operational mode (such as Locked mode), may never contain information other than for one sensor.

As a Server

The server side if this driver has been developed primarily to test the Client side driver as part of FieldServer's QA program. The driver sends messages reporting the state of the samples. The server driver can also be locked to report the status/value of one particular sample channel.

It is possible to connect up to three Honeywell Zellweger units (IR-148) on one RS-485 network provided that one unit is configured as a single point unit (IR-148 1 point), one as a 4-point unit (IR-148 4 point) and the other as an 8 point unit (IR-148 8-point). At this stage one device with 8 points and one with 4 points have been tested separately.

To allow for the possibility that the device is connected on a RS-485 network with other devices (such as the relay module option) messages that are not 49 bytes long and which do not begin with 0xB1 will be ignored. The Driver will, however, provide statistics for the ignored as well as the processed messages.

To see supported messages and the way the Driver stores Data, refer to [Section 7.1](#).

Max Nodes Supported

| FieldServer Mode | Nodes | Comments |
|------------------|-------|---|
| Client | 3 | Tested only 2 Nodes (IR-148 8 Point and IR-148 4 point) on separate networks. |
| Server | 3 | Developed to test Client side of the Driver. |


2 Driver Scope of Supply

2.1 Supplied by MSA Safety

| Part # | Description |
|--------|---------------|
| | Driver Manual |

3 Hardware Connections

The FieldServer is connected to the Honeywell Zellweger IR-148 Device as shown in connection drawing. Configure the device according to manufacturer's instructions.

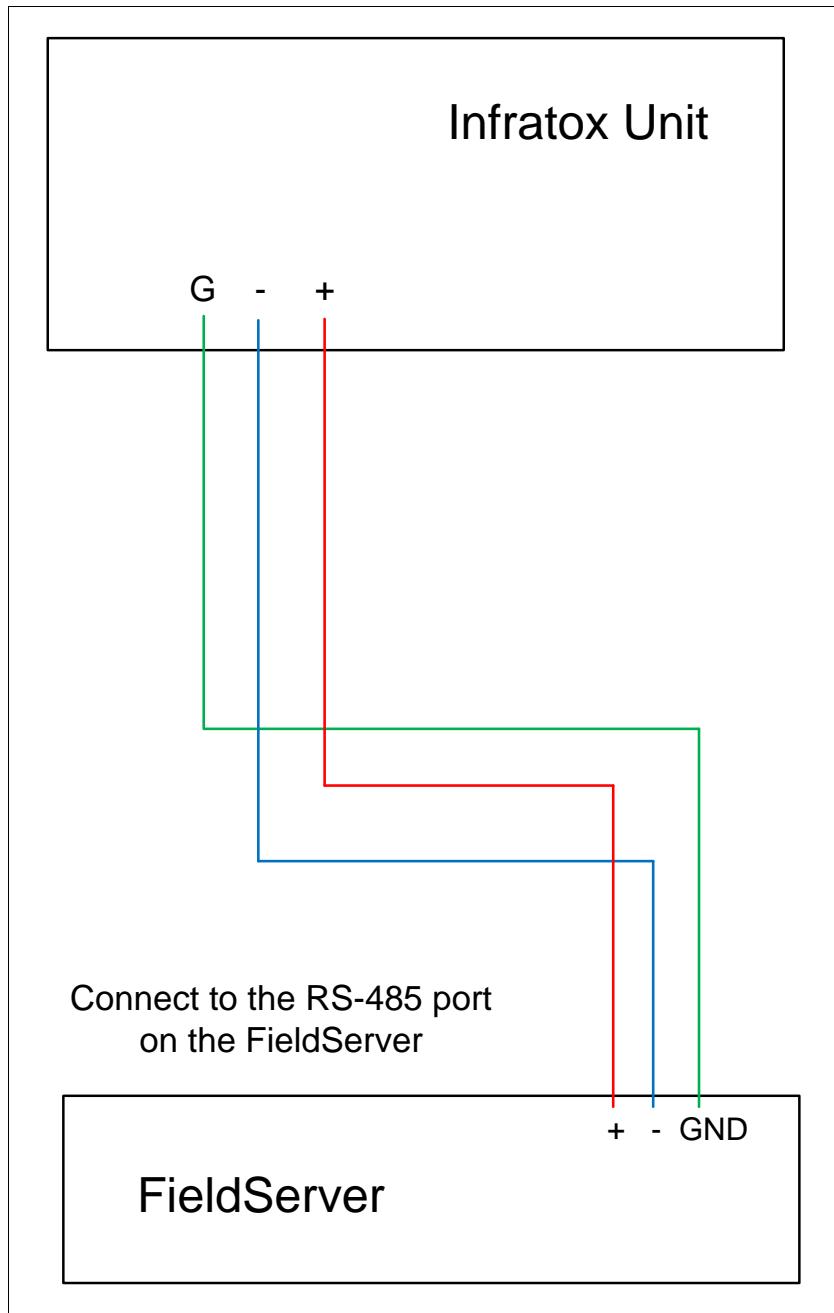

3.1 Connection Notes

- Other devices must not transmit Honeywell Zellweger IR-148 49 byte messages.
- If connection problems are experienced when connecting with RS-485, remove the GND wire.

4 Data Array Parameters

Data Arrays are “protocol neutral” data buffers for storage of data to be passed between protocols. It is necessary to declare the data format of each of the Data Arrays to facilitate correct storage of the relevant data.

| Section Title | Function | Legal Values |
|---------------------|--|--|
| Data_Arrays | | |
| Column Title | Function | Legal Values |
| Data_Array_Name | Provide name for Data Array. | Up to 15 alphanumeric characters |
| Data_Array_Format | Provide data format. Each Data Array can only take on one format. | Float, Bit, Byte, UInt16, UInt32, Sint16, Sint32 |
| Data_Array_Length | Number of Data Objects. Must be larger than the data storage area required by the Map Descriptors for the data being placed in this array. | 1-10000 |

Example

```
// Data Arrays
Data_Arrays
Data_Array_Name , Data_Array_Format , Data_Array_Length
DA_R1          , Float            , 100
DA_R2          , Float            , 100
DA_CTL_R1      , UInt16          , 1
DA_CTL_R2      , UInt16          , 1
```

Configuring the FieldServer

5 Client Side Configuration

For detailed information on FieldServer configuration, refer to the FieldServer Configuration Manual. The information that follows describes how to expand upon the factory defaults provided in the configuration files included with the FieldServer (see “.csv” sample files provided with the FieldServer).

This section documents and describes the parameters necessary for configuring the FieldServer to communicate with a Honeywell Zellweger IR-148 Server having one or eight sensors.

The configuration file tells the FieldServer about its interfaces, and the routing of data required. In order to enable the FieldServer for Honeywell Zellweger IR-148 communications, the driver independent FieldServer buffers need to be declared in the “Data Arrays” section, the destination device addresses need to be declared in the “Client Side Nodes” section, and the data required from the Servers needs to be mapped in the “Client Side Map Descriptors” section. Details on how to do this can be found below.

NOTE: In the following tables, * indicates an optional parameter and bold legal values are default.

5.1 Client Side Connection Parameters

| Section Title | Connections | |
|---------------|--|--|
| Column Title | Function | Legal Values |
| Port | Specify which port the device is connected to the FieldServer. | P1-P2 (with 232/485 converter), R1-R2 ¹ |
| Protocol | Specify protocol used. | InfraTox or Infra-Tox |
| Baud* | Specify baud rate. | 19200 (Vendor limitation) |
| Parity* | Specify parity. | None (Vendor limitation) |
| Data_Bits* | Specify data bits. | 8 (Vendor limitation) |
| Stop_Bits* | Specify stop bits. | 1 |

Example

```
// Client Side Connections
Connections
Port      , Protocol  , Baud    , Parity   , Stop_Bits
R1        , InfraTox , 19200  , None    , 1
```

¹ Not all ports shown are necessarily supported by the hardware. Consult the appropriate Instruction manual for details of the ports available on specific hardware.

Configuring the FieldServer

5.2 Client Side Node Parameters

| Section Title | Function | Legal Values |
|---------------|---|----------------------------------|
| Nodes | Provide name for node. | Up to 32 alphanumeric characters |
| Node_Name | Irrelevant for this driver when only one Node is connected. Otherwise the Node-ID should be the number of points/sensors for which the Zellweger unit is configured. A unique Node_ID is recommended for each Zellweger Unit as it may be useful in exposing Node status information. | 0-255 |
| Protocol | Specify protocol used. | InfraTox, Infra-Tox |
| Port | Specify which port the device is connected to the FieldServer. | P1-P2 ² , R1-R2 |

Example

```
// Client Side Nodes
Nodes
Node_Name , Node_ID , Protocol , Port
DEV1 , 1 , InfraTox , R1
```

5.3 Client Side Map Descriptor Parameters

5.3.1 FieldServer Specific Map Descriptor Parameters

| Column Title | Function | Legal Values |
|---------------------|---|---|
| Map_Descriptor_Name | Name of this Map Descriptor. | Up to 32 alphanumeric characters |
| Data_Array_Name | Name of Data Array where data is to be stored in the FieldServer. | One of the Data Array names from "Data Array" section above |
| Data_Array_Offset | Starting location in Data Array. | 0 to (Data_Array_Length-1) as specified in "Data_Array" section |
| Function | Function of Client Map Descriptor. | Passive_Client |

5.3.2 Driver Related Map Descriptor Parameters

| Column Title | Function | Legal Values |
|-------------------|---|---|
| Node_Name | Name of Node from which data is fetched. | One of the Node names specified in "Client Node Descriptor" above |
| Length | Length of Map Descriptor. | 0 to Data_Array_Length (specified in "Data_Array" section) |
| Extended_Storage* | Expand Storage per point. Refer to Section 7.1 . | Yes, No |

5.3.3 Timing Parameters

| Column Title | Function | Legal Values |
|---------------|------------------------------|--------------|
| Scan_Interval | Rate at which data is polled | >= 0s |

² Ports P1-P2 require a 232/485 converter.

Configuring the FieldServer

5.4 Map Descriptor Example

If configured according to this example, the driver will capture and store Gas value, Alarms, Trouble, Lock and Blank messages for all (8) sensors for Node (DEV1). Refer to [Section 7.1](#) for detailed information about data storage.

```
// Client Side Map Descriptors  
Map Descriptor  
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Function , Node_Name , Length  
CMD1 , DA_R1 , 0 , Passive Client , DEV1 , 100
```

In the above example:

- Data_Array_Name – One of the Data Arrays declared in the “Data Array” section above. The Data from the Node (Dev1) will be stored in this Data Array.
- Data_Array_Offset – The Driver stores Data from device (DEV1) with this memory location as the starting point and onward, in Data Array DA_R1.
- Function – This means that the FieldServer cannot poll the target device but monitors the device. Extracted data from incoming messages are stored in Data Array DA_R1.
- Node_Name – This is the logical name of the target device having the parameters defined in the “Client Node Descriptor” section above.
- Length – Length forces driver to reserve memory space for this number of elements, starting from memory location defined as Data_Array_Offset. Length must be long enough to store all data from Node (Dev1).

6 Server Side Configuration

For a detailed information on FieldServer configuration, refer to the FieldServer Configuration Manual. The information that follows describes how to expand upon the factory defaults provided in the configuration files included with the FieldServer (see “.csv” sample files provided with the FieldServer).

This section documents and describes the parameters necessary for configuring the FieldServer to report sensor data to Honeywell Zellweger IR-148 Client. As a Server this driver sends Gas value, Alarm, Trouble and Lock point messages. The driver can be locked to send data for only one particular sensor.

The configuration file tells the FieldServer about its interfaces, and the routing of data required. In order to enable the FieldServer for Honeywell Zellweger IR-148 communications, the driver independent FieldServer buffers need to be declared in the “Data Arrays” section, the FieldServer virtual Node(s) needs to be declared in the “Server Side Nodes” section, and the data to be provided to the Clients needs to be mapped in the “Server Side Map Descriptors” section. Details on how to do this can be found below.

NOTE: In the tables below, * indicates an optional parameter with the bold legal value as default.

6.1 Server Side Connection Parameters

| Section Title | Function | Legal Values |
|---------------|--|--|
| Connections | | |
| Column Title | Function | Legal Values |
| Port | Specify which port the device is connected to the FieldServer. | P1-P2 (with 232/485 converter), R1-R2 ³ |
| Protocol | Specify protocol used. | InfraTox or Infra-Tox |
| Baud* | Specify baud rate. | 19200 (Vendor limitation) |
| Parity* | Specify parity. | None (Vendor limitation) |
| Data_Bits* | Specify data bits. | 8 (Vendor limitation) |
| Protocol | Specify protocol used. | InfraTox or Infra-Tox |

Example

```
// Server Side Connections
Connections
Port      , Protocol   , Baud     , Parity    , Data_Bits
R1       , InfraTox   , 19200   , None     , 8
```

³ Not all ports shown are necessarily supported by the hardware. Consult the appropriate Instruction manual for details of the ports available on specific hardware.

Configuring the FieldServer

6.2 Server Side Node Parameters

| Section Title | Function | Legal Values |
|---------------|---|----------------------------------|
| Nodes | Provide name for node. | Up to 32 alphanumeric characters |
| Column Title | Function | Legal Values |
| Node_Name | Irrelevant for this driver when only one Node is connected. Otherwise the Node-ID should be the number of points/sensors for which the Zellweger unit is configured. A unique Node_ID is recommended for each Zellweger Unit as it may be useful in exposing Node status information. | 0-255 |
| Protocol | Specify protocol used. | InfraTox, Infra-Tox |
| Port | Specify at which port the device is connected to the FieldServer. | P1-P2 ⁴ , R1-R2 |

Example

```
// Server Side Nodes
Nodes
Node_Name      , Node_ID    , Protocol   , Connection
Node_1         , 1          , Secutron   , P1
```

6.3 Server Side Map Descriptor Parameters

6.3.1 FieldServer Specific Map Descriptor Parameters

| Column Title | Function | Legal Values |
|---------------------|---|---|
| Map_Descriptor_Name | Name of this Map Descriptor. | Up to 32 alphanumeric characters |
| Data_Array_Name | Name of Data Array where data is to be stored in the FieldServer. | One of the Data Array names from "Data Array" section above |
| Data_Array_Offset | Starting location in Data Array. | 0 to (Data_Array_Length-1) as specified in "Data_Array" section |
| Function | Function of Server Map Descriptor. | Wrbc |

⁴ Ports P1-P2 require a 232/485 converter.

Configuring the FieldServer

6.3.2 Driver Specific Map Descriptor Parameters

| Column Title | Function | Legal Values |
|---------------------|--|--|
| Node_Name | Name of Node to which data has to be sent. | One of the Node names specified in the “Node” section above |
| Length | Length of Map Descriptor. | 1 to maximum specified in “Data Array” section above |
| Da_Byte_Array_Name* | Name of Data Array used to lock the sensor. The driver will report data for the locked sensor only. | One of the Data Array names specified in “Data Array” section above |
| Data_Byte_Offset* | Specifies offset into the Da_Byte_Array_Name Data Array. This memory location will be checked when the user has locked a sensor. | 0 to (Data_Array_Length-1), Data_Array_Offset |
| Infra_Func* | <p>For quality assurance only: This parameter is used to send a message to a Client from a Map_Descriptor_Name*.ini file. The Data_Array_Offset value will be used as the line number from INI to send.</p> <p>INFRA_SIMULATION: only the numbered line will be sent.</p> <p>INFRA_SIMULATION_ALL: Starting at the numbered line all lines will be sent one by one until the end of the file is reached.</p> <p>INFRA_SIM_ALL_REPEAT: All lines from the numbered line will be sent until the end of the file is reached and then the cycle will repeat from the numbered line.</p> <p>NOTE: Ini must show all bytes as two character hex representation and the first line should be: // FILE_IN_HEX_FORMAT.</p> | INFRA_SIMULATION, INFRA_SIMULATION_ALL, INFRA_SIM_ALL_REPEAT, - |

6.4 Map Descriptor Examples

6.4.1 Server Using Data Array

The following Map Descriptor enables this Driver to send data for all 8 sensors to the Node (DEV1) connected at the FieldServer. Refer to the “Data Array” section for the Data Array format.

The Driver can send Gas value messages, Alarm messages, Trouble messages and lock point messages. The driver can also be locked to send data for only one particular sensor. In this example, if a valid (1-8) sensor number is inserted at offset 0 in the Data Array DA_CTL_R1, the driver will only send data for that particular sensor. To disable the lock, insert an invalid (0 or >8) number.

```
// Server Side Map Descriptors

Map Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Function
SMD1           , DA_R1        , 0          , Wrbc

, Node_Name   , Length    , Da_Byte_Name   , Da_Byte_Oset
, DEV1        , 100       , DA_CTL_R1    , 0
```

In the above example:

- Data_Array_Name – Driver will look into this data array to send Zellweger message to Zellweger 8 Channel Client.
- Data_Array_Offset – Data Array Offset indicates the starting memory location for the Data to be sent to the Node (DEV1).
- Function – Wrbc function makes this Server an Active Server. The Server continuously writes data for each sensor.
- Node_Name – Client Node which receives data from the Server.
- Length – Length should be sufficient to store data for all sensors for a Node.
- Da_Byte_Name – Name of Data Array used to lock sensor. Driver will report data for locked sensor only.

6.4.2 Server Using INI File

This Map Descriptor will enable the Driver to send the 2nd line from the SMD1.ini to the Node (DEV1) irrespective of the contents. The line may contain up to 2000 characters.

```
// Server Side Map Descriptors

Map Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Function , Node_Name , Length , Infra_Func
SMD1.ini           , Dummy        , 2          , wrbc    , DEV1     , 1      , INFRA_SIMULATION
```

In the above example:

- Data_Array_Offset – Data Array Offset indicates the line number to send to Node (DEV1).
- Function – Wrbc function makes this Server an Active Server. This Server continuously sends data from the specified line in the SMD1.ini file.
- Node_Name – Server sends data to this Node connected to the FieldServer.
- Length – Length should be set to 1.
- Infra_Func – Specifies the use of the INI file as the Data source.

7 Useful Features

7.1 How Data is Stored by the Driver

7.1.1 One Set of Consecutive Data Array Elements per Point/Sensor

| Offset | Sensor | Contents | Description |
|--------|--------|------------------|--|
| 0 | 1 | Alarm or Trouble | Set non-zero if alarm or a trouble has been reported. Set to zero if neither are currently being reported. |
| 1 | 1 | Alarm Type | 0 = None 1 = Caution 2 = Warning 3 = Alarm |
| 2 | 1 | Trouble | 0 = None 1 = Trouble |
| 3 | 1 | Gas Value | Gas value multiplied by 100. If configured, scaling will be applied. |
| 4 | 1 | Gas Units | 1 st 3 bytes of gas units are written as ASCII characters. |
| 5 | 1 | Gas Units | |
| 6 | 1 | Gas Units | |
| 7 | 1 | State | 0 = Enabled 1 = Disabled |
| 8 | 1 | Gas Value Valid | 1 = Gas Value updated with most recent message. 0 = Gas Value not updated. |
| 9 | 1 | Gas Value Age | In seconds since last update. Initial (and max) value = 0xffff |
| 10 | 1 | Sensor Data Age | Time since last message containing data about this sensor. In seconds since last update. Initial (and max) value = 0xffff |
| 11..21 | 2 | | |
| 22..32 | 3 | | |
| 33..43 | 4 | | |
| 44..54 | 5 | | |
| 55..65 | 6 | | |
| 66..76 | 7 | | |
| 77..87 | 8 | | |

7.1.2 Extended Storage

| Offset | Sensor | Contents | Description |
|----------|--------|---------------------------|---|
| 0 | 1 | Alarm or Trouble | Non-zero if alarm or a trouble has been reported. Zero if neither are currently being reported. |
| 1 | 1 | Alarm Type | 0 = None, 1 = Caution, 2 = Warning, 3 = Alarm |
| 2 | 1 | Trouble | 0=None, 1=Trouble |
| 3 | 1 | Gas Value | Gas value multiplied by 100 is stored here. When stored, if configured, scaling will be applied. |
| 4 | 1 | Gas Units | First 3 bytes of gas units are written here as ASCII characters. |
| 5 | 1 | Gas Units | |
| 6 | 1 | Gas Units | |
| 7 | 1 | State | 0 = Enabled, 1 = Disabled |
| 8 | 1 | Gas Value Valid | 1 = Gas Value updated with most recent message. 0 = Gas Value not updated. |
| 9 | 1 | Gas Value Age | In seconds since last update. Initial (and max) value = 0xffff |
| 10 | 1 | Sensor Data Age | Age since last message, containing data from this sensor in seconds. Initial (and max) value = 0xffff |
| 11 | 1 | I/O State | 255 = unknown, 0=Warm up, 1 = Ready, 2 = Trouble, 3= Cal/Setup |
| 12 | 1 | Alarm Latched Status | 0=No, 1=Yes |
| 13 | 1 | Audio On Status | 0=No, 1= Yes |
| 14 | 1 | Alarm Latching Preference | On Caution (0=No, 1= Yes) |
| 15 | 1 | Alarm Latching Preference | On Warning (0=No, 1= Yes) |
| 16 | 1 | Alarm Latching Preference | On Alarm (0=No, 1= Yes) |
| 17 | 1 | Audio On Preference | On Caution (0=No, 1= Yes) |
| 18 | 1 | Audio On Preference | On Warning (0=No, 1= Yes) |
| 19 | 1 | Audio On Preference | On Alarm (0=No, 1= Yes) |
| 20 | 1 | Audio On Preference | On Trouble (0=No, 1= Yes) |
| 21 | 1 | Audio On Preference | On Auxiliary (0=No, 1= Yes) |
| 22-24 | 1 | Spare | |
| 25..49 | 2 | | |
| 50..74 | 3 | | |
| 75..99 | 4 | | |
| 100..124 | 5 | | |
| 125..149 | 6 | | |
| 150..174 | 7 | | |
| 175..199 | 8 | | |

8 Reference

8.1 Supported Functions at a Glance

| Message Types | Notes |
|---------------------------------------|--|
| Gas Value Message | Message reports a gas value and units. |
| Trouble Message | Message reports a trouble for one sensor |
| Blank Message | Message used to flash Honeywell Zellweger IR-148 display |
| Alarm Message | Message reports an alarm (C/W/A) for one sensor |
| Locked Point Message | Unit is locked onto a single sample. |
| Other 49 byte messages beginning 0xb1 | Discarded but driver report stats on these messages as described in Section 8.3 . |
| Other 49 byte messages | |
| Other messages | |

8.2 Driver Error Messages

Some configuration errors might produce an error every time a poll is generated. This will fill the error buffer quickly and not add any clarity. For this reason, the driver suppresses subsequent similar messages. It is possible for the same error produced by multiple Map Descriptors to produce only one error message. Subsequent error messages can be seen on the driver message screen.

NOTE: In the actual message, %d has been replaced by an integer, %s by text indicating a data array name or map descriptor name and %x by two hex characters.

| Error Message | Description and Action Required |
|--|---|
| INFRA: #1 Err. Da <%s> length Reqd/exist <%d/%d> Md <%s> where md offset <%d> ⁵ | This error will be generated when the driver tries to store data for a sensor, but the corresponding Data Array is not long enough. Set the Data Array length as indicated. |
| INFRA:#2 Err. Incoming data is being abandoned on port R-P%d ⁵ | Honeywell Zellweger IR-148-8.8-Channel or another unit is connected at the indicated port of the FieldServer, but the Configuration file does not define a Map Descriptor to capture data from this unit. Change the CSV file to define a Map Descriptor to communicate with this device if required. |
| INFRA:#3 ERR. Invalid Node_id %d, Valid 1-8 | If there are multiple Nodes, then make the Node_ID the number of points (sensors) for which Zellweger units are configured. |
| Infra:#4 Err. Test file <%s> not found. | In Simulation mode the driver can send messages from files indicated by the Map Descriptor name. Check that the required file exists and that it is not in use by another application or change the mode from simulation to operation by deleting the parameter "INFRA_SIMULATION" from the CSV file. |
| INFRA:#11 Err. Illegal MD Function for Md <%s> ⁵ | Set Map Descriptor's function to Passive_Client if driver is configured as a Client or Wrbc if configured as a Server. |
| INFRA:#12 Err. Illegal MD length <%s> ⁵ | The Map Descriptor length parameter is either not defined or set to 0. Set the Map Descriptor length to 100. |
| INFRA:#13 Err. Illegal Infra_func for Md <%s> ⁵ | This error will be generated if using the Infra_func parameter with an incorrect value. See Section 6.3.2 for legal values. |

⁵ Edit CSV file, download the modified file and reset the FieldServer to have the changes take effect.

Additional Information

| Error Message | Description and Action Required |
|--|--|
| INFRA:#21 Err. Da <%s> length Reqd/exist <%d/%d> Md <%s> where md offset <%d> ⁵ | This error will be generated when the driver tries to send a message to the Client, but the Data Array used to compose the message is insufficiently long to hold information for all 8 sensors. Set the Data Array length as indicated. |
| INFRA:#22 Err. Diagnostic line <%d> ignored. ⁵ | In Server mode the driver does not send messages from lines starting with # or //. Change the Data_Array_Offset parameter for the indicated line in the ini file. |
| INFRA:#41 FYI. Write-thru not Possible On MD <%s> | If an Upstream Device writes a value at a memory location under the influence of the given Map Descriptor, the Write-thru operation will be cancelled as the Driver cannot write to an UnfraTox unit. |
| Infra:#51 FYI. You could use an Array called <%s> to expose diagnostic info. | It is possible to define a Data Array known as "Infra-stats" (see Section 7.1.1) This Data Array is very useful for statistics purposes. |

8.3 Driver Stats

In addition to the standard FieldServer operating statistics the driver can expose certain key stats in a Data Array which can then be monitored by an upstream device. Adding the following to the configuration file will activate these stats for a driver configured as a Client.

```
// Expose Driver Operating Stats
Data_Arrays
Data_Array_Name    , Data_Format    , Data_Array_Length
Infra-stats        , UINT32        , 200
```

| Stat # | Stats | Description |
|--------|---|---|
| 0 | INFRA_TROUBLE_MSG_RECV | Number of trouble messages received. |
| 1 | INFRA_TROUBLE_WITH_ALARM_MSG_R ECV | Number of Alarm as well as Trouble messages reported. |
| 2 | INFRA_ALARM_MSG_RECV | Number of Alarm messages reported. |
| 3 | INFRA_GAS_VALUE_MSG_RECV | Number of Gas Value messages reported. |
| 4 | INFRA_GAS_VALUE_WITH_ALARM_MSG _RECV | Number of Gas value as well as Alarm messages reported. |
| 5 | INFRA_LOCK_MSG_RECV | Number of Lock messages reported. |
| 6 | INFRA_BLANK_MSG_RECV | Number of Blank messages reported. |
| 10 | INFRA_ST_0xB1_49_RECV_DISC | Number of discarded messages starting with 0xB1 with length 49 bytes. |
| 11 | INFRA_BAD_ST_49_RECV_DISC | Number of discarded messages not starting with 0xB1 with length 49 bytes. |
| 12 | INFRA_NOT_49_RECV_DISC | Number of discarded messages with length not 49 bytes. |
| 13 | INFRA_NOT_49_RECV_BYTES_DISC | Length of the latest discarded message with length not 49 bytes. |
| 20 | INFRA_BAD_CRC_MSG_DISC | Number of messages discarded because of bad checksum. |

For the Node connected at R1:

Offset = Stat number

Example

The number of messages discarded because of bad start can be found at Offset 11 in Infra-Stats Data Array.

For the Node connected at R2:

Offset = 100 + Stat number

Example

The number of messages discarded because of bad start can be found at Offset 111 in Infra-Stats Data Array.