



**fieldserver**

# **Driver Manual**

## **FS-8700-21 LonWorks**

### **APPLICABILITY & EFFECTIVITY**

Effective for all systems manufactured after September 2021.



Driver Revision: 1.36  
Document Revision: 2.B



MSA Safety

1000 Cranberry Woods Drive  
Cranberry Township, PA 16066 USA  
Website: [www.MSA safety.com](http://www.MSA safety.com)

U.S. Support Information:

+1 408 964-4443  
+1 800 727-4377  
Email: [smc-support@msasafety.com](mailto:smc-support@msasafety.com)

EMEA Support Information:

+31 33 808 0590  
Email: [smc-support.emea@msasafety.com](mailto:smc-support.emea@msasafety.com)

## Contents

<b>1</b>	<b>Description .....</b>	<b>5</b>
<b>2</b>	<b>Definitions .....</b>	<b>5</b>
2.1	NV Updates/Polls .....	5
2.2	Network Management .....	5
2.2.1	LonWorks – Program ID Calculation (SPID).....	5
2.3	Clients/Servers .....	6
2.4	Explicit/Implicit .....	6
2.5	XIF Files.....	6
2.6	Device Resource Files.....	6
2.7	NV Aliases .....	6
2.8	Configuration Properties.....	6
<b>3</b>	<b>Driver Scope of Supply .....</b>	<b>7</b>
3.1	Supplied by MSA Safety .....	7
3.2	Provided by the Supplier of 3 <sup>rd</sup> Party Equipment .....	7
3.3	Additional Files Required.....	7
<b>4</b>	<b>Hardware Connections.....</b>	<b>8</b>
4.1	Service Pin.....	8
4.2	Neuron ID .....	8
4.3	Lon LED's .....	8
<b>5</b>	<b>Data Array Parameters .....</b>	<b>9</b>
<b>6</b>	<b>Implicit Configurations.....</b>	<b>10</b>
6.1	Special Considerations.....	10
6.1.1	Map Descriptor Names (Network Variable Names).....	10
6.1.2	Implicit LonWorks Functions .....	10
6.1.3	SNVT_Index.....	10
6.1.4	Address Table Limit .....	11
6.1.5	Network Management Capability .....	11
6.1.6	Client vs Server Mapping .....	11
6.2	Implicit Configuration of the FieldServer as a Client .....	12
6.2.1	Client Side Connection Parameters .....	12
6.2.2	Client Side Node Parameters.....	12
6.2.3	FieldServer Specific Map Descriptor Parameters .....	13
6.2.4	Driver Related Map Descriptor Parameters .....	13
6.2.5	Timing Parameters .....	14
6.3	Map Descriptor Example .....	14
<b>7</b>	<b>Explicit Configurations.....</b>	<b>15</b>
7.1	Special Considerations.....	15
7.1.1	Map Descriptor Names (Network Variable Names).....	15
7.1.2	LonWorks Functions .....	15
7.1.3	SNVT_Index.....	16
7.1.4	Domain Table Setup .....	16
7.1.5	Network Management .....	17
7.2	Explicit Configuration of the FieldServer as a Client .....	17
7.2.1	Client Side Connection Parameters.....	17
7.2.2	Client Side Node Parameters.....	18
7.2.3	Driver Related Map Descriptor Parameters .....	19
7.2.4	Timing Parameters .....	19
7.2.5	Map Descriptor Examples .....	20
7.3	Explicit Configuration of the FieldServer as a Server.....	22
7.3.1	Server Side Connection Parameters .....	22
7.3.2	Server Side Node Parameters .....	22
7.3.3	FieldServer Related Map Descriptor Parameters .....	22

7.3.4	Driver Related Map Descriptor Parameters .....	23
7.3.5	Timing Parameters .....	23
7.3.6	Map Descriptor Example .....	24
<b>8</b>	<b>Useful Features .....</b>	<b>25</b>
8.1	Using UNVT's .....	25
8.2	Using NV_Min, NV_Max, Etc.....	25
8.3	Throttling Mode (Send Heartbeat).....	25
8.4	XIF Generation .....	26
8.5	Configuration Properties .....	26
8.5.1	Configuration Examples .....	27
8.6	LonMark Object Creation.....	28
8.6.1	LonMark Config file Example – Open Loop “Water Temperature” Sensor.....	28
8.7	Node Status Operation .....	29
8.8	Working with Binary Data .....	29
8.9	Filtering SNVT Variables .....	30
8.9.1	SNVT_Option Field .....	30
8.9.2	SNVT_Units Field.....	30
8.9.3	Map Descriptor Example .....	31
8.10	Accessing Remote Configuration Properties Implemented as Embedded Files.....	32
8.10.1	General Notes .....	32
8.10.2	Determining if NVs Are Used to Expose CPs .....	32
8.10.3	Determining if Embedded Files Are Used to Expose CPs .....	32
<b>9</b>	<b>Vendor Information .....</b>	<b>40</b>
9.1	Echelon LonMaker.....	40
9.1.1	Using LonMaker to Commission the FieldServer.....	40
9.1.2	Removing Previous FieldServer Device Templates in LonMaker.....	40
9.2	Checking LonWorks® Network Using Echelon’s NodeUtility.exe .....	41
9.3	Neuron Systems .....	42
9.4	Honeywell Care .....	42
9.5	CARE and LON PT link Integration .....	43
9.6	Circon_SI .....	45
9.7	Tridium JACE.....	46
9.7.1	Correcting SNVT Indexing Problem in Tridium Niagara .....	46
9.8	Trane Rover.....	46
9.9	Trane Tracer SC .....	46
<b>10</b>	<b>Troubleshooting .....</b>	<b>47</b>
10.1	Debugging a LonWorks connection: Hints and tips.....	47
10.2	Error Messages .....	47
10.2.1	Error Message Lonlive.c 121 .....	47
10.3	Communication Errors using Neuron_ID Polling .....	47
10.4	Monitoring Node Status .....	47
10.5	Exposing Operation Statistics.....	48
10.6	“Illegal” Characters in Network Variable Names .....	49
10.7	Service types currently supported for network variable messages .....	49
10.8	Combining Explicit and Implicit.....	49
<b>11</b>	<b>Reference .....</b>	<b>50</b>
11.1	LonMark Profiles.....	50
11.2	Performance Tests for LonMark Certified blocks .....	50
11.2.1	Startup Times, 10 Input Blocks and 10 Output Blocks Totalling 80 NVs .....	50
11.2.2	Startup Times, 20 Input Blocks and 20 Output Blocks Totalling 160 NVs .....	50
11.3	SNVT_Type .....	51
11.4	SNVT_Type by Number .....	74
11.5	How to Interpret an XIF file.....	75

## 1 Description

The LonWorks driver allows the FieldServer to transfer data to and from devices using LonWorks protocol. The FieldServer can emulate either a Server or Client. The QuickServer Series FieldServers have a built-in LonWorks Interface. A Fieldbus connection is available on the FieldServer. Specifically selected FieldServer gateways with the LonWorks interface can handle up to 4096 Network Variables which can be of the Standard Network Variable Types (SNVT) and/or User-defined Network Variable Types (UNVT).

## 2 Definitions

### 2.1 NV Updates/Polls

On LonWorks networks, information is transferred using Network Variable Updates and Network Variable Polls. The Client requests Network Variables from the Server using Network Variable Polls and Network Variable Updates occur when a Client sends Network Variables to a Server.

### 2.2 Network Management

The FieldServer is able to set its own Domain, Subnet and Node ID at start-up using the FieldServer configuration file. Alternatively, the FieldServer is capable of being commissioned and bound by Network Management Tools such as LonMaker® - see 9.1.1 for further information.

#### 2.2.1 LonWorks – Program ID Calculation (SPID)

Network management tools use the Program ID to identify the different applications running on each device. Two devices on a network may have the same Program ID only if they have identical application/configurations.

The Program ID for the FieldServer consists of a fixed and a variable field (XX in the Program ID below).

90:00:95:47:1E:02:04:XX

The fixed part does not change for different configuration files or for different LonWorks driver versions. The variable part XX, which is also defined as the Model or Revision number, does however change.

The variable part is calculated at start-up when the configuration is loaded on the FieldServer. Certain critical fields in the configuration file are used to calculate this variable part of the Program ID. Thus if the configuration file changes significantly (critical fields) the Program ID will change. Also, as we add new features and capabilities to the LonWorks driver, this variable part of the Program ID may be different between LonWorks driver versions (even though the configuration file is the same).

It is possible though very unlikely that through a change in LonWorks driver and/or configuration file, the program IDs calculates out identical to another combination of driver and configuration. If this is the case with two FieldServers on the same network that run different configurations, one of these devices may fail to commission properly.

The calculated SPID can be found in line 5 of the fserver.xif file uploaded from the FieldServer.

The following configuration can be used to force the SPID:

Connections		
Adapter	, Protocol	, SPID
LonWorks	, LonWorks	, 80:00:95:48:50:02:04:01

### 2.3 Clients/Servers

The FieldServer functions as a Client when polling or sending updates on the LonWorks network and as a Server when being polled or receiving updates. The FieldServer can be bound to a maximum number of 15 LonWorks Nodes.

### 2.4 Explicit/Implicit

Clients can address Servers using explicit or implicit addressing. Clients using explicit addressing obtain their data transfer parameters directly from the FieldServer configuration file. Implicit addressing is used when a Network Management Tool such as LonMaker® is used to connect a FieldServer to other LonWorks Nodes - the FieldServer is assigned its data transfer (binding) parameters via Network Management Tool.

**NOTE: Updating a configuration file or a profile change may result in a change in the XIF file. Any changes in the XIF will require the FieldServer to be recommissioned.**

### 2.5 XIF Files

At start-up the FieldServer creates an external interface file (XIF) called fserver.xif based on the configuration file. The FieldServer differs from most other LonWorks drivers in that it is configurable and therefore its XIF is not fixed for all applications. The list of points available to the network will vary depending on the other networks connected to the FieldServer, and the requirements of the particular application. The recommended procedure for obtaining the XIF file is to upload it using the FieldServer FS-GUI page. Refer to [Section 8.4](#) for more information.

### 2.6 Device Resource Files

The STANDARD device resource file covers FieldServer data type support. All Standard Network Variable Types (SNVTs) in this file are available to the user. These SNVTs are listed in [Section 6.1.3](#). However, due to the sophisticated nature of LonWorks variables, it may not always be possible to typecast the full information supplied in a LonWorks variable to a simple Data Type contained in another protocol. The FieldServer supports Move and Logic functions which would allow the LonWorks variable to be split up and passed to separate simple data types, thus preventing information loss. The FieldServer also supports the sending and receiving of User-defined Network Variable Types (UNVTs) on the LonWorks Network. An UNVT is simply implemented as an array of bytes of user-defined length.

### 2.7 NV Aliases

The FieldServer currently supports a default of 63 network variable aliases to avoid network variable connection constraints. This number may be increased to a maximum of 4096.

### 2.8 Configuration Properties

Configuration Properties (CP's) characterize the behavior of a device in the system. Network installation tools realize this attribute and provide database storage to support maintenance operations. If a device fails and needs to be replaced, the configuration property data stored in the database is downloaded into the replacement device to restore the behavior of the replaced device in the system. Configuration properties are implemented on the FieldServer through configuration network variables. User-defined configuration property types are not supported. [Section 8.5](#) provides a list of standard configuration property types that are supported.

The information that follows describes how to expand upon the factory defaults provided in the configuration files included with the FieldServer.

### 3 Driver Scope of Supply

#### 3.1 Supplied by MSA Safety

Part #	Description
FS-8700-21	Driver Manual

#### 3.2 Provided by the Supplier of 3<sup>rd</sup> Party Equipment

Part #	Description
N/A	LonMaker® Integration Tool from Echelon Corporation (optional network management software)
N/A	LonWatcher from Distech Controls Inc. (optional network management software)
N/A	Circon System Integrator from Circon Systems Corporation (optional network management software)
PCC10	PCCard LonWorks Adapter (optional hardware)


#### 3.3 Additional Files Required

Filename	Auto-Created by driver	Always Loaded by MSA Safety	Conditionally loaded	Comments
Config.csv		X		Template loaded if no custom configuration ordered, otherwise Custom configuration loaded.
fserver.xif	X			Generated at power up. Changes if profile in configuration changes.
lon.ini			X	Used for providing default DSN. Refer to <b>Section 7.1.4</b> .
lonvars.cfg	X			Maintains commissioning settings. If corrupted, delete it, and reboot FieldServer to create new one.

## 4 Hardware Connections

The screw plug supplied with the FieldServer LonWorks interface will connect the FieldServer to the FTT-10 network. The 2-wire twisted-pair connection to the network is polarity insensitive. The FTT-10 network is a free topology network which supports star, loop and/or bus wiring connections. Refer to the FTT-10A Free Topology Transceiver User's Guide from Echelon Corporation for recommended wiring practices if necessary. Additional information on cabling and junction boxes that may be used in twisted pair LonWorks networks are detailed in the following Echelon publication:  
[http://www.echelon.com/support/documentation/bulletin/005-0023-01O\\_Jbox\\_wiring.pdf](http://www.echelon.com/support/documentation/bulletin/005-0023-01O_Jbox_wiring.pdf).

The connection diagram below shows how the QuickServer is connected to a LonWorks network:

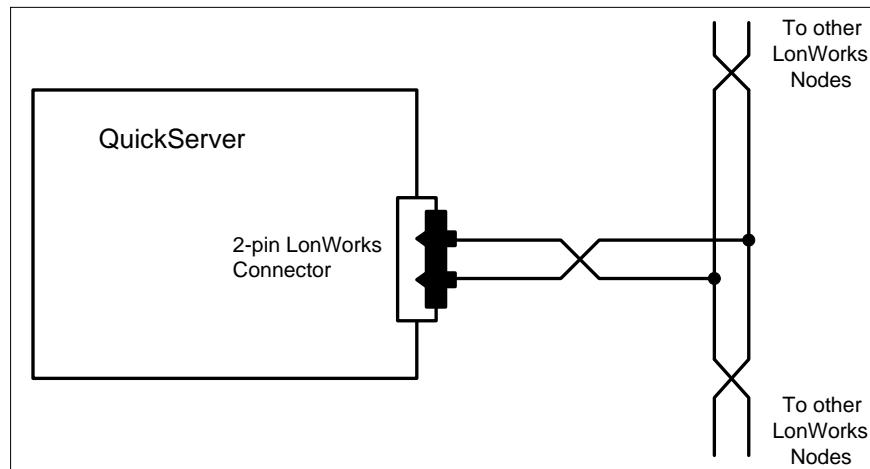

**NOTE: Configure the remote LonWorks devices according to manufacturer's instructions.**

### 4.1 Service Pin

The service pin is used to commission the FieldServer onto the network using a LonWorks Network Management tool.

### 4.2 Neuron ID

The driver prints the Neuron ID on the Driver Message Screen as its starts. On all platforms, the driver can store the Neuron ID in a Data Array so that it can be read by a Client node – see [Section 10.5](#).

### 4.3 Lon LED's

The location of the Lon LED varies between FieldServers. Consult specific FieldServer start-up guides for details. The Lon LED is consistent with the table below for all FieldServers. Note that the LED does not indicate Lon communications, but is a Service LED coupled with the Service Pin which indicates whether the LonWorks interface on the FieldServer is configured or not. It asks for service when flashing and indicates a problem when flashing as described below:

- The LED is solid ON when the neuron is blank or has a hardware failure.
- The LED blinks as 0.5s intervals when the neuron has not been configured with address information (no Lon DCC loaded).
- The LED is OFF when a Lon DCC is loaded.

## 5 Data Array Parameters

Data Arrays are “protocol neutral” data buffers for storage of data to be passed between protocols. It is necessary to declare the data format of each of the Data Arrays to facilitate correct storage of the relevant data. More information is available in [Section 11](#).

Section Title	Function	Legal Values
Column Title		
Data_Arrays		
Data_Array_Name	Provide name for Data Array.	Up to 15 alphanumeric characters
Data_Array_Format	Provide data format. Each Data Array can only take on one format.	Float, Bit, Byte, Uint16, Uint32, Sint16, Sint32 <a href="#">(Section 11)</a>
Data_Array_Length	Number of Data Objects. Must be larger than the data storage area required by the Map Descriptors for the data being placed in this array.	1-10000

### Example

```
// Data Arrays
Data_Arrays
Data_Array_Name , Data_Array_Format , Data_Array_Length
DA_AI_01      , UInt16,           , 200
DA_AO_01      , UInt16,           , 200
DA_DI_01      , Bit,             , 200
DA_DO_01      , Bit,             , 200
```

## 6 Implicit Configurations

### 6.1 Special Considerations

Implicit addressing is used when a Network Management Tool such as LonMaker® is used to connect a FieldServer to other LonWorks nodes - the FieldServer is assigned its data transfer (binding) parameters by the Network Management Tool.

#### 6.1.1 Map Descriptor Names (Network Variable Names)

When using Implicit configuration, the LonWorks driver provides a table of Network Variables for other Nodes to read. These Nodes access the variables according to Index numbers which are automatically assigned by the driver according to the Map Descriptor definition order in the configuration file. The driver also creates an identification table for configuration nodes to read the name and types of variables available on the FieldServer. Within the LonWorks protocol, this table size is limited to 64K bytes. If the application requires a large number of Server mappings (up to 4096), it will be necessary to limit the variable name length. Each Server mapping requires 4 bytes plus the length of the name from this 64K block.

#### 6.1.2 Implicit LonWorks Functions

Implicit Map Descriptors are distinguished from Explicit Map Descriptors by the function used in the Lon\_Function field of the Map Descriptor. Depending on the nature and direction of Data Transfer needed, different implicit functions are available as follows (function field MUST pair up with the Lon\_Function field as shown in the table below).

Lon_Function	Description	Function Field
NVUI	Network Variable Update Input.	PASSIVE
NVPO	Network Variable Polled Output.	
NVPIIMC	Network Variable Polled Input Implicitly addressed Continuously sent.	RDBC
NVUOIMC	Network Variable Update Output Implicitly addressed Continuously sent.	WRBC
NVUOIMX	Network Variable Update Output Implicitly addressed and sent on Change.	WRBX
NVUOIMT	Network Variable Update Output Implicitly addressed sent in Throttling Mode.	WRBC <b>(Section 8.3)</b>
CFG_NVUI	Configuration Network Variable Update Input.	PASSIVE

#### 6.1.3 SNVT\_Index

For implicitly addressed Client Map Descriptors and all Server side Map Descriptors the driver will assign an index to each one, starting from 0 and incrementing to 4095, in the order they appear in the configuration file.

# Configuring the FieldServer

## 6.1.4 Address Table Limit

It is important to note the limitation within LonWorks Implicit addressing that the Address Table used for storing the addresses of all active connections made with the FieldServer is limited to 16 Device Addresses including that of the FieldServer. This is a LonWorks limitation, not a FieldServer limitation, and it means that the FieldServer can only make active implicit connections to 15 other devices. If active connections to more than 15 devices are required, then it is necessary to use Explicit Configuration (NMFETCHC is recommended).

Devices that write to passive Map Descriptors in the FieldServer only are not placed in this table and therefore this limitation does not apply. (A Passive Map Descriptor is recognized by the Passive Parameter in the Function Field).

## 6.1.5 Network Management Capability

When commissioning an implicitly configured FieldServer using the "Traditional" binding method, the configuration parameters below are all that is needed to achieve this purpose. For hints and tips on how to commission the FieldServer using the various Vendor devices refer to **Section 9**.

It is possible to set the FieldServer Online and Offline using the Network Management Tools. This is a LonWorks function and is different from the traditional Online and Offline Status discussed in other FieldServer documentation. When the FieldServer is set offline using this LonWorks feature it will not communicate with other LonWorks devices.

## 6.1.6 Client vs Server Mapping

Distinguishing Client from Server in the LonWorks Environment is more difficult due to the "Peer to Peer" nature of LonWorks design. Clients and Servers can be identified in this environment as follows:

- Clients will write Setpoints and have status written to them, so expect Setpoints and Control Points on the Output side, and Status and Alarms on the Input side.
- Servers will have the opposite structure, with Setpoints and Control Points on the Input Side and Status and Alarms on the Output side.

Distinguishing Client from Server is important to ensure correct matching with other protocols being used on a FieldServer. For example, it would not be useful to map an Output to a BACnet AI point as both points will be expecting to push data out of the FieldServer.

# Configuring the FieldServer

## 6.2 Implicit Configuration of the FieldServer as a Client

**NOTE:** In the tables below, \* indicates an optional parameter, with the bold legal value being the default.

### 6.2.1 Client Side Connection Parameters

Section Title	Function	Legal Values
Connections	Specify protocol used	LonWorks

#### Example:

```
// Client Side Connections  
  
Connections  
Adapter      , Protocol  
LonWorks    , LonWorks
```

### 6.2.2 Client Side Node Parameters

Section Title	Function	Legal Values
Nodes	Provide name for Node.	Up to 32 alphanumeric characters
Protocol	Specify protocol used.	LonWorks
Startup_Write	Initiate a send on startup. Refer to <b>Section 8.3</b> for more information.	Enabled, <b>Disabled</b>

#### Example

```
// Client Side Nodes  
  
Nodes  
Node_Name   , Protocol  
LON_1       , LonWorks
```

## Configuring the FieldServer

### 6.2.3 FieldServer Specific Map Descriptor Parameters

Column Title	Function	Legal Values
Map_Descriptor_Name	Name of this Map Descriptor. (Network Variable Name)	Up to 16 alphanumeric characters
Data_Array_Name	Name of Data Array where data is to be stored or fetched from in the FieldServer.	One of the Data Array names defined in <a href="#">Section 5</a>
Data_Array_Offset	Starting location in Data Array.	0 to (Data_Array_Length-1) as specified in <a href="#">Section 5</a>
Lon_Function	Detailed Function of Client Map Descriptor.	See <a href="#">Section 6.1.2</a> for a list of valid entries for Implicit Connections
Function	Function of Client Map Descriptor.	See <a href="#">Section 6.1.2</a> for a list of valid entries based on the Lon_Function

### 6.2.4 Driver Related Map Descriptor Parameters

Column Title	Function	Legal Values
Node_Name	Name of Node to fetch data from or send data to. Needed for Explicit Addressing.	One of the Node names specified in <a href="#">Section 6.2.2</a>
SNVT_Type	Standard network variable type of the data.	<a href="#">Section 11</a>
SNVT_Option*	Specifies which record out of a complex SNVT we are after.	<a href="#">Section 8.9.1</a>
SNVT_Units*	Specifies the measurement units (e.g. Metric or English).	<a href="#">Section 8.9.2</a>
UNVT_Byte_Length*	Specifies the length in bytes of an UNVT. This Parameter is compulsory when SNVT_Type is set to UNVT, the parameter is not used in conjunction with SNVT's.	1-255 ( <a href="#">Section 8.1</a> )
UNVT_ID	Specifies the Type Number to apply to this particular UNVT. This Parameter is optional when SNVT_Type is set to UNVT, the parameter is not used on conjunction with SNVT's.	0, 146-255 ( <a href="#">Section 8.1</a> )
NV_Min_Value*	Network Variable updates with values less than specified in this field will be ignored.	<a href="#">Section 8.2</a>
NV_Max_Value*	Network Variable updates with values higher than specified in this field will be ignored.	<a href="#">Section 8.2</a>
NV_Delta_Value*	Network Variable updates where the value's delta change is less than specified in this field will be ignored unless the Max_Scan_Time Condition has been met. Compulsory for Throttling Lon Functions used on other Lon Functions. It is possible to configure a start-up write option for throttling Map Descriptor functions instead of waiting for the minimum scan time to pass. Refer to <a href="#">Section 8.3</a> .	<a href="#">Section 8.2</a>

NV_Selfdoc_Text*	The Self-Documenting String for this Network Variable.	Normal Text up to a length of 40 characters; defaults to "" for parameters using string values and 0 for parameters using numeric values
------------------	--	--

## 6.2.5 Timing Parameters

Column Title	Function	Legal Values
Scan_Interval	Seconds per scan.	0-32000
Min_Scan_Time	Minimum Scan Time in seconds.	<a href="#">Section 8.3</a>
Max_Scan_Time	Maximum Scan Time in seconds.	<a href="#">Section 8.3</a>

## 6.3 Map Descriptor Example

```
// Client Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Lon_Function , Function , Node_Name , SNVT_Type
TempOut1 , DA_FO_01 , 0 , NVUOIMT , Wrbc , LON_1 , SNVT_Temp_f
TempOut2 , DA_FO_01 , 1 , NVUOIMX , Wrbc , LON_1 , SNVT_Temp_f
TempOut3 , DA_FO_01 , 2 , NVUOIMC , Wrbc , LON_1 , SNVT_Temp_f
Templn , DA_FL_01 , 0 , NVPIIMT , Rdbc , LON_1 , SNVT_Temp_f
```

This field determines the Map Descriptor's function. See [Section 6.1.2](#) for more information.

Required for Throttling Mode: This field specifies the minimum change needed for a Network Variable's value to invoke an NV Update.

, Nv_Delta_Value	, Min_Scan_Time	, Max_Scan_Time	, Scan_Interval
, 10	, 5	, 20	, -
, -	, -	, -	, -
, -	, -	, -	, 20
, -	, -	, -	, 5

The Data Array will be sampled and evaluated for delta change once every Min\_Scan\_Time (seconds).

If found during Min\_Scan\_Time sampling (Throttling Mode) that Max\_Scan\_Time has elapsed since the last NV Update, a new NV Update will be transmitted.

For Non-Throttled Client Map Descriptors the Scan\_Interval determines the update rate.

## 7 Explicit Configurations

### 7.1 Special Considerations

With Explicit configuration, the FieldServer communicates directly with other devices by specifying the remote device address in the FieldServer configuration.

All the Servers and their Clients need to be on the same domain to be able to communicate. If the LonWorks device's Node ID is not known, it may be read using a utility program e.g. NodeUtil or using a LonWorks Analyzer. All the Client Node CSV files need to have their Subnet\_ID and Node\_ID parameters set to point to their respective Server Subnet and Node ID values. Once the FieldServers are restarted the network should function correctly.

#### 7.1.1 Map Descriptor Names (Network Variable Names)

As a Server, the LonWorks driver provides a table of Network Variables for other Nodes to read. These Nodes access the variables according to Index numbers which are automatically assigned by the driver according to the Map Descriptor definition order in the configuration file. The driver also creates an identification table for configuration nodes to read the name and types of variables available on the FieldServer. Within the LonWorks protocol, this table size is limited to 64K bytes. If the application requires a large number of Server mappings (up to 4096), it will be necessary to limit the variable name length. Each Server mapping requires 4 bytes plus the length of the name from this 64K block.

#### 7.1.2 LonWorks Functions

Explicit Map Descriptors are distinguished from Implicit Map Descriptors by the function used in the Lon\_Function field of the Map Descriptor. Depending on the nature and direction of Data Transfer needed different explicit functions are available as shown below.

**NOTE:**

- Function field MUST pair up with the Lon\_Function field as shown in the table below.
- NMFETCHC is the preferred Lon Function for most applications. ([Section 7.1.5](#))

Lon_Function	Description	Function Field
NVUI	Network Variable Update Input.	SERVER
NVPO	Network Variable Polled Output.	
NVPIEXC	Network Variable Polled Input Explicitly addressed Continuously sent.	RDBC
NVUOEXC	Network Variable Update Output Explicitly addressed Continuously sent.	WRBC
NVUOEXX	Network Variable Update Output Explicitly addressed and sent on Change.	WRBX
NVUOEXT	Network Variable Update Output Explicitly addressed sent in Throttling Mode.	WRBC
NMFETCHC	Network Management Network Variable Fetch Continuously sent (Explicit Addressing only).	RDBC
CFG_NVUI	Configuration Network Variable Update Input.	SERVER

# Configuring the FieldServer

## 7.1.3 SNVT\_Index

The SNVT\_Index field must be specified for all explicitly addressed Client Map Descriptors. These Client Map Descriptors use this field to index their relevant Map Descriptors on the Server side.

## 7.1.4 Domain Table Setup

To be able to communicate with other Nodes on the LonWorks network, the FieldServer must have its Domain, Subnet and Node ID's set. Explicit configuration requires the user to set these parameters.

There are 3 ways in which the FieldServer DSN (Domain, Subnet, Node address) can be set:

- Set the DSN using a Network manager by commissioning the FieldServer into the Network Manager Project. When doing it this way, it is extremely important that the DSN is not forced in the FieldServer Configuration, as the Configuration address will override the Network Manager Address every time the FieldServer is restarted.
- Set the DSN from the Lon.ini file. Using this option provides a default DSN if the FieldServer does not have a DSN assigned. If a Network Manager or the FieldServer Configuration provides a DSN, then the Lon.ini DSN will be ignored.
- Set the DSN in the FieldServer configuration. This option takes precedence over the 2 other addressing options, and should therefore **not** be used when commissioning a FieldServer into a Network with a Network Manager.

### Example 1: Setting the Domain and Subnet from the Lon.ini file

The Domain Table and Subnet IDs can be set from a Lon.ini file on the FieldServer. The FieldServer's LonWorks Node ID will be set from the System\_Station\_Address field in the configuration file if specified; otherwise a default value will be used.

Lon.ini file contents:

```
:D50:S01:
```

### Example 2: Setting the Node, Domain and Subnet in the configuration file

```
FieldServer
System_Station_Address , Title
[Node_Id]           , :D[Domain_ID]:S[Subnet_ID]:[Title continued...]
```

The Title field must start with “:D”, followed by the Domain\_ID in hexadecimal notation, followed by “:S”, followed by the Subnet\_ID in hexadecimal notation. The domain length is automatically determined by the number of digits in the [Domain\_ID] field. Since 2 hexadecimal digits constitute 1 byte, “:D123456:” for example would have a length of 3.

Specifying the Domain and Subnet in the configuration file will override the settings from the Lon.ini file.

# Configuring the FieldServer

## 7.1.5 Network Management

The NVPIEXC command generally used for polling has the limitation that data can only move in one direction (Server to Client). The added functionality of a Write-through was added to the network management fetch command (NMFETCHC) to provide movement of data back to the polled node. Thus, should the data in the Data Array linked to a NMFETCHC Map Descriptor change by another process, the data will be propagated to the polled node by means of a network variable update.

Another useful feature of the NMFETCHC function is that it can perform reads to any other type of Node function (NVUI, CFG\_NVUI, NVUOEXX, NVPIIMC, etc.). This means that even Client Map Descriptors can be read this way.

Network management fetch requests received on polled nodes are handled differently from normal NV Poll requests. The response to a NV Poll will contain valid data. Data is valid if the node that is the source of the data is online and if this data is not too old. The data in the response to a network management fetch will not be checked for validity, however, it will simply respond with the current data in the variable.

## 7.2 Explicit Configuration of the FieldServer as a Client

### 7.2.1 Client Side Connection Parameters

Section Title		
Connections		
Column Title	Function	Legal Values
Adapter	Adapter Name.	LonWorks
Protocol	Specify protocol used.	LonWorks
Default_Service*	Specify messaging service used.	Ack, UnAck <sup>1</sup>

#### Example

```
// Client Side Connections  
  
Connections  
Adapter      , Protocol     , Default_Service  
LonWorks     , LonWorks     , Ack
```

<sup>1</sup> Only applies to explicit addressing mode. Use Network Management Tool to set desired service type for implicit messaging. UnAck Service is commonly used to achieve quicker network variable update rates, but message delivery is not guaranteed.

## Configuring the FieldServer

### 7.2.2 Client Side Node Parameters

Section Title	Column Title	Function	Legal Values
Nodes	Node_Name	Provide name for Node.	Up to 32 alphanumeric characters.
	Subnet_ID	Server (destination) Node's Subnet ID of an explicitly addressed message.	1-255
	Node_ID	Server (destination) Node's Node ID of an explicitly addressed message.	1-127
	Protocol	Specify protocol used.	LonWorks
	Startup_Write	Initiate a send on startup. Refer to <a href="#">Section 8.3</a> for more information.	Enabled, <b>Disabled</b>
	NM_Extended_Commands*	Used to enable Wink install type network management messages on network variable updates from NMFETCHC function Write-Throughs. Certain devices only allow Wink install messages updating network variables.	Enabled, <b>Disabled</b>
	Readback_Option*	<p>This Client Side parameter enables the user to configure the timing of a read after a write. The Readback operation will apply to all drivers that support Active Reads and Write-Through operations.</p> <p><b>Readback_Asynchronously</b> - When a write occurs, the read will occur when scheduled.</p> <p><b>Readback_On_Write</b> - When a write occurs, set the timer to 0, so Responsible Map Descriptor gets queued in the next cycle.</p> <p><b>Readback_Immediately_On_Write</b> - Prioritize both write and read to happen in a higher priority queue than normal reads. The Readback operation will apply to all drivers that support Active Reads and Write-Through operation.</p>	<b>Readback_Asynchronously,</b> <b>Readback_Asynchronously,</b> <b>Readback_Immediately_On_Write</b>

#### Example

```
// Client Side Nodes

Nodes
Node_Name , Subnet_ID , Node_ID , Protocol , NM_Extended_Commands , Readback_Option
LON_1      , 1        , 1        , LonWorks , Enabled                  , Readback_Asynchronously
```

## Configuring the FieldServer

### 7.2.3 Driver Related Map Descriptor Parameters

Column Title	Function	Legal Values
Node_Name	Name of Node to fetch data from or send data to. Needed for Explicit Addressing.	One of the Node Names specified in <b>Section 7.2.2</b>
SNVT_Index	Server Network Variable Index.	0-4095
SNVT_Type	Standard network variable type of the data.	<b>Section 11</b>
SNVT_Option*	Specifies which record out of a complex SNVT we are after.	<b>Section 8.9.1</b>
SNVT_Units*	Specifies the measurement units when units other than Metric are required.	<b>Section 8.9.2</b>
UNVT_Byte_Length*	Specifies the length in bytes of an UNVT. This Parameter is compulsory when SNVT_Type is set to UNVT, the parameter is not used on conjunction with SNVT's.	1-255 ( <b>Section 8.1</b> )
UNVT_ID	Specifies the Type Number to apply to this particular UNVT. This Parameter is optional when SNVT_Type is set to UNVT. The parameter is not used on conjunction with SNVT's.	0, 146-255 ( <b>Section 8.1</b> )
NV_Min_Value*	Network Variable updates with values less than specified in this field will be ignored.	<b>Section 8.2</b>
NV_Max_Value*	Network Variable updates with values higher than specified in this field will be ignored.	<b>Section 8.2</b>
NV_Delta_Value*	Network Variable updates where the value's delta change is less than specified in this field will be ignored unless the Max_Scan_Time Condition has been met. Compulsory for Throttling Lon Functions, not used on other Lon Functions. It is possible to configure a start-up write option for throttling Map Descriptor functions instead of waiting for the minimum scan time to pass. Refer to <b>Section 8.3</b> .	<b>Section 8.2</b>
NV_Selfdoc_Text*	The Self-Documenting String for this Network Variable.	Normal Text up to a length of 40 characters. Defaults to "" for parameters using string values and 0 for parameters using numeric values.

### 7.2.4 Timing Parameters

Column Title	Function	Legal Values
Scan_Interval*	Seconds per scan.	0-32000, <b>2s</b>
Min_Scan_Time*	Minimum Scan Time in seconds. Compulsory for Throttling Lon Functions only. Not used on other Lon Functions.	<b>Section 8.3</b>
Max_Scan_Time*	Maximum Scan Time in seconds. Compulsory for Throttling Lon Functions only. Not used on other Lon Functions.	<b>Section 8.3</b>

# Configuring the FieldServer

## 7.2.5 Map Descriptor Examples

### Explicit Config Using Network Management Polls

The Map Descriptor pollTemp\_p shows the use of SNVT\_Units for Scaling when polling temperature. The Map Descriptor pollSwitch shows the use of SNVT\_Option for Selective data scanning. This only brings in the "State" portion of SNVT\_Switch.

Map_Descriptors					
Map_Descriptor_Name	, Data_Array_Name	, Data_Array_Offset	, Lon_Function	, Function	, Node_Name
pollTemp_p	, DA_Explicit	, 1	, NMFETCHC	, Rdbc	, Remote_Node
pollSwitch	, DA_Explicit	, 2	, NMFETCHC	, Rdbc	, Remote_Node

This field determines the Map Descriptor's function. See **Section 7.2.3** for information.

, SNVT_Index	, SNVT_Type	, SNVT_Units	, SNVT_Option	, Scan_Interval
, 0	, SNVT_temp_p	, Deg_F	, -	, 1.0s
, 1	, SNVT_switch	, -	, State	, 1.0s

Explicitly addressed Client Map Descriptors use this field to extract the correct variable from the remote device's external interface.

Explicitly Addressed Client Map Descriptors use this field to point to their relevant Server Map Descriptors.

### Polling UNVT's

Map_Descriptors					
Map_Descriptor_Name	, Data_Array_Name	, Data_Array_Offset	, Lon_Function	, Function	
pollUNVT	, DA_Explicit	, 101	, NMFETCHC	, Rdbc	

, Node_Name	, SNVT_Index	, SNVT_Type	, UNVT_Byte_Length	, Scan_Interval
, Remote_Node	, 2	, UNVT	, 31	, 1.0s

UNVT Byte length must be specified for correct operation.

# Configuring the FieldServer

## Using Neuron ID to Address Devices (Client Drivers Only)

It is possible to poll remote LonWorks devices using their Neuron ID's instead of the traditional Network Manager method. The Neuron ID is the 12 Digit Hex identifier of the associated LonWorks Device. An example configuration follows.

Note that Neuron ID addressing is considered explicit addressing so the station address, domain ID and subnet ID must be set as described in **Section 7.1.4**.

Neuron ID addressing is independent of domains, subnet, nodes and can therefore reach any device connected to the LonWorks network. The FieldServer needs to be commissioned with a Network Management tool for the routers to know it's there, and then neuron based packets will be passed through the router.

Bridge
System_Station_Address , Title
110 , D01:S01:Neuron ID Example:

On the Client side add a new field under Nodes as shown below:

Nodes
Node_Name , Node_ID , Protocol , Neuron_ID
Lon_Srv_11 , 11 , LonWorks , F912AB440100

Create a Map Descriptor as Follows:

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Lon_Function , Function
1nviAmp1 , DA_001 , 0 , NMFETCHC , RDBC
, Node_Name , SNVT_Index , SNVT_Type , Scan_Interval
, Lon_Srv_11 , 000 , SNVT_amp , 0s

# Configuring the FieldServer

## 7.3 Explicit Configuration of the FieldServer as a Server

NOTE: In the tables below, \* indicates an optional parameter, with the bold legal value being the default.

### 7.3.1 Server Side Connection Parameters

Section Title		
Column Title		
Connections	Adapter Name.	
Adapter	Protocol	LonWorks
Protocol	Specify protocol used.	LonWorks

#### Example

```
// Server Side Connections  
  
Connections  
Adapter      , Protocol  
LonWorks     , LonWorks
```

### 7.3.2 Server Side Node Parameters

Section Title		
Nodes		
Column Title	Function	Legal Values
Node_Name	Provide name for Node.	Up to 32 alphanumeric characters
Protocol	Specify protocol used.	LonWorks
Startup_Write	Initiate a send on startup.	Enabled, <b>Disabled</b>

#### Example

```
// Server Side Nodes  
  
Nodes  
Node_Name   , Protocol  
LON_1       , LonWorks
```

### 7.3.3 FieldServer Related Map Descriptor Parameters

Column Title	Function	Legal Values
Map_Descriptor_Name	Name of this Map Descriptor.	Up to 16 alphanumeric characters
Data_Array_Name	Name of Data Array where data is to be stored or fetched from in the FieldServer.	One of the Data Array names defined in <b>Section 5</b>
Data_Array_Offset	Starting location in Data Array.	0 to (Data_Array_Length-1) as specified in <b>Section 5</b>
Lon_Function	Detailed Function of Client Map Descriptor.	See <b>Section 7.1.2</b> for a list of valid entries
Function	Function of Client Map Descriptor.	

## Configuring the FieldServer

### 7.3.4 Driver Related Map Descriptor Parameters

Column Title	Function	Legal Values
Node_Name	Name of Node to fetch data from or send data to. Needed for Explicit Addressing.	One of the node names specified under Client Node Parameters
SNVT_Index	Server Network Variable Index.	0-4095
SNVT_Type	Standard network variable type of the data.	<a href="#">Section 11</a>
SNVT_Option	Specifies which record out of a complex SNVT we are after.	<a href="#">Section 8.9.1</a>
SNVT_Units	Specifies the measurement units if units other than Metric is required.	<a href="#">Section 8.9.2</a>
UNVT_Byte_Length*	Specifies the length in bytes of an UNVT. This Parameter is compulsory when SNVT_Type is set to UNVT, the parameter is not used on conjunction with SNVT's.	1-255 ( <a href="#">Section 8.1</a> )
UNVT_ID	Specifies the Type Number to apply to this particular UNVT. This Parameter is optional when SNVT_Type is set to UNVT, the parameter is not used on conjunction with SNVT's.	0, 146-255 ( <a href="#">Section 8.1</a> )
NV_Min_Value*	Network Variable updates with values less than specified in this field will be ignored.	<a href="#">Section 8.2</a>
NV_Max_Value*	Network Variable updates with values higher than specified in this field will be ignored.	<a href="#">Section 8.2</a>
NV_Delta_Value*	Network Variable updates where the value's delta change is less than specified in this field will be ignored unless the Max_Scan_Time Condition has been met. Compulsory for Throttling Lon Functions only. Not used on other Lon Functions.	<a href="#">Section 8.3</a>
NV_Selfdoc_Text	The Self-Documenting String for this Network Variable.	Normal Text up to a length of 40 characters. Defaults to "" for parameters using string values and 0 for parameters using numeric values.
Bad_Value_Validation*	Set to Disabled to allow the out of range value.	<a href="#">Enabled</a> , Disabled

### 7.3.5 Timing Parameters

Column Title	Function	Legal Values
Scan_Interval*	Seconds per scan.	0-32000, <a href="#">2s</a>
Min_Scan_Time*	Minimum Scan Time in seconds. Compulsory for Throttling Lon Functions only. Not used on other Lon Functions.	<a href="#">Section 8.3</a>
Max_Scan_Time*	Maximum Scan Time in seconds. Compulsory for Throttling Lon Functions only. Not used on other Lon Functions.	<a href="#">Section 8.3</a>

## Configuring the FieldServer

### 7.3.6 Map Descriptor Example

```
// Server Side Map Descriptors
Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Lon_Function , Function , Node_Name , SNVT_Index
NviTemp , DA_FI_01 , 0 , NVUI , Server , LON_1 , -
NviTemp , DA_FO_01 , 1 , NVPO , Server , LON_1 , -
NviTemp , - , - , CFG_NVUI , Server , LON_1 , -
```

Server NVUI can be grouped with Client NV Update types and NMFETCHC. Server NVPO can be grouped with Client NV Poll types and NMFETCHC.

Explicitly Addressed Client Map Descriptors use this field to point to their relevant Server Map Descriptors.

```
, Nv_Delta_Value , SNVT_Type , Nv_Min_Value , Nv_Max_Value , Nv_Selfdoc_text
, 10 , SNVT_Temp_f , 0 , - , "@0|1;WaterTemp"
, - , SNVT_Temp_f , 0 , 150 , "&200\x8023"
, - , SNVT_Temp_f , - , 150 , "&200\x8020"
```

Required for Throttling Mode: This field specifies the minimum change needed for a Network Variable's value to invoke an NV Update.

If specified for a Floating point or Integer SNVT then NV Updates with values higher than specified here will not be written to its relevant Data Array location.

The Self-documenting String for a Network Variable can be up to 40 characters wide.

If specified for a Floating point or Integer SNVT then NV Updates with values lower than specified here will not be written to its relevant Data Array location.

## 8 Useful Features

### 8.1 Using UNVT's

UNVT's are User-defined Network Variable Types and are defined in the configuration file by filling the SNVT\_Type field with "UNVT". The UNVT's size in bytes should also be added to the UNVT\_Byte\_Length field and the UNVT's type number in the UNVT\_ID field. Valid UNVT\_IDs are 0 and the range 146 to 255. The UNVT\_ID value will be substituted with the default value of 0 if the field is left empty. Refer to the example in [Section 7.2.3](#).

### 8.2 Using NV\_Min, NV\_Max, Etc.

The NV\_Min\_Value, NV\_Max\_Value functionality were added to stop the propagation of 'out of bounds' network variables across a LonWorks network. NV values higher than assigned by the NV\_Max\_Value field or lower than assigned by NV\_Min\_Value field will not be sent out on the network or copied to their relevant Data Arrays. If one or both of these fields are not assigned values, limit checking will not be performed on that particular field. This functionality applies only to SNVT's of either Floating point or Integer formats. Refer to the examples in [Sections 6.2.4](#) and [8.6.1](#).

One or both of these fields can be linked to a configuration network variable update input in order to create an interoperable configuration property. For further information refer to [Section 8.5](#).

### 8.3 Throttling Mode (Send Heartbeat)

When the Lon\_Function field specifies a Throttling Mode Client Map Descriptor the NV\_Delta\_Value, Min\_Scan\_Time and Max\_Scan\_Time fields all need to be assigned values.

When operating in Throttling Mode, a Network Variable's value will be sampled at the Min\_Scan\_Time period. If the value differs by an amount greater than or equal to that specified by the NV\_Delta\_Value field from the previously transmitted value, the NV update will be transmitted. Otherwise an NV update will be only sent if the time since the last update is greater than or equal to the Max\_Scan\_Time field value. Refer to the examples in [Section 6.2.4](#).

This functionality applies only to SNVT's of either Floating point or Integer formats.

The driver can be configured to initiate a send on startup rather than waiting for the minimum scan interval to pass. The following example describes the configuration required:

Nodes
Node_Name , Node_ID , Protocol , Startup_Write
Lon_Srv_11 , 11 , LonWorks , Enabled

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Lon_Function , Function , Node_Name
nvoAmp , DA_001 , 0 , NVUOEXT , WRBC , Lon_Srv_11

, SNVT_Index , SNVT_Type , Min_Scan_Time , Max_Scan_Time , NV_Delta_Value
, 000 , SNVT_amp , 30s , 60s , 30

**NOTE: Refer to Section 8.5.1. To configure Send Heartbeat parameters dynamically the NV\_Min\_Send\_Time, NV\_Max\_Send\_Time and NV\_Delta\_Value should be used with Configuration Network Variables.**

### 8.4 XIF Generation

After start-up the FieldServer creates a XIF (version 4.0) according to the configuration loaded. This file is called fServer.xif and can be uploaded from the FieldServer using the FieldServer FS-GUI.

To upload the XIF file using the FS-GUI:

- Enter the FieldServer IP Address followed by \fserver.xif into a web browser.
  - For example: 192.168.2.101\fserver.xif

The FieldServer's XIF file is internally generated by the LonWorks driver using the information contained in the FieldServer's configuration file (CONFIG.CSV). It is not possible to download an externally created XIF file using NodeUtil or LonMaker®. Additionally, it is also not possible to download any type of externally created network variables default values file. The FieldServer's configuration can be changed by uploading and editing the CONFIG.CSV file, and therefore the XIF file must be obtained by uploading it from the FieldServer.

**NOTE: The XIF file will change whenever the configuration file has been changed, downloaded and the FieldServer restarted.**

### 8.5 Configuration Properties

Configuration Properties are implemented on the FieldServer using configuration Network Variables. Configuration Network Variables take the form of update inputs in order to be updated or read by a network management tool. Each Configuration Network Variable will have its own Map Descriptor. Since the data carried by a Network Variable is intended as a configuration property for other already declared non-configuration Network Variable(s), no Data Array needs to be assigned to its Map Descriptor.

The following configuration property types are supported:

- Apply gain to Input and Output Network Variable values via SNVT\_nv\_type.
- Add Offset values to Input and Output Network Variable Values via SNVT\_nv\_type.
- Enforce Minimum and Maximum Range on Network Variables.
- Set Update Rate on Active Network Variables.
- Set Throttling Mode (Min/MaxSendTime, DeltaValue) properties on Active Network Variables.
- Allow adjusting of scan interval on active LonWorks Map Descriptors (SCPTupdateRate (98)).
- SCPTGain (31) for Modbus Translations via SNVT\_multiv.
- Allow changing of the NV\_Delta\_Value (SCPTsndDelta (27)).
- SCPTnvType that is mandatory on changeable type interfaces for FieldServer specific LonMark certification of the protocol gateway profile.

Configuration Properties can be declared to belong to the entire Node, to an Object(s) or to a Network Variable(s). This declaration defines the scope of the Configuration Property. Configuration Properties that belong to an Object are declared as a part of the Object; Configuration Properties associated with a Network Variable(s) are declared as belonging to the Network Variable(s) etc.

## Additional Information

A Configuration Property's Type and Responsible Map Descriptor(s) are declared by the Configuration Network Variable's self-documentation string as follows:

For linking to the entire node:

"&0, , 0\x80, [SCPT Index]"

Example: "&0, , 0\x80, 20"

For linking to object(s):

"&1, [Object Index(s)], 0\x80, [SCPT Index]"

Example: "&1, 0.2.3, 0\x80, 23"

For linking to network variable(s):

"&2, [NV Index(s)], 0\x80, [SCPT Index]"

Example: "&2, 0.1.2.4.7, 0\x80, 20"

### 8.5.1 Configuration Examples

#### Config Network Variable Map Descriptors Applied to Output NV's

Map_Descriptors									
Map_Descriptor_Name	Data_Array_Name	Data_Array_Offset	Lon_Function	Function	Node_Name	SNVT_Type	NV_Gain		
nciOut01a	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_nv_type	,
nciOut01b	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count_inc_f	,
nciOut01c	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count_inc_f	,
nciOut01d	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count_inc_f	,
nciOut01e	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_time_sec	,
nciOut01f	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_time_sec	,
nciOut01g	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_nv_type	,
nciOut01h	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count_inc_f	,
nciOut01i	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count_inc_f	,
nciOut01j	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_nv_type	,
nciOut01k	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count	,
nciOut01l	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count	,
nciOut01m	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count	,
nciOut01n	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_time_sec	,
nciOut01o	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_time_sec	,
nciOut01p	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_nv_type	,
nciOut01q	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count	,
nciOut01r	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_count	,
nciOut01s	,	-	,	-	CFG_NVUI	Passive	, Lon_Srv_1	, SNVT_multiv	, 1.00

, NV_Min_Value	, NV_Max_Value	, NV_Min_Send_Time	, NV_Max_Send_Time	, NV_Delta_Value	, NV_Value_String	, Nv_Selfdoc_text
,"	,	,	,	,	"0 52 12 4 1 0 0"	"&2, 0, 0\x80, 254"
,-3.40282e+038	,	,	,	,	"	"&2, 2, 0\x80, 23"
,	, 3.40282e+038	,	,	,	"	"&2, 2, 0\x80, 20"
,	,	,	,	, 1.00	"	"&2, 2, 0\x80, 27"
,	,	,	, 10.00	,	"	"&2, 2, 0\x80, 49"
,	,	, 1.00	,	,	"	"&2, 2, 0\x80, 52"
,	,	,	,	,	"0 52 12 4 1 0 0"	"&2, 3, 0\x80, 254"
,	, -3.40282e+038	,	,	,	"	"&2, 3, 0\x80, 23"
,	, 3.40282e+038	,	,	,	"	"&2, 3, 0\x80, 20"
,	,	,	,	,	"0 8 6 2 1 0 0 "	"&2, 4, 0\x80, 254"
,0	,	,	,	,	"	"&2, 4, 0\x80, 23"
,	, 65535	,	,	,	"	"&2, 4, 0\x80, 20"
,	,	,	,	, 1.00	"	"&2, 4, 0\x80, 27"
,	,	,	, 10.00	,	"	"&2, 4, 0\x80, 49"
,	,	, 1.00	,	,	"	"&2, 4, 0\x80, 52"
,	,	,	,	,	"0 8 6 2 1 0 0 "	"&2, 5, 0\x80, 254"
,0	,	,	,	,	"	"&2, 5, 0\x80, 23"
,	, 65535	,	,	,	"	"&2, 5, 0\x80, 20"
,	,	,	,	,	"	"&1, 1, 0\x80, 31"

### **Config Network Variable Map Descriptors Applied to Input NV's**

Map_Descriptor_Name	Data_Array_Name	Data_Array_Offset	Lon_Function	Function	Node_Name	SNVT_Type	NV_Gain	NV_Min_Value
nciln01a	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_nv_type	,	-
nciln01b	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_count_inc_f,	,	-3.40282e+038
nciln01c	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_count_inc_f,	,	-
nciln01d	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_nv_type	,	-
nciln01e	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_count_inc_f,	,	-3.40282e+038
nciln01f	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_count_inc_f,	,	-
nciln01g	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_time_sec	,	-
nciln01h	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_nv_type	,	-
nciln01i	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_count	,	0
nciln01j	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_count	,	-
nciln01k	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_nv_type	,	-
nciln01l	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_count	,	0
nciln01m	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_count	,	-
nciln01n	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_time_sec	,	-
nciln01o	,	-	,	CFG_NVUI	Passive	, Lon_Srv_1 , SNVT_muldiv	, 1.00	,

, NV_Max_Value	, NV_Min_Send_Time	, NV_Max_Send_Time	, NV_Delta_Value	, NV_Value_String	, Nv_Selfdoc_Text
,	,	,	,	"0 52 12 4 1 0 0"	, "&2, 6, 0x80, 254"
,	,	,	,	"	, "&2, 6, 0x80, 23"
3.40282e+038	,	,	,	"	, "&2, 6, 0x80, 20"
,	,	,	,	"0 52 12 4 1 0 0"	, "&2, 7, 0x80, 254"
,	,	,	,	"	, "&2, 7, 0x80, 23"
3.40282e+038	,	,	,	"	, "&2, 7, 0x80, 20"
,	1.00	,	,	"	, "&2, 7, 0x80, 98"
,	,	,	,	"0 8 6 2 1 0 0 "	, "&2, 8, 0x80, 254"
,	,	,	,	"	, "&2, 8, 0x80, 23"
65535	,	,	,	"	, "&2, 8, 0x80, 20"
,	,	,	,	"0 8 6 2 1 0 0 "	, "&2, 9, 0x80, 254"
,	,	,	,	"	, "&2, 9, 0x80, 23"
65535	,	,	,	"	, "&2, 9, 0x80, 20"
,	1.00	,	,	"	, "&2, 9, 0x80, 98"
,	,	,	,	"	, "&1, 2, 0x80, 31"

### **8.6 LonMark Object Creation**

For more information on filling out the Node Self-Documentation String as well as the relevant Network Variable Self-Documentation Strings in order to create a LonMark Object, consult the following documentation from the LonMark Interoperability Association at [www.lonmark.org](http://www.lonmark.org):

- Understanding LonMark Self-Documentation
- LonMark Application Layer Interoperability Guidelines

The example below shows how LonMark Objects can be assigned in FieldServer configuration files.


In this example the standard Open Loop Sensor Object (Type 1) is used to create a Water Temperature Sensor that will send out its current status via Network Variable Updates.

#### **8.6.1 LonMark Config file Example – Open Loop “Water Temperature” Sensor**

```
// Client Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Lon_Function , Function , Node_Name , SNVT_Index
nvoTemp , DA_FL_01 , 0 , NVUOIMC , Wrbc , LON_1 , -
NviTempMin , - , - , CFG_NVUI , Server , LON_1 , -
NviTempMax , - , - , CFG_NVUI , Server , LON_1 , -
, SNVT_Type , Nv_Min_Value , Nv_Max_Value , Nv_Selfdoc_Text
, SNVT_Temp_f , - , - , "@0|1;WaterTemp"
, SNVT_Temp_f , 10 , - , "&200|x8023"
, SNVT_Temp_f , - , 300 , "&200|x8020"
```

The entries under Nv\_Selfdoc\_Text are described in more detail below:

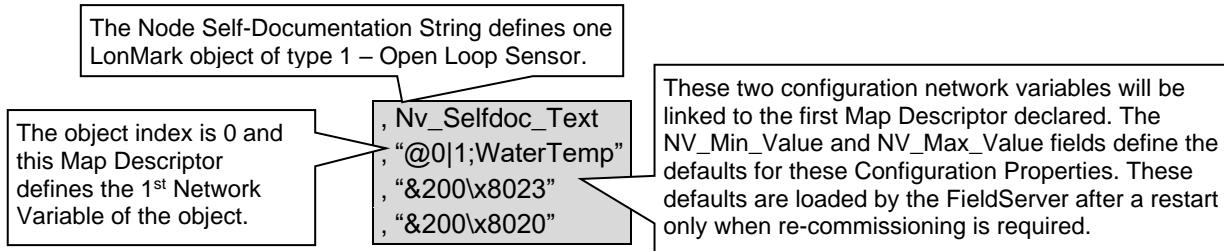

### 8.7 Node Status Operation

When binding network variables on the FieldServer, the node status will be on-line before binding as well as after un-binding network variables. A Node will go off-line only when a bound network variable of that node goes off-line (e.g. is disconnected).

When using a network tool to commission the FieldServer (implicit addressing), the FieldServer LonWorks Node must be placed ONLINE on the LonWorks network before it will pass data with other bound network variables. The following messages may appear on the driver screen when using the FS-GUI which indicates that the FieldServer has not been put into the ONLINE state yet:

"Not sending NV msg for [variable name], Node OFFLINE!"

To set the FieldServer to ONLINE using LonMaker:

Right-click on the FieldServer device and select Manage.

On the Devices Tab, click the ONLINE button.

The FieldServer LonWorks Node is always ONLINE when using explicit addressing.

**NOTE: The FieldServer Node\_Status function (refer to the FieldServer Configuration Manual) looks at the Node\_ID configured in order to monitor Node status. In implicit applications this may not be the real Node\_ID since Node\_ID is allocated by the network manager.**

### 8.8 Working with Binary Data

When sending binary data on a LonWorks network, there are two SNVT's that are most commonly used, namely SNVT\_State and SNVT\_Switch.

SNVT\_State is a 16 bit integer that allows the user to send 16 data bits to the remote device. To do this, the 16 data bits need to be packed into an integer word. If this packing is already done when the value is transferred into the FieldServer, then the SNVT need only be linked to the relevant Data Array offset for transfer out of the FieldServer. However, if the FieldServer is picking up 16 separate bits from another network for this variable, then the FieldServer Packed\_Bit function can be used to achieve the packing. See the FieldServer Configuration manual for more details on the Packed\_Bit function.

SNVT\_Switch is a two byte value consisting of an analog value in the left hand byte (VALUE portion), and a binary state in the right hand byte (STATE portion). LonMark guidelines for this SNVT stipulate that the VALUE portion has a range from 0-100%, and that the STATE portion can assume a value of 1 or 0. However, since the raw data type for these two values is byte (a value ranging from 0-255), care needs to be taken when transferring values into this SNVT to make sure the source values are within the legal range. If a value is placed into one of these bytes that is deemed out of range, then a -1 value will be sent on the LonWorks network to indicate out of range. Also note that when sending binary status in a SNVT Switch, some devices expect the VALUE portion to change when the STATUS portion changes, so an analog value that changes in sympathy with the binary state may be necessary.

### 8.9 Filtering SNVT Variables

#### 8.9.1 SNVT\_Option Field

This field can be used to isolate a specific record within a complex SNVT. **Section 11** shows which SNVTs are currently attributed with SNVT\_Option capabilities.

#### 8.9.2 SNVT\_Units Field

The measurement units of a SNVT is fixed as far as it is transported across the LonWorks network, but by the setting of the SNVT\_Units field it is possible to specify how the data is made available in Data Arrays. For example, SNVT\_temp\_f is always transported across the LonWorks network as degrees Celsius, but by setting the SNVT\_Units field to Deg\_F the measurement units of the Map Descriptor's data will be set to degrees Fahrenheit. The following table shows which SNVT's currently have SNVT\_Units capabilities.

<b>SNVT_Type</b>	<b>SNVT_Option</b>	<b>SNVT_Units</b>	<b>Length</b>	<b>Measurement Units</b>
SNVT_flow	N/A	Liters/Second	1	Liters per Second
		Cubic-feet-per-minute	1	Cubic-feet-per-minute
		Gallons-per-minute	1	Gallons-per-minute
SNVT_flow_f	N/A	Liters/Second	1	Liters per Second
		Cubic-feet-per-minute	1	Cubic-feet-per-minute
		Gallons-per-minute	1	Gallons-per-minute
SNVT_press_f	N/A	Inch_H20	1	Inches of water
SNVT_press_p	N/A	Inch_H20	1	Inches of water
SNVT_temp	N/A	Raw	1	Raw, unadjusted data
		Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)
SNVT_temp_f	N/A	Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)
		Raw	1	Raw, unadjusted data
SNVT_temp_p	N/A	Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)
		Raw	1	Raw, unadjusted data
SNVT_switch <sup>2</sup>	All	Raw	2	Raw, unadjusted data
	Value	Raw	1	Raw, unadjusted data
		Percent	1	Percent (%)
	State	Raw	1	Raw, unadjusted data

---

<sup>2</sup> See also **Section 8.8**.

<b>SNVT_Type</b>	<b>SNVT_Option</b>	<b>SNVT_Units</b>	<b>Length</b>	<b>Measurement Units</b>
SNVT_temp_setpt	All	Raw	12	Raw, unadjusted data
		Deg_C	6	Degrees Celsius (°C)
		Deg_F	6	Degrees Fahrenheit (°F)
	Occupied_cool	Raw	1	Raw, unadjusted data
		Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)
	Standby_cool	Raw	1	Raw, unadjusted data
		Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)
	Unoccupied_cool	Raw	1	Raw, unadjusted data
		Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)
SNVT_temp_setpt	Occupied_heat	Raw	1	Raw, unadjusted data
		Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)
	Standby_heat	Raw	1	Raw, unadjusted data
		Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)
	Unoccupied_heat	Raw	1	Raw, unadjusted data
		Deg_C	1	Degrees Celsius (°C)
		Deg_F	1	Degrees Fahrenheit (°F)

### 8.9.3 Map Descriptor Example

#### Selecting Multiple Convert Units on SNVT\_flow and SNVT\_flow\_f

// Client Side Map Descriptors				
Map_Descriptors				
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Lon_Function , Function				
nviFlow1 , DA_001 , 0 , NVPIEXC , RDBC				
nviFlow1_f , DA_001 , 1 , NVPIEXC , RDBC				
nviFlow2 , DA_001 , 2 , NVPIEXC , RDBC				
nviFlow2_f , DA_001 , 3 , NVPIEXC , RDBC				
, Node_Name , SNVT_Index , SNVT_Type , SNVT_Units				
, Lon_Srv_11 , 0 , SNVT_flow , Cubic-feet-per-minute				
, Lon_Srv_11 , 1 , SNVT_flow_f , Cubic-feet-per-minute				
, Lon_Srv_11 , 2 , SNVT_flow , Gallons-per-minute				
, Lon_Srv_11 , 3 , SNVT_flow_f , Gallons-per-minute				
SNVT_flow and SNVT_flow_f is always transported across the LonWorks network as liters/second, but by setting the SNVT_Units field the units of the Map Descriptor's data can be changed.				
<span style="border: 1px solid black; padding: 5px;">The same Map Descriptor can be used on the Server Side but the Function must be changed to Passive.</span>				

### 8.10 Accessing Remote Configuration Properties Implemented as Embedded Files

#### 8.10.1 General Notes

A device's configuration properties (CPs) can be exposed as Network Variables (NVs) that can be viewed in LonMaker, or as embedded files that cannot be viewed in LonMaker.

#### 8.10.2 Determining if NVs Are Used to Expose CPs

- View the XIF file with a text viewer.
- Search for lines starting with VAR.
- A first indication that it uses NVs is the name of the VAR that starts with nci (network configuration input).
- A second determination that NVs are used is the 2nd line below VAR (the self-documentation string line) that contains a ‘&’ character after the “ (e.g. “&1,0,0).
- Finally, at the end of the file there should be a NVVAL section that will give default values for all Configuration Properties exposed as Network Variables.

#### Accessing CPs Exposed as NVs

CPs exposed as NVs can be accessed either with:

- Implicit Addressing – where a network management tool such as LonMaker is simply used to bind to the network variable.
- Explicit Addressing – where it is accessed using the SNVT\_Index.

**Example: If the CP exposed as a NV is the 5th entry in the XIF file from the top, the SNVT\_Index will be 4.**

Looking at the complete VAR line of the CP to be accessed:

VAR nciDevMinVer 4 0 0 0 -- the number just after the name is always the SNVT\_Index, in this case 4.

#### 8.10.3 Determining if Embedded Files Are Used to Expose CPs

- View the XIF file with a text viewer.
- Search for lines starting with VAR.
- A first indication that embedded files are used is names such as nvoFileDirectory, and a second determination is the SNVT\_Type number in the 3rd or 4th lines below the VAR line. This line will always have a number followed by a star and an additional number (e.g. 73 \* 1).
- The first number is the SNVT\_Type and these numbers indicate that embedded files are used:  
73 \* ( SNVT\_file\_req )  
74 \* ( SNVT\_file\_status )  
114 \* ( SNVT\_address )
- Finally, at the end of the file there will be FILE sections to confirm embedded files are used.

### **Accessing CPs Exposed as Files<sup>3</sup>**

Currently, the FieldServer driver can only access CPs exposed as files where the SNVT\_address of the files are exposed, such as done by all the LonPoint modules. Therefore, the existence of the 114 \* line in the XIF indicates that the device exposes the address of the files which the FieldServer driver will use to access the files.

#### **STEP 1:**

Add a map descriptor to the config file that will read the address of the embedded files.

Example from the DI-10V3.XIF file:

VAR Node\_Directory 4 0 0 0

0 1 63 1 0 1 0 1 0 0 0 0 0

"@0|8;Address offset of the node file directory. For tool-use" only 114 \* 1

Map_Descriptors			
Map Descriptor Name	Data Array Name	Data Array Offset	Lon Function
nviFDAddress	, File_Address	, 0	, NMFETCHC
, Function	, Node_Name	, SNVT_Index	, SNVT_Type
, RDBC	, Lon_Remote	, 004	, SNVT_address

Note this value  
from the VAR line.

Note this value from  
the SNVT Type line.

In the following excerpt taken from the Echelon SNVTs document, 114 refers to SNVT\_Address which is the Type of SNVT:

---

### **SNVT\_address (114)**

#### *Neuron Chip Address*

SNVT Index	Measurement	Type Category	Type Size
114	Neuron Chip Address	Unsigned Long	2 bytes
Valid Type Range	Type Resolution	Units	Invalid Value
16,384 .. 64,767	1	16-bit address value	64,768 (0xFD00)
Raw Range	Scale Factors	File Name	Default Value
16,384 .. 64,767 (0 .. 0xFCFF)	1, 0, 0 $S = a \cdot 10^b \cdot (R + c)$	N/A	N/A

<sup>3</sup> **Warning:** This method uses direct memory write LonWorks messages that could corrupt a remote device's configuration property files if the incorrect memory address is determined by the outlined steps. Do not allow write-throughs to happen until the configuration property's value is correctly read and displayed in the FieldServer Data Array. Verify correct configuration property and values by adding the device to a network management tool and changing the values with the tool making sure the corresponding FieldServer Data Array values match before using the device in explicit messaging mode.

## Additional Information

### STEP 2:

Add a map descriptor that will read the first 16 bytes at the address provided by the 1<sup>st</sup> map descriptor. These 16 bytes are the file directory table of the device and indicate the types and addresses of the files that need to be accessed to read or write the Configuration Properties:

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , DA_Address , Lon_Function
Poller 1 , CP_Info , 0 , File_Address , NM_MEMORY
The first 16 bytes of the file directory table will be stored in this data array.
NOTE: This is the data array from the 1 <sup>st</sup> mapdesc that will give this mapdesc the address of the file directory table.
, Function , Node_Name , SNVT_Type , UNVT_ID , UNVT_Byte_Length
, RDBC , Lon_Remote , Not SNVT , - , 16

### STEP 3:

Create a moves function to extract the address of the file where the Configuration Properties are located.

This table is for Version 1.1 File Table Format - the 1st byte of CP\_Info shows the version:  
0x11 = Version 1.1

Version 1.1 uses 1 byte for the file-type entries.

Moves
Source_Data_Array , Source_Offset , Target_Data_Array , Target_Offset , Length , Function
CP_Info , 10 , CPs_Address , 0 , 1 , Join_Int16
NOTE: The CP_Info data array is populated by the 2 <sup>nd</sup> mapdesc from the previous step and contains the first 16 bytes of the file directory table on the device.
This function will take the 2 bytes at offset 10 from the CP_Info data array and combine them into a word address and store that value in the CPs_Address data array at offset 0.

In practice, here is how the CP\_Info data array will look like for a version 1.1 file directory table:

Data_Array
Data_Array_Name , Data_Array_Length , Data format , Bytes Per Item
CP_Info , 16 , Byte , 1

Bytes: 11 03 09 5a 02 cd 31 04 fa 01 d7 16 00 31 01 d6  
Offset: 0 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15

## Additional Information

These bytes can be interpreted as follows for version 1.1 and version 2.0:

Offset (v1.1)	Offset (v2.0)	Description	Example
0	0	File directory table format version.	11 -> version 1.1 20 -> version 2.0
1	1	Number of files on the device.	03 -> 3 files
2-3	2-3	Filesize of 1st file in bytes.	095a -> 2,394 bytes
4	4-5	* File type of 1st file. 2 = template file (XIF)	02 -> 2 (v1.1) 00 02 -> 2 (v2.0)
5-6	6-7	Address of 1st file.	cd31
7-8	8-9	Filesize of 2nd file on the device.	04fa -> 1,274 bytes
9	10-11	* File type of 2nd file. 1 = configuration properties	01 -> 1 (v1.1) 00 01 -> (v2.0)
10-11	12-13	Address of 2nd file.	d716

\* The first file will always be the template (XIF) file and the 2<sup>nd</sup> file will always be the configuration properties file according to the LonMark Interoperability Guidelines document, section 4-6 and 4-13.

The version of the file director format can be determined beforehand from the device's XIF file by searching for the 1<sup>st</sup> FILE section, example:

FILE template 0 2

"1.1;"

Here it shows version 1.1, so Source\_Offset 10 can be used.

For version 2.0 it would show "2.0," and Source\_Offset 12 would be used.

### STEP 4:

Create map descriptors for the configuration properties of the device.

At this stage in the example, the CPs\_Address data array will now contain an address value of d716 which is the start address of the first configuration property on the device.

View the device's XIF file again and search for the FILE template section which will be the first FILE section encountered.

FILE template 02:

```
"1.1;"  
"1,0,3\x84,62,1;" // UCPTdeviceMajorVersion (unsigned int)  
"1,0,3\xA4,63,1;" // UCPTdeviceMinorVersion (unsigned int)  
"1,0,3\x84,64,1;" // UCPTobjectMajorVersion (unsigned int)  
"1,0,3\xA4,65,1;" // UCPTobjectMinorVersion (unsigned int)  
"1,0,0\x82,17,31;" // SCPT_location (SNVT_str_asc) Label, Location  
"1,0,0\x82,22,7;" // SCPT_max_snd_t (SNVT_elapsed_tm) Send Time, Max  
"1,0,3\x82,2,7;" // UCPTgoUncnfgT (SNVT_elapsed_tm)  
"1,0,3\x82,3,7;" // UCPTgoUncnfgPrwupT (SNVT_elapsed_tm)  
"1,1,3\x85,38,3;" // UCPTObjectType (struct ObjectType)  
"1,1,3\x84,64,1;" // UCPTobjectMajorVersion (unsigned int)  
"1,1,3\xA4,65,1;" // UCPTobjectMinorVersion (unsigned int)  
"1,1,0\x81,17,31;" // SCPT_location (SNVT_str_asc) Label, Location  
"1,1,3\x81,4,7;" // UCPTdebounceT (SNVT_elapsed_tm)  
"1,1,3\x81,16,1;" // UCPTdioType (struct DioType)  
"1,1,3\x81,5,1;" // UCPTinvertInput (boolean)  
"1,1,3\x81,17,7;" // UCPTonDelay (SNVT_elapsed_tm)  
"1,1,3\x81,18,7;" // UCPToffDelay (SNVT_elapsed_tm)
```

Each line starting from the 3<sup>rd</sup> line eg. "1,0,3\x84 ... " defines a configuration property on the device. All lines that contain an x84 or x85 or xA4 are constant configuration properties which cannot be accessed and are not part of the addressing offsets into the file, so these lines should be ignored.

The following description is a quick way to determine the address offset and type of each configuration property for the most common declaration, but there may be variations so the LonMark Interoperability Guidelines document section 4-6 can be studied further for more complex definitions of configuration properties.

The format of each entry is basically:

"<header>,<select>,<flag\attributes>,<config\_index>,<length>;"  
eg. " 1 , 0 , 0\x82 , 17 , 31 ;"

The comments after each entry can be used to ascertain the type of CP.

For the example above the flag is 0 which always points to a SCPT type CP. Any non-zero flag value points to a UCPT type CP.

So, from this example, flag is 0, and config\_index is 17, so it is SCPT 17 that should be used to determine the type of the CP.

From the Echelon SCPT list:

### SCPTlocation (17)

#### *Location Label*

This configuration property sets descriptive physical location information for the associated functional block or device. It provides a more detailed description of the device that can be provided by the Neuron Chip's 6-byte location string.

A SCPTlocation configuration property that applies to the Node Object functional block is used to identify the subsystem containing the device. This allows network recovery tools to recover subsystem information from a device. The subsystem may be a simple location name, or may be a hierarchical subsystem name. If a hierarchical subsystem name is specified, the subsystem hierarchy components must be separated by periods ("."). For example, a device may have a Node Object SCPTlocation value of "Bldg 1.Floor 2.Rm 29", representing the Bldg 1/Floor 2/Rm 29 subsystem. Periods must not otherwise be used in a SCPTlocation value that applies to a Node Object functional block. Other characters that cannot be used in a subsystem name are the backslash ("\"), colon (":"), forward slash ("/"), or double-quote characters. For very large networks, subsystem numbers may be used instead of subsystem names, for example: "1.2.29". This allows deeply nested hierarchies to fit within the 31 character limit for SCPTlocation.

SCPT Index	Measurement	Type Category	Type Size
17	SNVT_str_asc	Structure	31 bytes

#### *Structure Definition*

```
typedef struct {
    unsigned char      ascii[31];
} SNVT_str_asc;
```

The ascii field contains a null-terminated string of up to 30 characters. The default value is null string (all zeroes).

The Measurement shows SNVT\_str\_asc should be used as the data-type to store the value from this configuration property. The comment in the XIF file confirms this:

```
// SCPT_location (SNVT_str_asc) Label, Location
```

Finally, the length is 31 bytes.

At this stage the following is determined:

The first accessible Configuration Property on this device is at address d716 (hex) offset 0 and it is 31 bytes long.

## Additional Information

To create a mapdesc to read and write to this CP, it is defined:

Map_Descriptors					
Map_Descriptor_Name	Data_Array_Name	Data_Array_Offset	DA_Address	Address_Offset	Lon_Function
CP_CMD001	DA001	0	CPs_Address	000	NM_MEMORY
,	Function	Scan_Interval	Node_Name	SNVT_Type	UNVT_ID
,	RDBC	0s	Lon_Remote	SNVT_str_asc	-
,					-

A UCPT example:


"1,1,3\x81,5,1;" // UCPTinvertInput (boolean)

the format is:

"<header>,<select>,<flag\attributes>,<config\_index>,<length>;"

flag is non-zero so this is UCPT that is defined in resource file scope 3 index 5 and it is 1 byte long.

The resource editor shows the Echelon scope 3 file at index 5:

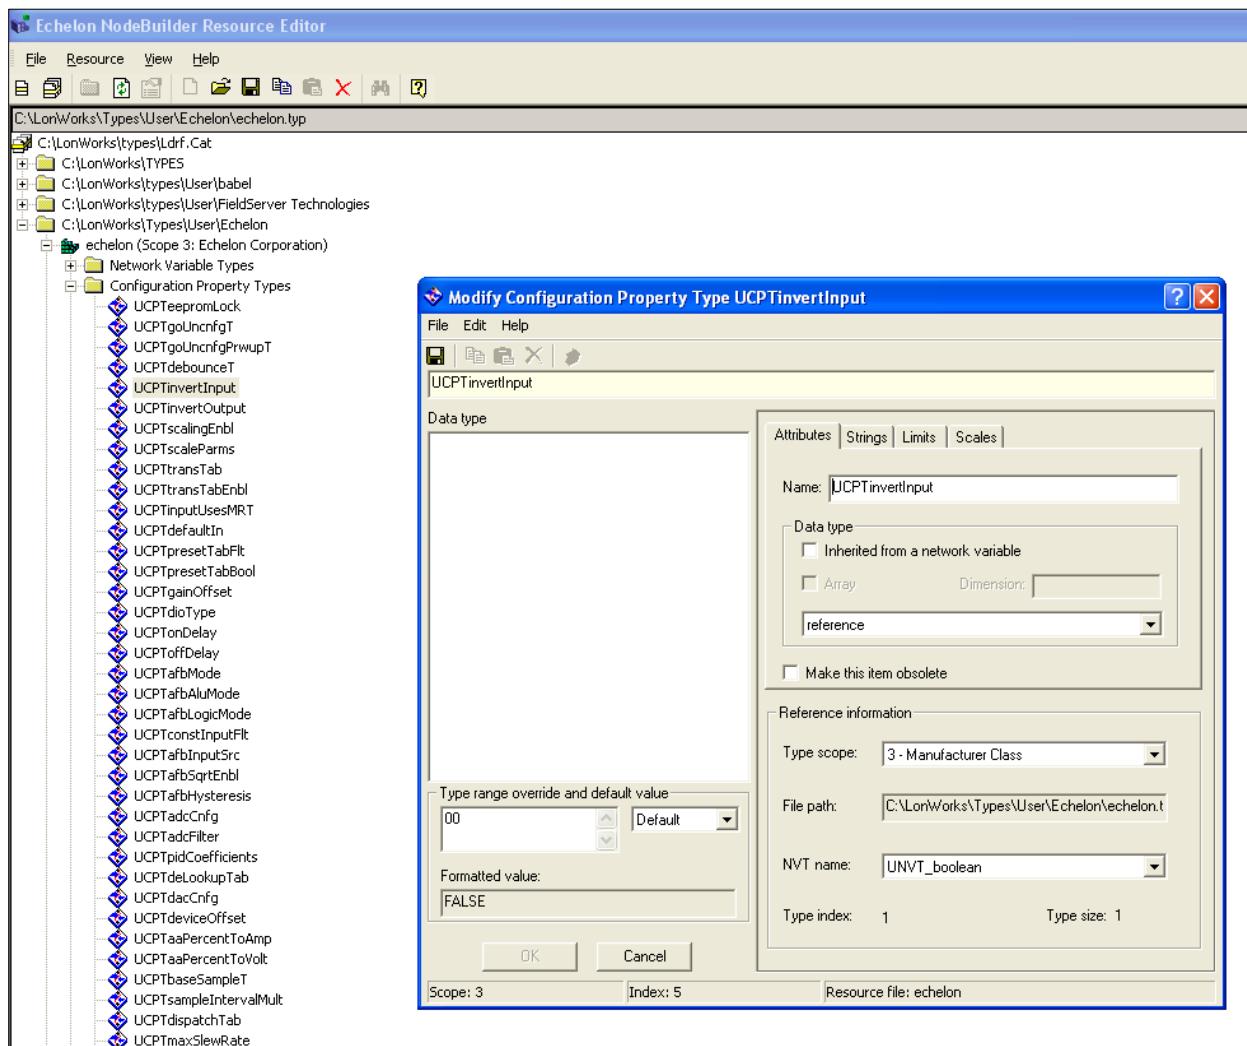

## Additional Information

In this example, it isn't necessary to check the resource files. This is a simple example; the comment was enough to indicate the use of an UNVT type of length 1, other UCPTs may be structures with elements that need to be interpreted by the front-end to decide which offsets to read or write to inside the data bytes.

To create a mapdesc to read and write to this CP, it is defined:

```
Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , DA_Address , Address_Offset , Lon_Function
CP_CMD008          , DA008        , 0           , CPs_Address , 091           , NM_MEMORY

, Function , Scan_Interval , Node_Name , SNVT_Type , UNVT_ID , UNVT_Byte_Length
, RDBC     , 0s            , Lon_Remote , Not SNVT , -         , 01
```

**NOTE: The SNVT\_Type is set to Not SNVT to indicate this is an UNVT and the UNVT\_Id is set to 1 which is the first UNVT. The next UNVT will be 02. And finally, the type size of 1 as per the example is set as the UNVT\_Byte\_Length.**

### 9 Vendor Information

#### 9.1 Echelon LonMaker

**9.1.1 Using LonMaker to Commission the FieldServer** Ensure that the correct firmware and latest configuration is loaded on the FieldServer (Each change in the FieldServer requires re-commissioning of the FieldServer in LonMaker).

- Ensure that the FieldServer and the LonMaker machine are on the same network.
- Open the existing Network in LonMaker, or create a new Network.
- Click on “Create New Network” and follow the network wizard, making the following selections:
  - Network Interface: Choose Network Attached
  - Management Mode: Choose Onnet unless working offline
  - Register Plug-ins required: None
- Once Visio is open with the Network showing, drag a new device onto the drawing from the toolbox.
- Follow the Device Network, making the following selections:
  - Enter Device Name: Choose commission device
  - Specify Device Template: Choose upload from device
  - Specify Device Channel: Choose Auto Detect
  - Specify Device Properties: Leave as is (Ping is optional)
  - Identify Device: Choose service pin
  - Device Application Image: Leave unchecked
  - Initial State: Leave as is
- Press the service pin on the FieldServer when asked to do so, and the FieldServer will be commissioned.
- Drag a new function block onto the drawing from the toolbox. Give the function block a name and ensure that it is allocated to the FieldServer device.
- Once the function block is on the drawing, drag input and output variables onto the function block. LonMaker will display the variables available for binding. Click on the required variables (or use the select all option), and they will be commissioned onto the function block.
- Connect these variables to other devices by dragging connections from the toolbox and connecting the variables.

#### 9.1.2 Removing Previous FieldServer Device Templates in LonMaker

If using a previously used LonMaker to commission a FieldServer or ProtoCessor onto a LonWorks network, LonMaker saves the properties of that device as a device template. It is important to remove all previous device templates from LonMaker when moving onto the next FieldServer product as some parameters might transfer to the new device.

To remove the device templates, open the LonMaker workspace as normal. Then choose the LonMaker toolbar and choose the Device Templates option. This will bring up a list of all device templates. Highlight and then remove all device templates that do not contain “Echelon” or “LNS”. This will ensure a fresh commission of the FieldServer product.

### 9.2 Checking LonWorks® Network Using Echelon's NodeUtility.exe


- Run Nodeutil.exe.
- Press Service Pin on all LonWorks® Devices.
- Press ‘F’ to find Nodes.
- Press ‘L’ to List Nodes, Confirm that all Nodes can be seen.
- Press ‘G’ (Goto) each Node and:
  - Confirm Domain ID is correct (usually , “F”).
  - Record Node.
  - Confirm that Subnet is “1”.
  - Confirm that Size is “1”.
- Press ‘L’ (List) Network Variables.
- Record SNVT Type and Index.

### 9.3 Neuron Systems

Newron Systems may produce the following Error message “bindings lost after power-cycle”. This can be fixed by placing the FieldServer in the Configured state which will cause the bindings to be committed to the Neuron and they will remain after a power cycle.

#### Procedure:

- 1) Make the bindings in NL220.
- 2) Place devices in ONLINE mode or state.
- 3) Refer to the following Screencap for assistance in placing the FieldServer in the Configured state.

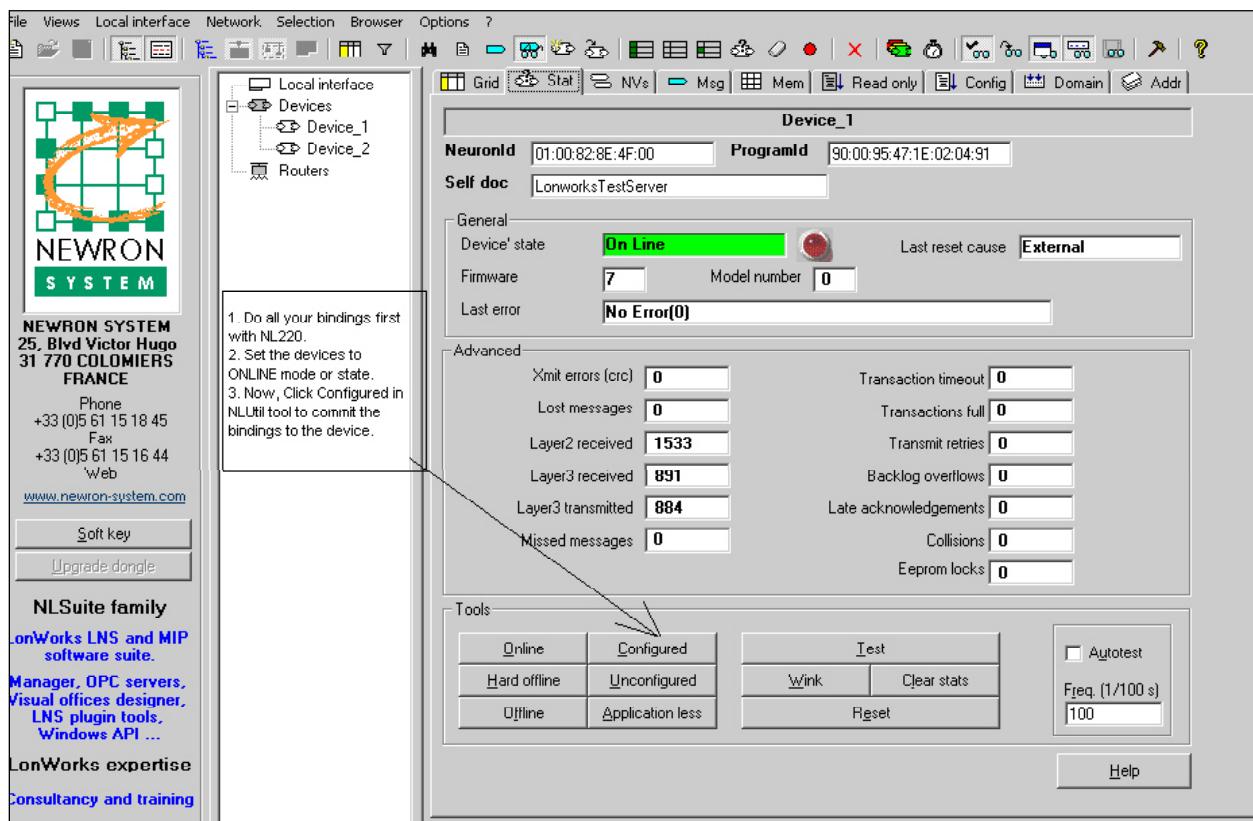

### 9.4 Honeywell Care


This system uses unacknowledged service as default.

## Additional Information


### 9.5 CARE and LON PT link Integration

The procedure that follows describes a successful integration from a LonPtLink using Honeywell Care ver 7.0:

- Set the PT Link configuration file as follows for LonWorks: Implicit, Update, Update.
- Open the device library in Care and create a new Lon device as shown in the example below.

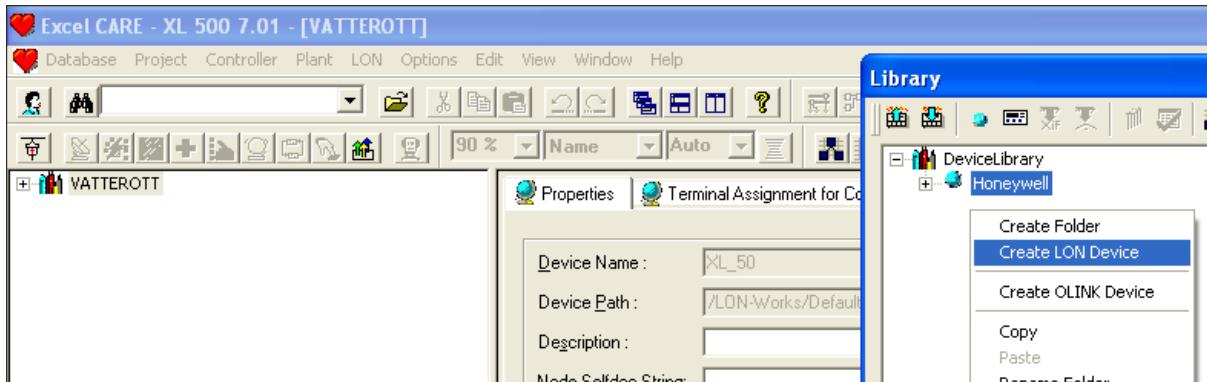


- Connect to the Lon side of the PT Link using the Lon network interface cable and set Care to Onnet.
- Right click on the new Lon device created in the device library and select Import Lon Object>From Online. This will upload the PT Link configuration into the new device.

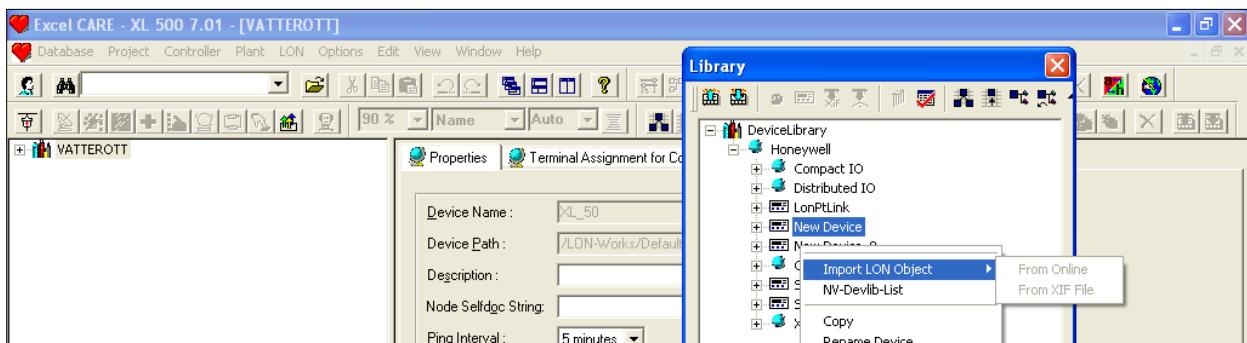

**NOTE: All Controllers that will be connected to the PT Link must be powered up and communicating to the PT Link before uploading the new device.**

- Rename the new device e.g. LonPtLink, and drag it into the default channel.

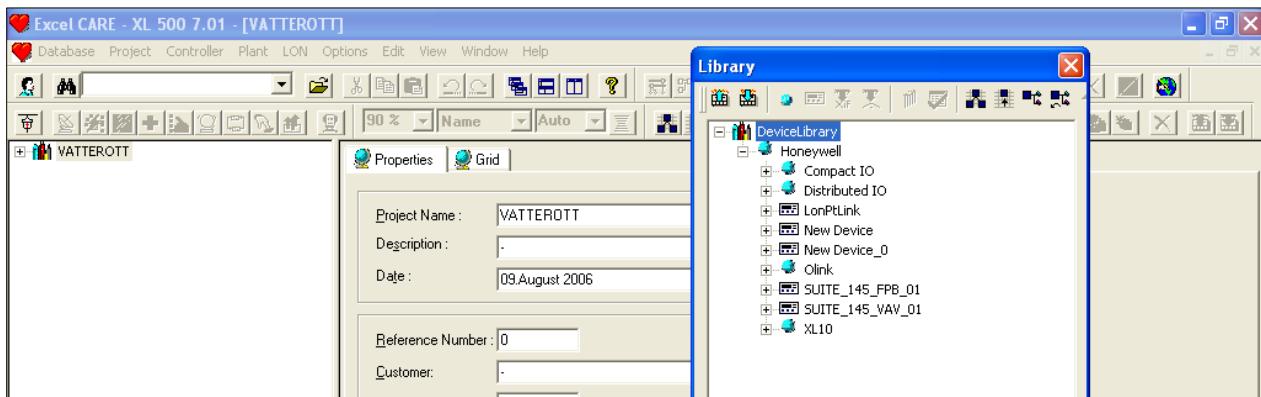


## Additional Information

- Create the pseudo points to be bound to the PT Link. Leave them as non Lon Points for now and setup any engineering units.
- Open the Controller that is being binded from in the network tree and go to the Terminal Assignments tab.
- Drag the newly created LonPtLink device into the Terminal Assignment window.
- Now drag the pseudo points from the XL5000 controller and drop them onto the appropriate NV'S.


The example below shows the pseudo digital 2 stat RTU\_01\_ENABLE in the XL50 bound to the NVI schedule force (shcdfrc) on the PT Link. Using the autobind in Care will automatically configure the required snvt and lon nv.

**NOTE: The schdfrc nv is the occupancy point. The pseudo point has to be set to a logical 1 for occupied and a logical 0 for unoccupied.**

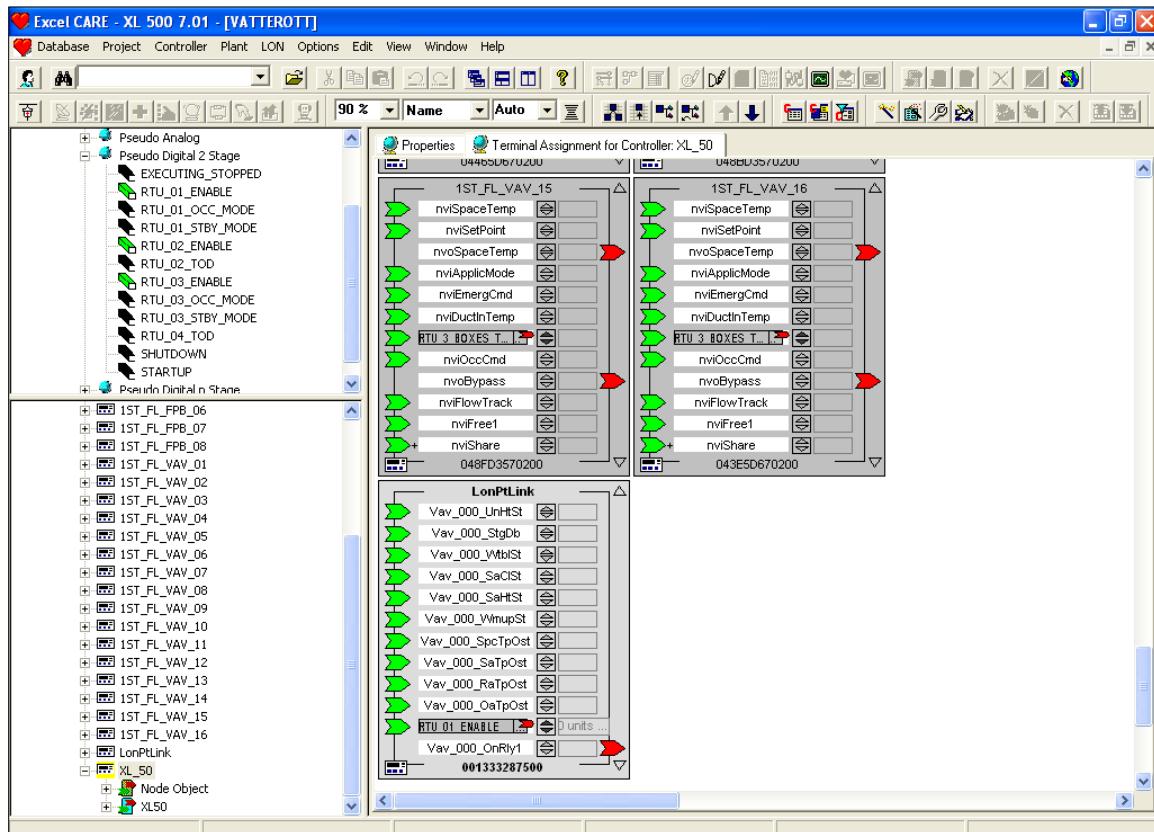

## Additional Information

- Open up the nv points bound from the controller under the controller in the network tree and set the nvo points to Ackd bindings in the service type as shown below.
  - Care automatically defaults to unacknowledged bindings

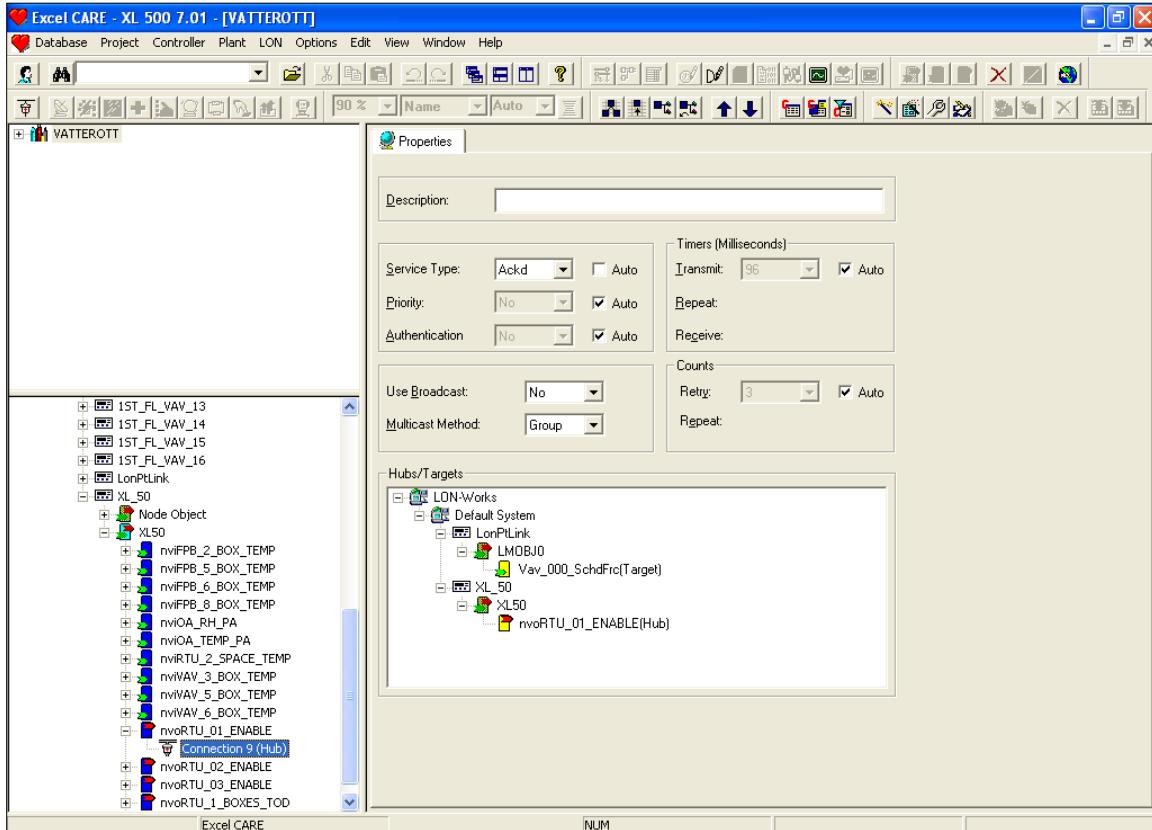

- Now go onnet in Care and commission the controllers.

**NOTE:** If installing on a SymmetrE front end, create an XIF file for LNS to use to commission the device on synchronization. Use FS GUI or NodeUtil182 (available for free download at [www.echelon.com](http://www.echelon.com)). Ensure that the XIF is not created until everything has been configured and commissioned properly.

### 9.6 Circon\_SI

**NOTE:** Circon\_SI does not recognize whitespace; %; -.

**NOTE:** The maximum number of Network Variables under Circon\_SI is limited to 255 per node.

- Set the Connection\_Type parameter in the configuration file per the following example. This will ensure that all illegal characters are replaced with underscores, and that the number of Network Variables per Node is limited to 255 in the configuration.

#### Example

```
// Client Side Connections
Connections
Adapter      , Protocol     , Connection_Type
LonWorks     , LonWorks     , Circon_SI
```

### 9.7 Tridium JACE

This system uses unacknowledged service as default.

**NOTE: Tridium calls Acknowledged service “critical bindings”.**

#### 9.7.1 Correcting SNVT Indexing Problem in Tridium Niagara

The procedure below was done in Niagara AX-Workbench Rev 3.4.X. It may not work in prior revs or with R2 because the menus are different.

If after a dynamic device is created and the nv (Network Variable) index of a monitored device does not match the XIF file of the device being monitored, the XIF can be imported by first converting the XIF to an LNML file. There is a menu item under tools in AX Workbench to do this.

- Obtain a copy of the correct XIF file.
- Choose the option for LON XML conversion under Tools.
- In the LON XML converter, browse to the XIF file.
- Choose a working directory for the new LNML file and convert the file.
- In LON Device manager, double click the device with the problem nv index.
- In the LNML file select box, browse to the newly created LNML file.
- Commission the device.
- Right click on the device, select Actions and then Upload.
- Compare the nv index with the XIF file index. If the numbers match, data should be correctly displayed after deleting and re-generating the proxy points.

### 9.8 Trane Rover

Use Trane Rover Service Pack 4 or later when commissioning the FieldServer. This does not ship from Trane by default and may have to be requested from the local Trane representative.

When using Pre-Service Pack 4 software, the FieldServer will appear in Rover, but none of the FieldServer variables will be available for binding even though they are present. Service Pack 4 has been tested to ensure that the variables show and the bindings work well.

### 9.9 Trane Tracer SC

The Trane Tracer SC is unable to deal with devices on remote subnets cleanly and all precautions needs to be taken to ensure that the FieldServer presents itself to the SC in an unconfigured manner so that the SC can allocate a Domain, SubNet and Node to the FieldServer on the same subnet.

The FieldServer LonWorks Configuration must be set up for implicit addressing by not specifying the Domain, Subnet and Node\_ID in the Title section of the Configuration file, to ensure that the Trane Tracer SC tool will successfully find the FieldServer on the LonWorks Network. To this end ensure the following:

- The FieldServer needs to be configured as LonWorks Implicit on the Server Side of the configuration file.
- The DSN information needs to be completely removed from the Title section of the configuration file.

## 10 Troubleshooting

### 10.1 Debugging a LonWorks connection: Hints and tips

- To test connections, set the configuration tool into a mode that will display service requests, and then push the button on the FieldServer. A request should appear.
- In order for variables to appear as outputs, they need to be declared as write variables in the FieldServer. Declaring the Map Descriptor functions as WRBC, or WRBX can do this. See [Section 6.1.2](#) for more information.
- If the domain and Subnet ID are defined in the configuration file of the FieldServer, these values will be used when power is cycled to the FieldServer. If the values set here are different to what the Network Manager has set up for the FieldServer for clients using implicit addressing, the FieldServer will stop communicating. In this case, change these settings or remove them from the configuration file completely and recommission the FieldServer.

### 10.2 Error Messages

Message	Description
"LON:#03 FYI. Standard driver build. This is normal.	This message is informational and can be safely ignored.

#### 10.2.1 Error Message Lonlive.c 121

If the following error message is returned:

DRIVER-> LON : Error, timeout while waiting for Lon I/F to reset!----- Configuration Error -----

It is possible that the FieldServer hardware in use may not support LonWorks, or the firmware loaded contains LonWorks but is the wrong firmware for the application. Remove LonWorks from the configuration or get new firmware/hardware.

### 10.3 Communication Errors using Neuron\_ID Polling

In order to allow communication across routers when using Neuron\_ID based polling, routers need to be set up to forward NID addressed messages to/from the connected channels.

### 10.4 Monitoring Node Status

When monitoring Node Status with a configuration using implicit addressing, it is important that at least one of the Map Descriptors has active functions (Wrbc, Rdbc). This will cause traffic and when the traffic stops, this will indicate that the Node is offline.

### 10.5 Exposing Operation Statistics

If this driver is appropriately configured, it can expose operation statistics in a Data Array which can be monitored by a remote device to check that the driver is performing without error.

The lines from the example below can be cut and pasted into a configuration file to expose these stats.

```
Data_Arrays,  
  
Data_Array_Name    , Data_Format    , Data_Array_Length  
Lonworks-stats     , UINT32        , 1000
```

Data Array Offset	Description
1	Increments when Neuron ID is read. Used for scripting.
2	Overwritten when Neuron ID is read. Contains 1st byte of Neuron ID.
3	Overwritten when Neuron ID is read. Contains 2nd byte of Neuron ID.
4	Overwritten when Neuron ID is read. Contains 3rd byte of Neuron ID.
5	Overwritten when Neuron ID is read. Contains 4th byte of Neuron ID.
6	Overwritten when Neuron ID is read. Contains 5th byte of Neuron ID.
7	Overwritten when Neuron ID is read. Contains 6th byte of Neuron ID.
8	Not Used.
9	Not Used.
10	Overwritten when Neuron ID is read. Contains 1st nibble of 1st byte of Neuron ID as an ASCII char. e.g. if 1st byte=0x12 then the value stored here is 0x32 - the ASCII char for the digit 2.
11	Overwritten when Neuron ID is read. Contains 2nd nibble of 1st byte of Neuron ID as an ASCII char. e.g. if 1st byte=0x12 then the value stored here is 0x31 - the ASCII char for the digit 1.
12	Overwritten when Neuron ID is read. Contains 1st nibble of 2nd byte of Neuron ID as an ASCII char.
13	Overwritten when Neuron ID is read. Contains 2nd nibble of 2nd byte of Neuron ID as an ASCII char.
14	Overwritten when Neuron ID is read. Contains 1st nibble of 3rd byte of Neuron ID as an ASCII char.
15	Overwritten when Neuron ID is read. Contains 2nd nibble of 3rd byte of Neuron ID as ASCII char.
16	Overwritten when Neuron ID is read. Contains 1st nibble of 4th byte of Neuron ID as an ASCII char.
17	Overwritten when Neuron ID is read. Contains 2nd nibble of 4th byte of Neuron ID as an ASCII char.
18	Overwritten when Neuron ID is read. Contains 1st nibble of 5th byte of Neuron ID as an ASCII char.
19	Overwritten when Neuron ID is read. Contains 2nd nibble of 5th byte of Neuron ID as an ASCII char.
20	Overwritten when Neuron ID is read. Contains 1st nibble of 6th byte of Neuron ID as an ASCII char.
21	Overwritten when Neuron ID is read. Contains 2nd nibble of 6th byte of Neuron ID as an ASCII char.
30	Domain Table Subnet ID
31	Domain Table Node ID
32	Domain Table Domain ID - length in bytes
33	Domain Table Domain ID - Byte 1
34	Domain Table Domain ID - Byte 2
35	Domain Table Domain ID - Byte 3
36	Domain Table Domain ID - Byte 4
37	Domain Table Domain ID - Byte 5
38	Domain Table Domain ID - Byte 6

### 10.6 “Illegal” Characters in Network Variable Names

**Spaces:** Spaces may not be used in Network Variable Names. The driver automatically replaces all spaces with underscores at startup.

**Brackets:** LonMaker truncates a name from where a bracket is used e.g. a name like nviTest[1]Input shows as nviTest. Brackets are therefore not able to be used in Network Variable Names.

### 10.7 Service types currently supported for network variable messages

The default service type for network variable update messages is fixed to acknowledged service. This can be changed to unacknowledged service ([Section 7.2](#)). Request-response service is used for network variable poll and network management fetch messages.

### 10.8 Combining Explicit and Implicit

To ensure undisturbed communication between the network management tool and the FieldServer during the commissioning, binding or monitoring processes, the timeouts of the explicitly addressed variables (Map Descriptors) might need to be set to values lower than the message timeouts used by the network management tool (LonMaker for Windows).

#### LonWorks FieldServer Performance

No.	Description	Min	Typ	Max	Units
1	FieldServer startup time with 4096 network variables	-	6.5	-	Minutes
2	Time to commission FieldServer with 4096 network variables	-	-	40	Minutes
3	Time to complete a network variable update between two FieldServers (acknowledged service)	-	40	-	Milli-seconds
4	Time to complete a network poll message between two FieldServers (request/response service)	-	125	-	Milli-seconds
5	Time to complete a network management variable fetch message between two FieldServers (request/response service)	-	125	-	Milli-seconds

## 11 Reference

### 11.1 LonMark Profiles

The following FieldServer Platforms are LonMark XIF version 3.4 certified:



FS-QuickServer-Lon

ProtoCessor-Lon

The following Profiles are certified on [LonMark.org](http://LonMark.org).

<b>GATEWAYS</b>	
<b>Standard Gateways</b>	
<a href="#">ProtoCarrier/ProtoCessor FPC-CD2 Daughter Card Gateway for OEMs</a>	
<a href="#">ProtoCessor FPC-F04 Embedded Gateway Module for OEMs</a>	
<a href="#">ProtoNode LER External Protocol Gateway for OEMs</a>	
<a href="#">QuickServer FS-QS-1011 Gateway for LonWorks®</a>	
<b>HVAC Gateways</b>	
<a href="#">Liebert SiteLink-12 LonWorks® Adapter</a>	
<b>HVAC</b>	
<b>Boiler Controller</b>	
<a href="#">Cleaver Brooks Adapter for LonWorks®</a>	
<b>Discharge Air Controller</b>	
<a href="#">FieldServer Data Aire DAP Adapter for LonWorks®</a>	
<b>INDUSTRIAL</b>	
<b>Generator Set</b>	
<a href="#">FieldServer Caterpillar EMCP II Adapter</a>	
<a href="#">FieldServer Kohler 550 Adapter</a>	

### 11.2 Performance Tests for LonMark Certified blocks

#### 11.2.1 Startup Times, 10 Input Blocks and 10 Output Blocks Totalling 80 NVs

Device	Startup Time without a config	1st Startup Time with config	Restart Startup Time with config	Commission Time (load XIF first)	Commission Time (upload from dev.)
FFPLon/QuickServer	48 seconds	193 seconds	135 seconds		

#### 11.2.2 Startup Times, 20 Input Blocks and 20 Output Blocks Totalling 160 NVs

Device	Startup Time without a config	1st Startup Time with config	Restart Startup Time with config	Commission Time (load XIF first)	Commission Time (upload from dev.)
FFPLon/QuickServer	48 seconds	460 seconds	306 seconds	260 seconds	802 seconds

### 11.3 SNVT\_Type

The following section describes each SNVT as implemented on the FieldServer LonWorks driver.

**Data Length** – The number of Data Array elements required when specifying a Data Array name under a Map Descriptor.

**Suggested Data Array Formats** – This field suggests FieldServer Data Array formats in ascending order of storage space required while ensuring data integrity. It is not recommended to store a byte value in a bit Data Array since only the values 0 and 1 will be retained from the byte value resulting in a loss of resolution. If a byte value is stored in a Floating point Data Array, 3 bytes will go to waste. A SNVT with more than one data item may require a float Data Array format to prevent loss of resolution. Since FieldServer Map Descriptors can only work with one type of Data Array format for all the data items in a SNVT, it is sometimes necessary to use a Float Data Array element for all data items of which some may only have required a Byte. Fortunately, all SNVT's are short in length and RAM is adequately provided for on the FieldServer. If a loss in resolution can be tolerated, any Data Array format may be used.

The range of FieldServer Data Arrays formats are:

Data Array Format	Description	Values Range
BIT	1-bit	0, 1
BYTE	8-bit Byte	0.. 255
SINT16	16-bit Signed Integer	-32, 768... 32, 767
UINT16	16-bit Unsigned Integer	0.. 65, 535
SINT32	32-bit Signed Integer	-2, 147, 483, 647... 2, 147, 483, 647
UINT32	32-bit Unsigned Integer	0.. 4, 294, 967, 295
FLOAT	32-bit Float	-3.40282E38... 3.40282E38

**Values Range** – These are the only values that will be allowed for the SNVT, e.g. a value of 101 will not be processed in a read or write on SNVT\_Switch's Value data item.

**Invalid Value** – The Invalid value is used to force the data item's value should a value outside the value range be encountered in a read or write. Should the invalid value be N/A (Not Applicable), the data item's value will be bounded by the indicated values range, e.g. an incoming read value of 101 will be stored as 100 for SNVT\_Switch's Value data item. Note that in some cases both the type and raw values are specified. Raw values are not of the same type of the SNVT's measurement type, i.e. they are not scaled.

**Data Item** – SNVT's containing more than one data item have a name specified for each item. This name can be used in the SNVT\_Option field of a Map Descriptor to isolate only this one item.

SNVT_abs_humid	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Absolute humidity	gram/kilogram	0.. 655.34	Raw: 65,535 (0xFFFF) Type: 655.35
SNVT_address	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Neuron Chip Address	16-bit address value	16,384 .. 64,767	N/A

## Additional Information

SNVT_alarm	<b>Data Length</b>	25	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1-6</b>	Alm_Location00,..Alm_Location05	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Location array element	8-bit unsigned byte	0 .. 255
	<b>Data Item 7</b>	Object_ID	
	Object ID	object index	0 .. 65,535
	<b>Data Item 8</b>	Alarm_type	
	alarm_type_t	N/A	255 (0xFF) (AL_NUL)
	<b>Data Item 9</b>	Priority_level	
	Priority_level_t	N/A	255 (0xFF) (PR_NUL)
	<b>Data Item 10</b>	Index_to_SNVT	
	Index to NV	index of NV causing alarm	0 .. 65,535
	<b>Data Item 11-14</b>	Alm_Value00,..Alm_Value03	
	Value array element	specific to NVT	0 .. 255
	<b>Data Item 15</b>	Year	
	Year	year	0 .. 3000
	<b>Data Item 16</b>	Month	
	Month	month of year	0 .. 12
	<b>Data Item 17</b>	Day	
	Day	day of month	0 .. 31
	<b>Data Item 18</b>	Hour	
	Hour	Hour of day	0 .. 23
	<b>Data Item 19</b>	Minute	
	Minute	Minutes	0 .. 59
	<b>Data Item 20</b>	Second	
	Second	Seconds	0 .. 59
	<b>Data Item 21</b>	Millisecond	
	Millisecond	Milliseconds	0 .. 999
	<b>Data Item 22-25</b>	Alm_limit00,..Alm_limit03	
	Alarm limit array element	specific to NVT	0 .. 255
SNVT_alarm_2	<b>Data Length</b>	27	
	<b>Suggested Data Array Formats</b>	Uint32	
	<b>Data Item 1</b>	Alarm_type	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	alarm_type_t	N/A	0 .. 32
	<b>Data Item 2</b>	Priority_level	
	Priority_level_t	N/A	255 (0xFF) (PR_NUL)
	<b>Data Item 3</b>	Alarm_time	
	time	seconds	0..4,294,967,294 4294967295(0xFFFFFFFF)
	<b>Data Item 4</b>	milliseconds	
	Millisecond	Milliseconds	0 .. 999 -1 (0xFFFF)
	<b>Data Item 5</b>	Sequence_number	
	Number	Milliseconds	0 .. 255 N/A
SNVT_amp	<b>Data Item 6-27</b>	description	
	ASCII char string	N/A	0 .. 255 N/A
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
Electric current	Amperes	-3,276.8..3,276.7	N/A

## Additional Information

SNVT_amp_ac	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Alt. electric current	Amperes	0 .. 65,534	65,535 (0xFFFF)
SNVT_amp_f	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Electric current	Amperes	-3.40282E38..3.40282E38	N/A
SNVT_amp_mil	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Electric current	Milli-amperes	-3,276.8..3,276.7	N/A
SNVT_angle	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Phase/Rotation	Radians	0 .. 65.535	N/A
SNVT_angle_deg	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Angular distance	degrees	-359.98 .. 360.00	Type: 655.34 Raw: 32,767 (0x7FFF)
SNVT_angle_f	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Phase/Rotation	Radians	-3.40282E38..3.40282E38	N/A
SNVT_angle_vel	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Angular velocity	Radians/second	-3,276.8..3,276.7	N/A
SNVT_angle_vel_f	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Angular Velocity	Radians/Second	-3.40282E38..3.40282E38	N/A
SNVT_area	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Area	Square meters (m <sup>2</sup> )	0 .. 13.1068	Type: 13.107 Raw: 0xFFFF (65,535)
SNVT_btu_f	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Thermal Energy	British Thermal Units	0 .. 3.40282E38	N/A

## Additional Information

SNVT_btu_kilo	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Thermal Energy	Kilo-British Thermal Units	0 .. 65,535	N/A
SNVT_btu_mega	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Thermal Energy	Mega-British Thermal Units	0 .. 65,535	N/A
SNVT_char_ascii	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Byte, Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Character	8-bit ASCII Char	0 .. 255	N/A
SNVT_chlr_status	<b>Data Length</b>			3
	<b>Suggested Data Array Formats</b>			Byte, Uint16, Float
	<b>Data Item 1</b>			chl_rn_mode
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Byte, Uint16, Float	8-bit ASCII Char	0 .. 255	N/A
	<b>Data Item 2</b>			chl_op_mode
	hvac_t	N/A	0 .. 17	255 (0xFF) (HVAC_NUL)
SNVT_color	<b>Data Item 3</b>			chl_state
				N/A
	<b>Data Length</b>			3
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			L_star
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Lightness	Lightness	0.0 .. 100.0	N/A
SNVT_config_src	<b>Data Item 2</b>			a_star
	Redness/Greenness	Redness/Greenness	-200.0 .. 200.0	N/A
	<b>Data Item 3</b>			b_star
	Yellowness/Blueness	Yellowness/Blueness	-200.0 .. 200.0	N/A
SNVT_count	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Config_source_t	N/A	0 .. 1	255 (0xFF) (CFG_NUL)
SNVT_count_f	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Event Count	Count	0 .. 65,535	N/A
SNVT_count_inc	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Sint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Event Count	Count	0 .. 3.40282E38	N/A

## Additional Information

SNVT_count_inc_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Incremental Count	Count	-3.40282E38.. 3.40282E38
			N/A
SNVT_ctrl_req	<b>Data Length</b>	3	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>	ctl_req_rcvr_id	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Receiver ID	ID number	1 .. 65,535
			0
SNVT_ctrl_resp	<b>Data Length</b>	5	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>	ctl_rsp_status	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	control_resp_t	N/A	0 .. 5
			255 (0xFF) (CTRLR_NUL)
SNVT_currency	<b>Data Length</b>	3	
	<b>Suggested Data Array Formats</b>	Sint32	
	<b>Data Item 1</b>	Currency	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Currency_t	N/A	0 .. 56
			255 (0xFF) (CU_NUL)
SNVT_date_day	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	days_of_week_t	N/A	0 .. 6
			255 (0xFF)
SNVT_defr_mode	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	defrost_t	N/A	0 .. 2
			255 (0xFF) (DFM_MODE_NUL)
SNVT_defr_state	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	defrost_state_t	N/A	0 .. 4
			255 (0xFF) (DFS_NUL)

## Additional Information

SNVT_defr_term	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	defrost_term_t	N/A	0 .. 100
SNVT_density	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Density	Kg/m <sup>3</sup> : kilograms per cubic meter	0 .. 32,767.5
SNVT_density_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Density	Kilograms per Cubic Meter (kg/m <sup>3</sup> )	0 .. 3.40282E38
SNVT_dev_c_mode	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	device_c_mode_t	N/A	0 .. 29
SNVT_earth_pos	<b>Data Length</b>	6	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	epos_dir_bits	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Latitude/Longitude	Direction	0 .. 255
	<b>Data Item 2</b>	epos_lat_degs	
	Latitude degrees	Degrees	1 .. 90
	<b>Data Item 3</b>	epos_lat_mins	
	Latitude Minutes	Minutes	1 .. 59.999
	<b>Data Item 4</b>	epos_long_degs	
	Longitude Degrees	Degrees	1 .. 180
	<b>Data Item 5</b>	epos_long_mins	
SNVT_elapsed_tm	Longitude Minutes	Minutes	1 .. 59.999
	<b>Data Item 6</b>	epos_htabv_sea	
	Height Above Sea Level	Meters (m)	-3.40282E38..3.40282E38
	<b>Data Length</b>	5	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
SNVT_elapsed_tm	<b>Data Item 1</b>	etm_day	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Days	Days	0 .. 65,534
	<b>Data Item 2</b>	etm_hour	
	Hours	Hours	0 .. 23
	<b>Data Item 3</b>	etm_minute	
	Minutes	Minutes	0 .. 59
	<b>Data Item 4</b>	etm_second	
	Seconds	Seconds	0 .. 59
	<b>Data Item 5</b>	etm_millisecond	
	Milliseconds	Milliseconds	0 .. 999

## Additional Information

SNVT_elec_kwh	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Electrical energy	Kilowatt-hours	0 .. 65,535
SNVT_elec_kwh_I	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Sint32	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Electricity	Kilowatt-hour	-214,748,364.7 214,748,364.8 .. 14,748,364.6
SNVT_elec_whr	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Electric energy	Watt-hours	0 .. 6,553.5
SNVT_elec_whr_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Electric Energy	Watt-hour	0 .. 3.40282E38
SNVT_enthalpy	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Enthalpy	KiloJoules per Kilogram kJ/kg	-327.68 .. 327.66 Raw: 32,767 (0x7FF) Type: 327.67
SNVT_evap_state	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	evap_t	N/A	0 .. 2 255 (0xFF) (EVAP_NUL)
SNVT_ex_control	<b>Data Length</b>	10	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>	ex_ctrl_status	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	ex_control_t	N/A	0 .. 2 255 (0xFF) (EX_CONTROL_NUL)
	<b>Data Item 2-7</b>	ex_ctrl_domid_0, ..ex_ctrl_domid_5	
	Domain ID	Byte	0 .. 255
	<b>Data Item 8</b>	ex_ctrl_domid_len	
	Domain length	Number of bytes	0 .. 6
	<b>Data Item 9</b>	ex_ctrl_subnet	
SNVT_file_pos	Subnet	Subnet number	1 .. 255
	<b>Data Item 10</b>	ex_ctrl_node	
	Node	Node number	1 .. 127
	<b>Data Length</b>	2	
	<b>Suggested Data Array Formats</b>	Uint32	
<b>Data Item 1</b>	ops_rw_ptr		
<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
Read/Write Pointer	File Byte Address	0..2,147,483,647	N/A
<b>Data Item 2</b>	ops_rw_len		
Read/Write Length	Number of Bytes	0 .. 65,535	N/A

## Additional Information

<b>SNVT_file_req (only raw data support)</b>	<b>Data Length</b>	12	
	<b>Suggested Data Array Formats</b>	Byte	
<b>SNVT_file_status (only raw data support)</b>	<b>Data Length</b>	27	
	<b>Suggested Data Array Formats</b>	Byte	
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
<b>SNVT_fire_indcte</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	fire_indicator_t	N/A	0 .. 8
			255 (0xFF) (FN_NUL)
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
<b>SNVT_fire_init</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	fire_initiator_t	N/A	0 .. 16
			255 (0xFF) (FI_NUL)
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
<b>SNVT_fire_test</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	fire_test_t	N/A	0 .. 3
			255 (0xFF) (FT_NUL)
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
<b>SNVT_flow</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Flow volume	Liters/Second	0 .. 65,534
			65,535 (0xFFFF)
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
<b>SNVT_flow_f</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Flow Volume	Liters/Second	-3.40282E38.. 3.40282E38
			N/A
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
<b>SNVT_flow_mil</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Flow volume	Milliliters/Second ml/s	0 .. 65,535
			N/A
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
<b>SNVT_flow_p</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Flow volume	Cubic meters per hr	0 .. 655.34
			Raw: 65,535 (0xFFFF) Type: 655.35
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
<b>SNVT_freq_f</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Frequency	Hertz	0 .. 3.40282E38
			N/A
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
<b>SNVT_freq_hz</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Frequency	Hertz	0 .. 6,553.5
			N/A
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
<b>SNVT_freq_kilohz</b>	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Frequency	Kilohertz	0 .. 6,553.5
			N/A

## Additional Information

SNVT_freq_milhz	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Frequency	Hertz	0 .. 6.5535
SNVT_gfci_status	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Invalid Value</b>
	gfci_status_t	N/A	0 .. 5 255 (0xFF) (GFCI_NUL)
SNVT_grammage	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Invalid Value</b>
	Grammage	Grams/Square-meter	0 .. 6,553.5 N/A
SNVT_grammage_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Invalid Value</b>
	Grammage	Grams/Square-meter	0 .. 3.40282E38 N/A
SNVT_hvac_emerg	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Invalid Value</b>
	emerg_t	N/A	0 .. 5 255 (0xFF) (EMERG_NUL)
SNVT_hvac_mode	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Invalid Value</b>
	Hvac_t	N/A	0 .. 17 255 (0xFF) (HVAC_NUL)
SNVT_hvac_overid	<b>Data Length</b>	3	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	hvac_ord_state	
	<b>Measurement</b>	<b>Units</b>	<b>Invalid Value</b>
	hvac_overid_t	N/A	0 .. 48 255 (0xFF) (HVO_NUL)
	<b>Data Item 2</b>	hvac_ord_percent	
	Percent	Percent of Full Scale	-163.840.. 163.830 Type: 163.835 Raw: 32,767 (0x7FFF)
	<b>Data Item 3</b>	hvac_ord_flow	
	Flow	Liters per Second	0 .. 65,534 65,535 (0xFFFF)

## Additional Information

SNVT_hvac_status	<b>Data Length</b>	7	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	hvac_sts_mode	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	hvac_t	N/A	0 .. 17
	<b>Data Item 2</b>	255 (0xFF)(HV_NUL)	
	Primary Heat Output	Percent of Full Scale	-163.840 .. 163.830
	<b>Data Item 3</b>	Type: 163.835 Raw: 32,767 (0x7FFF)	
	Secondary Heat Output	Percent of Full Scale	-163.840 .. 163.830
	<b>Data Item 4</b>	Type: 163.835 Raw: 32,767 (0x7FFF)	
SNVT_hvac_type	<b>Data Item 5</b>	hvac_heat_out_sec	
	Cooling Output	Percent of Full Scale	-163.840 .. 163.830
	<b>Data Item 6</b>	Type: 163.835 Raw: 32,767 (0x7FFF)	
	Economizer Output	Percent of Full Scale	-163.840 .. 163.830
	<b>Data Item 7</b>	Type: 163.835 Raw: 32,767 (0x7FFF)	
	In Alarm State	Alarm value	0 .. 1
	<b>Data Length</b>	N/A	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Byte, Uint16, Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
SNVT_length	Hvac_hvt_t	N/A	0 .. 9
	<b>Data Length</b>	255 (0xFF)(HVT_NUL)	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Length	Meters (m)	0 .. 6,553.5
	<b>Data Length</b>	N/A	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
SNVT_length_f	Length	Meters	0 .. 3.40282E38
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Length	Meters	0 .. 3.40282E38
	<b>Data Length</b>	N/A	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
SNVT_length_kilo	Length	Kilometers (km)	0 .. 6,553.5
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Length	Kilometers (km)	0 .. 6,553.5
	<b>Data Length</b>	N/A	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
SNVT_length_micr	Length	Micrometers, Microns	0 .. 6,553.5
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Length	Micrometers, Microns	0 .. 6,553.5
	<b>Data Length</b>	N/A	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
SNVT_length_mil	Length	Millimeters (mm)	0 .. 6,553.5
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Length	Millimeters (mm)	0 .. 6,553.5
	<b>Data Length</b>	N/A	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
SNVT_lev_cont	Continuous Level	Percent of Full Level	0 .. 100.0
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Continuous Level	Percent of Full Level	0 .. 100.0
	<b>Data Length</b>	N/A	
	<b>Suggested Data Array Formats</b>	1	
	<b>Data Item 1</b>	Float	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>

## Additional Information

SNVT_lev_cont_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Continuous Level	Percent of Full Scale	0 .. 100
SNVT_lev_disc	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Discrete_levels_t	N/A	0 .. 4 255 (0xFF)(ST_NUL)
SNVT_lev_percent	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Percentage Level	% of Full Scale, or Parts-per Million (ppm)	-163.840..163.830 Type: 163.835 Raw: 32,767 (0x7FFF)
SNVT_lux	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Illumination	Lux	0 .. 65,535
SNVT_magcard (only raw data support)	<b>Data Length</b>	20	
	<b>Suggested Data Array Formats</b>	Byte	
SNVT_mass	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Mass	Grams	0 .. 6,553.5
SNVT_mass_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Mass	Grams	0 .. 3.40282E38
SNVT_mass_flow	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float, Uint16	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Mass	kg/h	-32768..32767
SNVT_mass_flow_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Mass	kg/h	-3.40282E38..3.40282E38
SNVT_mass_kilo	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Mass	Kilograms (kg)	0 .. 6,553.5
SNVT_mass_mega	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Mass	Metric Tons; Tonne	0 .. 6,553.5

## Additional Information

SNVT_mass_mil	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Mass	Milligrams (mg)	0 .. 6,553.5
SNVT_motor_state	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	motor_state_t	N/A	0 .. 7
SNVT_mul_div	<b>Data Length</b>	2	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Multiplier	N/A	0 .. 65,535
SNVT_multiplier	<b>Data Item 2</b>		
	<b>Divisor</b>	<b>Units</b>	<b>Values Range</b>
	Divisor	N/A	1 .. 65,535
	<b>Data Length</b>	0	
	<b>Suggested Data Array Formats</b>	N/A	
SNVT_nv_type	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Multiplier	N/A	0 .. 32.7675
	<b>Data Length</b>	15	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
SNVT_nv_type	<b>Data Item 1-8</b>	nv_type_pid0,..nv_type_pid7	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Program ID	N/A	0 .. 255
	<b>Data Item 9</b>	nv_type_scope	
	Scope	N/A	0 .. 6
SNVT_nv_type	<b>Data Item 10</b>	nv_type_index	
	Type index	N/A	1 .. 65,535
	<b>Data Item 11</b>	nv_type_cat	
	nv_type_category_t	N/A	1 .. 14
	<b>Data Item 12</b>	nv_type_length	
SNVT_nv_type	Type length	Bytes	1 .. 31
	<b>Data Item 13</b>	nv_type_scale_a	
	Scaling multiplier	N/A	-32,768 .. 32,766
	<b>Data Item 14</b>	32,767	
	Scaling exponent	N/A	-32,768 .. 32,766
SNVT_obj_request	<b>Data Item 15</b>	nv_type_scale_c	
	Scaling offset	N/A	-32,768 .. 32,766
	<b>Data Length</b>	32,767	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>	obj_request_id	
SNVT_obj_request	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	obj_request_id	File Byte Address	0..2,147,483,647
	<b>Data Item 2</b>	N/A	
	object_request_t	N/A	0 .. 17
	<b>Data Length</b>	255 (0xFF)(RQ_NUL)	
SNVT_obj_status	<b>Suggested Data Array Formats</b>	2	
	<b>Data Item 1</b>	Uint32	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Functional Block ID	N/A	0 .. 65,535
	<b>Data Item 2</b>	N/A	
SNVT_obj_status	object_status_bits	Bits	0..4,294,967,295
	<b>Data Length</b>	N/A	
	<b>Suggested Data Array Formats</b>	obj_status_id	
	<b>Data Item 1</b>	obj_status_bits	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>

## Additional Information

SNVT_occupancy	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Occup_t	N/A	0 .. 3
SNVT_override	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	override_t	N/A	0 .. 2
SNVT_pH	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Acidity	pH	-32.768 .. 32.767
SNVT_pH_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Acidity	pH	-3.40282E38..3.40282E38
SNVT_pos_ctrl	<b>Data Length</b>	9	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	pos_ctrl_rcvr_id	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Receiver ID	ID number	1 .. 65,535
	<b>Data Item 2</b>	pos_ctrl_cntrl_id	
	Controller ID	ID number	1 .. 65,534
	65,535 (0xFFFF)		
	<b>Data Item 3</b>	pos_ctrl_cntrl_prio	
	Controller priority	Priority value	0 .. 200
	<b>Data Item 4</b>	pos_ctrl_function	
	cam_func_t	N/A	0 .. 2
	255 (0xFF)(CMF_NUL)		
	<b>Data Item 5</b>	pos_ctrl_action	
	cam_act_t	N/A	0 .. 2
	255 (0xFF)(CMA_NUL)		
	<b>Data Item 6</b>	pos_ctrl_number	
	Action number	Action number	1 .. 255
	<b>Data Item 7</b>	0	
	Pan position	Degrees	-359.98 .. 360.00
	Raw: 32,767 (0x7FFF) Type: 655.34		
	<b>Data Item 8</b>	pos_ctrl_tilt	
	Tilt position	Degrees	-359.98 .. 360.00
	Raw: 32,767 (0x7FFF) Type: 655.34		
	<b>Data Item 9</b>	pos_ctrl_zoom	
	Zoom position	Percent of full-scale or ppm	-163.840..163.830
	Raw: 32,767 (0x7FFF) Type: 163.835		
SNVT_power	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Power	Watts (W)	0 .. 6,553.5
SNVT_power_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Power	Watts	-3.40282E38..3.40282E38

## Additional Information

SNVT_power_kilo	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Power	KiloWatts	0 .. 6,553.5
SNVT_ppm	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Concentration	Parts per Million (ppm)	0 .. 65,535
SNVT_ppm_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Concentration	Parts per Million	0 .. 3.40282E38
SNVT_preset	<b>Data Length</b>	11	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>	preset_learn	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	learn_mode_t	N/A	0 .. 3
	<b>Data Item 2</b>	preset_selector	
	Selector	N/A	0 .. 65,535
	<b>Data Item 3-6</b>	preset_value00..preset_value03	
	Value	Specific to SNVT	0 .. 255
	<b>Data Item 7</b>	preset_day	
	Days	Days	0 .. 65,534
	<b>Data Item 8</b>	preset_hour	
	Hours	Hour	0 .. 23
	<b>Data Item 9</b>	preset_minute	
	Minutes	Minutes	0 .. 59
	<b>Data Item 10</b>	preset_second	
	Seconds	Seconds	0 .. 59
SNVT_preset	<b>Data Item 11</b>	preset_millisec	
	Milliseconds	Milliseconds	0 .. 999
SNVT_press	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Pressure (gauge)	KiloPascals	-3,276.8 .. 3,276.6
SNVT_press_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Pressure (gauge)	Pascals	-3.40282E38 .. 3.40282E38
SNVT_press_p	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Sint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Pressure (gauge)	Pascals	-32,768 .. 32,766
			32,767 (0x7FFF)

## Additional Information

SNVT_privacyzone	<b>Data Length</b>	3	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>	priv_zn_action	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	privacyzone_t	N/A	0 .. 5
	<b>Data Item 2</b>	255 (0xFF) (PZ_NUL)	
	Zone number	Privacy zone number	1 .. 255
	<b>Data Item 3</b>	priv_zn_number	
	Camera ID	ID number	1 .. 65,535
	<b>Data Length</b>	0	
	<b>Suggested Data Array Formats</b>	priv_zn_camera_id	
	<b>Data Item 4</b>	Camera ID	
SNVT_ptz	<b>Data Length</b>	6	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	ptz_pan_dir	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	ptz_pan_dir	Direction	0 .. 255
	<b>Data Item 2</b>	N/A	
	Pan speed	Percent of full level	0.0 .. 100.0
	<b>Data Item 3</b>	ptz_pan_speed	
	tilt_dir_t	N/A	0 .. 2
	<b>Data Item 4</b>	255 (0xFF) (TILT_NUL)	
	Tilt speed	Percent of full level	0.0 .. 100.0
	<b>Data Item 5</b>	N/A	
SNVT_pump_sensor	zoom_t	N/A	0 .. 2
	<b>Data Item 6</b>	ptz_tilt_dir	
	ptz_zoom_speed	Meters (m)	-3.40282E38 .. 3.40282E38
	<b>Data Length</b>	ptz_tilt_speed	
	<b>Suggested Data Array Formats</b>	N/A	
	<b>Data Item 1</b>	ptz_zoom	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Frequency	Hertz	0 .. 6,553.4
	<b>Data Item 2</b>	N/A	
	Body temperature	Degrees Celsius	-274.0 .. 6,279.4
	<b>Data Item 3</b>	N/A	
	Motor external temp	Degrees Celsius	-274.0 .. 6,279.4
	<b>Data Item 4</b>	N/A	
	Motor internal temp	Degrees Celsius	-274.0 .. 6,279.4
SNVT_pump_sensor	<b>Data Item 5</b>	N/A	
	Boolean	Bit	0, 1
	<b>Data Item 6</b>	pump_sn_mot_overload	
	Boolean	Bit	255 (0xFF) (BOOL_NUL)
	<b>Data Item 7</b>	pump_sn_body_temp	
	Boolean	Bit	255 (0xFF) (BOOL_NUL)
	<b>Data Item 8</b>	pump_sn_mot_int_temp	
	Electric current use	Ampere	-3,276.8..3,276.6
	<b>Data Item 9</b>	N/A	
	Power usage	Kilowatts	0 .. 6,553.4
	<b>Data Item 10</b>	pump_sn_pwr_usage	
	unit_temp_t	N/A	0 .. 3
SNVT_pump_sensor	<b>Data Item 11</b>	255 (0xFF) (TEMP_NUL)	
	Boolean	Bit	0, 1
	<b>Data Item 12</b>	pump_sn_em_brake_act	
	Boolean	Bit	255 (0xFF) (BOOL_NUL)
	<b>Data Item 13</b>	pump_sn_fric_brk_act	
	Boolean	Bit	255 (0xFF) (BOOL_NUL)
	<b>Data Item 14</b>	pump_sn_gas_brk_act	
	Boolean	Bit	255 (0xFF) (BOOL_NUL)

## Additional Information

SNVT_pumpset_mn	<b>Data Length</b>	8	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>	pset_main_pump	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	motor_state_t	N/A	0 .. 7
	<b>Data Item 2</b>	255 (0xFF) (MOTOR_NUL)	
	motor_state_t	N/A	0 .. 7
	<b>Data Item 3</b>	pset_booster_pump	
	priority_level_t	N/A	0 .. 11
	<b>Data Item 4</b>	255 (0xFF) (PR_NUL)	
	Boolean_t	Bit	0, 1
	<b>Data Item 5</b>	255 (0xFF) (BOOL_NUL)	
	Boolean_t	Bit	0, 1
SNVT_pumpset_sn	<b>Data Length</b>	14	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	pset_sn_dil_flow	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Total Dilution Flow Volume	Milliliters per second	0 .. 65,534
	<b>Data Item 2</b>	N/A	
	Exhaust Temperature	Degrees Celsius	-274.0 .. 6,279.4
	<b>Data Item 3</b>	N/A	
	Exhaust Pressure	Kilo-pascals	-3,276.8..3,276.6
	<b>Data Item 4</b>	N/A	
	Shaft seal purge pressure	Kilo-pascals	-3,276.8..3,276.6
	<b>Data Item 5</b>	N/A	
	Inlet vacuum pressure	Kilo-pascals	-3.40282E38 .. 3.40282E38
SNVT_pwr_fact	<b>Data Item 6</b>	pset_sn_inlet_vacuum	
	Supply voltage	Volts	-3,276.8..3,276.6
	<b>Data Item 7</b>	N/A	
	Total coolant flow	Milliliters per second	0 .. 65,534
	<b>Data Item 8</b>	N/A	
	Boolean	Bit	0, 1
	<b>Data Item 9</b>	255 (0xFF) (BOOL_NUL)	
	Boolean	Bit	0, 1
	<b>Data Item 10</b>	255 (0xFF) (BOOL_NUL)	
	Boolean	Bit	0, 1
	<b>Data Item 11</b>	pset_sn_inl_p_dil_act	
	Boolean	Bit	0, 1
	<b>Data Item 12</b>	255 (0xFF) (BOOL_NUL)	
	Boolean	Bit	0, 1
	<b>Data Item 13</b>	pset_sn_exh_dil_act	
	Boolean	Bit	0, 1
	<b>Data Item 14</b>	255 (0xFF) (BOOL_NUL)	
	Boolean	Bit	0, 1
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Power Factor	Multiplier	-1.00000..1.00000
			N/A

## Additional Information

SNVT_pwr_fact_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Power Factor	N/A	-1 .. 1
SNVT_reg_val	<b>Data Length</b>	3	
	<b>Suggested Data Array Formats</b>	Sint32	
	<b>Data Item 1</b>	reg_val_value	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Raw value	Defined by unit field	-2,147,483,638 .. 2,147,483,647
	<b>Data Item 2</b>	reg_val_unit	
	reg_val_unit_t	N/A	0 .. 43
	<b>Data Item 3</b>	reg_val_decimals	
SNVT_reg_val_ts	Decimal Place	Digits after Decimal	0 .. 7
	<b>Data Length</b>	9	
	<b>Suggested Data Array Formats</b>	Sint32	
	<b>Data Item 1</b>	reg_val_ts_raw	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Raw Value		-2,147,483,648 .. 2,147,483,647
	<b>Data Item 2</b>	reg_val_ts_unit	
	reg_val_unit_t	N/A	0 .. 43
	<b>Data Item 3</b>	reg_val_ts_bits	
	See SNVT tables	See SNVT tables	0 .. 255
	<b>Data Item 4</b>	reg_val_ts_year	
	Year	Year	0 .. 300
	<b>Data Item 5</b>	reg_val_ts_month	
	Month	Month of Year	0 .. 12
SNVT_res	<b>Data Item 6</b>	reg_val_ts_day	
	Day	Day of Month	0 .. 31
	<b>Data Item 7</b>	reg_val_ts_hour	
	Hour	Hour of day	0 .. 23
	<b>Data Item 8</b>	reg_val_ts_min	
	Minutes	Minute of Hour	0 .. 59
	<b>Data Item 9</b>	reg_val_ts_secs	
	Minutes	Minute of Hour	0 .. 59
	<b>Data Length</b>	1	
SNVT_res_f	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Electrical Resistance	Ohms	0 .. 6,553.5
	<b>Data Length</b>	1	
SNVT_res_kilo	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Electrical Resistance	KiloOhms	0 .. 6,553.5
	<b>Data Length</b>	1	

## Additional Information

SNVT_rpm	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Angular Velocity	Revolutions per Minute (RPM)	0 .. 65,534 65,535 (0xFFFF)
SNVT_sblnd_state	<b>Data Length</b>	5	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	function	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	setting_t	N/A	0 .. 5 255 (SET_NUL)
	<b>Data Item 2</b>	setting	
	Scene setting Level	Percent of Full Level	0 .. 100 N/A
	<b>Data Item 3</b>	rotation	
	Rotation Angle	Degrees	-359.98 .. 360.00 32,767 (0x7FFF)
	<b>Data Item 4</b>	cmd_source	
SNVT_scene	sblnd_cmd_source_t	N/A	0 .. 127 -1 (0xFF)
	<b>Data Item 5</b>	error_code	
	sblnd_error_t	N/A	0 .. 14 -1 (0xFF)
	<b>Data Length</b>	2	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
SNVT_scene_cfg	<b>Data Item 1</b>	Function	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Scene_t	N/A	0 .. 23 255 (0xFF) (SC_NUL)
	<b>Data Item 2</b>	Scene_Number	
	Scene Number	Scene Number	1 .. 255 N/A
	<b>Data Length</b>	7	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	scn_cfg_func	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	scene_config_t	N/A	0 .. 4 255 (0xFF) (SCF_NUL)
SNVT_setting	<b>Data Item 2</b>	scn_cfg_scene	
	Scene Number	Scene Number	1 .. 255 N/A
	<b>Data Item 3</b>	scn_cfg_setting	
	Scene Setting Level	Percent of Full Level	0 .. 100.0 N/A
	<b>Data Item 4</b>	scn_cfg_rotation	
	Scene Rotation Angle	Degrees	-359.98 .. 360.00 Raw: 32,767 (0x7FFF) Type: 655.34
	<b>Data Item 5</b>	scn_cfg_fade_tim	
	Scene Fade Time	Seconds	0.0 to 6,553.4 Raw: 65,535 (0xFFFF) Type: 6553.5
	<b>Data Item 6</b>	scn_cfg_dly_tim	
	Scene Delay Time	Seconds	0.0 to 6,553.4 Raw: 65,535 (0xFFFF) Type: 6553.5
	<b>Data Item 7</b>	scn_cfg_scn_proi	
	Scene Priority	Priority Value	0 .. 255 N/A
	<b>Data Length</b>	3	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	setting_function	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	setting_t	N/A	0 .. 5 255 (0xFF)(SET_NUL)
	<b>Data Item 2</b>	setting_setting	
	Scene Setting Level	Percent of Full Level	0 .. 100.0 N/A
	<b>Data Item 3</b>	setting_rotation	
	Rotation Angle	Degrees	-359.98 .. 360.00 Raw: (0x7FFF) 32,767 Type: 655.34

## Additional Information

SNVT_smo_obscur	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Smoke Obscuration	Percent Obscuration	0.000 .. 5.000
SNVT_sound_db	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Sound Level	Decibels	-327.68 .. 327.67
SNVT_sound_db_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Sound Level	Decibels from Sound Pressure Level	-3.40282E38 .. 3.40282E38
SNVT_speed	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Linear Velocity	Meters per Second	0 .. 6,553.5
SNVT_speed_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Speed	Meters per Second	-3.40282E38 .. 3.40282E38
SNVT_speed_mil	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Linear Velocity	Millimeters per Second	0 .. 65,535
SNVT_state	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	16 state bits	Bits	0 .. 65,535
SNVT_state_64	<b>Data Length</b>	4	
	<b>Suggested Data Array Formats</b>	Packed_Bit, Uint16, Float	
	<b>Data Item 1</b>	state_64_word0	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Boolean	Bit	0, 1 per bit (16 bits in word)
	<b>Data Item 2</b>	state_64_word1	
	Boolean	Bit	0, 1 per bit (16 bits in word)
	<b>Data Item 3</b>	state_64_word2	
	Boolean	Bit	0, 1 per bit (16 bits in word)
	<b>Data Item 4</b>	state_64_word3	
	Boolean	Bit	0, 1 per bit (16 bits in word)

## Additional Information

SNVT_str_asc	<b>Data Length</b>			31
	<b>Suggested Data Array Formats</b>			Byte, Uint16, Float
	<b>Data Item 1 - 31</b>			ascii00, ascii01, .. ascii30
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Character String	N/A	0 .. 255	N/A
SNVT_str_int	<b>Data Length</b>			16
	<b>Suggested Data Array Formats</b>			Uint16, Float
	<b>Data Item 1</b>			char_set
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Locale Code	N/A	0 .. 255	N/A
SNVT_switch	<b>Data Item 2 - 16</b>			wide_char00, .. wide_char14
	Wide-character string with NULL terminator	N/A	0 .. 65,535	N/A
	<b>Data Length</b>			2
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			Value
SNVT_telcom	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Value	Percent of full scale	0 .. 100.0	N/A
	<b>Data Item 2</b>			State
	State	N/A	0 .. 1	-1
	<b>Data Length</b>			1
SNVT_temp	<b>Suggested Data Array Formats</b>			Byte, Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	telcom_states_t	N/A	0 .. 20	255 (0xFF) (TEL_NUL)
	<b>Data Length</b>			1
SNVT_temp_diff_p	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Temperature	Degrees Celsius	-274.0 .. 6,279.5	N/A
	<b>Data Length</b>			1
SNVT_temp_f	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Incremental Count	Degrees Celsius	-3.40282E38 .. 3.40282E38	N/A
	<b>Data Length</b>			1
SNVT_temp_p	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Temperature	Degrees Celsius	-273.17 .. 327.66	Type: 327.67 Raw: 32,767 (0x7FFF)
	<b>Data Length</b>			1
SNVT_temp_ror	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Temperature Rate of Change/Rise	Degrees Celsius per Minute ('C/min)	-16,384.0..16,383.0	Raw: 32,767 (0x7FFF) Type: 16,383.5
	<b>Data Length</b>			1

## Additional Information

	<b>Data Length</b>	6	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	Occupied_cool	
SNVT_temp_setpt	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Occupied Cooling Setpoint	Degrees Celsius	-273.17 .. 327.66 Type: 327.67 Raw: 32,767 (0x7FFF)
	<b>Data Item 2</b>	Standby_cool	
	Standby Cooling Setpoint	Degrees Celsius	-273.17 .. 327.66 Type: 327.67 Raw: 32,767 (0x7FFF)
	<b>Data Item 3</b>	Unoccupied_cool	
	Unoccupied Cooling Setpoint	Degrees Celsius	-273.17 .. 327.66 Type: 327.67 Raw: 32,767 (0x7FFF)
SNVT_therm_mode	<b>Data Item 4</b>	Occupied_heat	
	Occupied Heating Setpoint	Degrees Celsius	-273.17 .. 327.66 Type: 327.67 Raw: 32,767 (0x7FFF)
	<b>Data Item 5</b>	Standby_heat	
	Standby Heating Setpoint	Degrees Celsius	-273.17 .. 327.66 Type: 327.67 Raw: 32,767 (0x7FFF)
	<b>Data Item 6</b>	Unoccupied_heat	
	Unoccupied Heating Setpoint	Degrees Celsius	-273.17 .. 327.66 Type: 327.67 Raw: 32,767 (0x7FFF)
SNVT_time_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	therm_mode_t	N/A	0 .. 2 255 (0xFF) (THERM_NUL)
	<b>Data Length</b>	1	
SNVT_time_hour	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Elapsed Time	Seconds	-3.40282E38.. 3.40282E38
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
SNVT_time_min	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Elapsed Time	Hours	0 .. 65,535
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
SNVT_time_sec	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Elapsed Time	Minutes	0 .. 65,535
	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>		
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Elapsed time	Seconds	0 .. 6,553.4 65,535 (0xFFFF)

## Additional Information

SNVT_time_stamp	<b>Data Length</b>	6	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>	ts_year	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Year	Year	0 .. 3000
	<b>Data Item 2</b>	65,535 (0xFFFF)	
	Month	Month of Year	0 .. 12
	<b>Data Item 3</b>	ts_month	
	Day	Day of Month	0 .. 31
	<b>Data Item 4</b>	N/A	
	Hours	Hours of Day	0 .. 23
	<b>Data Item 5</b>	ts_hour	
	Minutes	Minute of Hour	0 .. 59
	<b>Data Item 6</b>	ts_minute	
	Second	Second of Minute	0 .. 59
SNVT_time_zone (only raw data support)	<b>Data Length</b>	15	
	<b>Suggested Data Array Formats</b>	Byte	
SNVT_tod_event	<b>Data Length</b>	3	
	<b>Suggested Data Array Formats</b>	Uint16, Float	
	<b>Data Item 1</b>	tod_cur_state	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	occup_t	N/A	0 .. 3
	<b>Data Item 2</b>	255 (0xFF) (OC_NUL)	
	occup_t	N/A	0 .. 3
	<b>Data Item 3</b>	255 (0xFF) (OC_NUL)	
SNVT_trans_table	Time to Next State	Minute of Hour	0 .. 65,535
	<b>Data Length</b>	8	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1-7</b>	tr_point00,..tr_point06	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Axis-points Array	N/A	-3.40282E38.. 3.40282E38
	<b>Data Item 8</b>	N/A	
	interp_t	N/A	0 .. 65,535
SNVT_turbidity	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	N/A	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Turbidity	Nephelometric Turbidity Units (NTU)	0 .. 65.534
SNVT_turbidity_f	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Float	
	<b>Data Item 1</b>	N/A	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Turbidity	Nephelometric Turbidity Units (NTU)	0 .. 3.40282E38
SNVT_valve_mode	<b>Data Length</b>	1	
	<b>Suggested Data Array Formats</b>	Byte, Uint16, Float	
	<b>Data Item 1</b>	N/A	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	valve_mode_t	N/A	0 .. 7
SNVT_vol	<b>Data Length</b>	255 (0xFF) (VALVE_NUL)	
	<b>Suggested Data Array Formats</b>	N/A	
	<b>Data Item 1</b>	N/A	
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>
	Volume	Liters	0 .. 6,553.5

## Additional Information

SNVT_vol_f	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Volume	Liters	0 .. 3.40282E38	N/A
SNVT_vol_kilo	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Volume	Kiloliters (kl)	0 .. 6,553.5	N/A
SNVT_vol_mil	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Volume	Milliliters	0 .. 6,553.5	N/A
SNVT_volt	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Electric Voltage	Volts	-3,276.8..3,276.7	N/A
SNVT_volt_ac	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Uint16, Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Electric Voltage	Volts, Alt. Current (VAC)	0 .. 65,534	65,535 (0xFFFF)
SNVT_volt_dbmv	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Electric Voltage	Decibels-milliVolts, Direct Current	-3,276.8.. 3,276.7	N/A
SNVT_volt_f	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Electric Voltage	Volts	-3.40282E38 .. 3.40282E38	N/A
SNVT_volt_kilo	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Electric Voltage	Kilovolts	-3,276.8.. 3,276.7	N/A
SNVT_volt_mil	<b>Data Length</b>			1
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Electric Voltage	Millivolts	-3,276.8.. 3,276.7	N/A
SNVT_zerospan	<b>Data Length</b>			2
	<b>Suggested Data Array Formats</b>			Float
	<b>Data Item 1</b>			zero
	<b>Measurement</b>	<b>Units</b>	<b>Values Range</b>	<b>Invalid Value</b>
	Zero-term	Percent (%) or Parts-per-Million (ppm)	-163.840.. 163.835	N/A
	<b>Data Item 2</b>			span
	Span-factor	Percent (%) or Parts-per-Million (ppm)	0 .. 32.7675	N/A

### 11.4 SNVT\_Type by Number

<b>SNVT Type Number</b>	<b>SNVT Type Name</b>	<b>SNVT Type Number</b>	<b>SNVT Type Name</b>
1	SNVT_amp	83	SNVT_state
2	SNVT_amp_mil	84	SNVT_time_stamp
3	SNVT_angle	85	SNVT_zerospan
4	SNVT_angle_vel	86	SNVT_magcard
5	SNVT_btu_kilo	87	SNVT_elapsed_tm
6	SNVT_btu_mega	88	SNVT_alarm
7	SNVT_char_ascii	89	SNVT_currency
8	SNVT_count	90	SNVT_file_pos
9	SNVT_count_inc	91	SNVT_muldiv
10	SNVT_date_cal	92	SNVT_obj_request
11	SNVT_date_day	93	SNVT_obj_status
12	SNVT_date_time	94	SNVT_preset
13	SNVT_elec_kwh	95	SNVT_switch
14	SNVT_elec_whr	96	SNVT_trans_table
15	SNVT_flow	97	SNVT_override
16	SNVT_flow_mil	98	SNVT_pwr_fact
17	SNVT_length	99	SNVT_pwr_fact_f
18	SNVT_length_kilo	100	SNVT_density
19	SNVT_length_micr	101	SNVT_density_f
20	SNVT_length_mil	102	SNVT_rpm
21	SNVT_lev_cont	103	SNVT_hvac_emerg
22	SNVT_lev_disc	104	SNVT_angle_deg
23	SNVT_mass	105	SNVT_temp_p
24	SNVT_mass_kilo	106	SNVT_temp_setpt
25	SNVT_mass_mega	107	SNVT_time_sec
26	SNVT_mass_mil	108	SNVT_hvac_mode
27	SNVT_power	109	SNVT_occupancy
28	SNVT_power_kilo	110	SNVT_area
29	SNVT_ppm	111	SNVT_hvac_overid
30	SNVT_press	112	SNVT_hvac_status
31	SNVT_res	113	SNVT_press_p
32	SNVT_res_kilo	114	SNVT_address
33	SNVT_sound_db	115	SNVT_scene
34	SNVT_speed	116	SNVT_scene_cfg
35	SNVT_speed_mil	117	SNVT_setting
36	SNVT_str_asc	118	SNVT_evap_state
37	SNVT_str_int	119	SNVT_therm_mode
38	SNVT_telcom	120	SNVT_defr_mode
39	SNVT_temp	121	SNVT_defr_term
40	SNVT_time_passed	122	SNVT_defr_state
41	SNVT_vol	123	SNVT_time_min
42	SNVT_vol_kilo	124	SNVT_time_hour
43	SNVT_vol_mil	125	SNVT_ph
44	SNVT_volt	126	SNVT_ph_f
45	SNVT_volt_dbmv	127	SNVT_chlr_status
46	SNVT_volt_kilo	128	SNVT_tod_event
47	SNVT_volt_mil	129	SNVT_smo_obscur
48	SNVT_amp_f	130	SNVT_fire_test
49	SNVT_angle_f	131	SNVT_temp_ror
50	SNVT_angle_vel_f	132	SNVT_fire_init
51	SNVT_count_f	133	SNVT_fire_indcte
52	SNVT_count_inc_f	134	SNVT_time_zone
53	SNVT_flow_f	135	SNVT_earth_pos
54	SNVT_length_f	136	SNVT_reg_val
55	SNVT_lev_cont_f	137	SNVT_reg_val_ts

<b>SNVT Type Number</b>	<b>SNVT Type Name</b>	<b>SNVT Type Number</b>	<b>SNVT Type Name</b>
56	SNVT_mass_f	138	SNVT_volt_ac
57	SNVT_power_f	139	SNVT_amp_ac
58	SNVT_ppm_f	143	SNVT_turbidity
59	SNVT_press_f	144	SNVT_turbidity_f
60	SNVT_res_f	145	SNVT_hvac_type
61	SNVT_sound_db_f	146	SNVT_elec_kwh_l
62	SNVT_speed_f	147	SNVT_temp_diff_p
63	SNVT_temp_f	148	SNVT_ctrl_req
64	SNVT_time_f	149	SNVT_ctrl_resp
65	SNVT_vol_f	150	SNVT_ptz
66	SNVT_volt_f	151	SNVT_privacyzone
67	SNVT_btu_f	152	SNVT_pos_ctrl
68	SNVT_elec_whr_f	153	SNVT_enthalpy
69	SNVT_config_src	154	SNVT_gfci_status
70	SNVT_color	155	SNVT_motor_state
71	SNVT_grammage	156	SNVT_pumpset_mn
72	SNVT_grammage_f	157	SNVT_ex_control
73	SNVT_file_req	158	SNVT_pumpset_sn
74	SNVT_file_status	159	SNVT_pump_sensor
75	SNVT_freq_f	160	SNVT_abs_humid
76	SNVT_freq_hz	161	SNVT_flow_p
77	SNVT_freq_kilohz	162	SNVT_dev_c_mode
78	SNVT_freq_milhz	163	SNVT_valve_mode
79	SNVT_lux	164	SNVT_alarm_2
80	SNVT_ISO_7811	165	SNVT_state_64
81	SNVT_lev_percent	166	SNVT_nv_type
82	SNVT_multiplier		

### 11.5 How to Interpret an XIF file

An XIF file can be viewed with a viewer program such as Notepad. The file contents start with a header section. The first three lines are for informational purposes (file name, copyright, etc.), followed by a 4<sup>th</sup> blank line.

The fifth line contains the program ID:

90:00:95:47:1E:02:04:D7

Lines 6-10 contain encoded information on the capabilities of the LonWorks device. Refer to the LonMark Device Interface File Reference Guide for more information.

Line 11 contains a single asterisk indicating the end of the device information.

\*


Line 12 contains the device self-documentation string, which is the same as the FieldServer title, specified in the configuration file:

":D48:S01:DCC085 X30.CSV v4.10c

The next section contains the Network Variable definitions. We will only discuss the encoded information of importance to the FieldServer. Refer to the LonMark Device Interface File Reference Guide for more information.

## Additional Information


An example of a Standard Network Variable Type (SNVT) Definition:

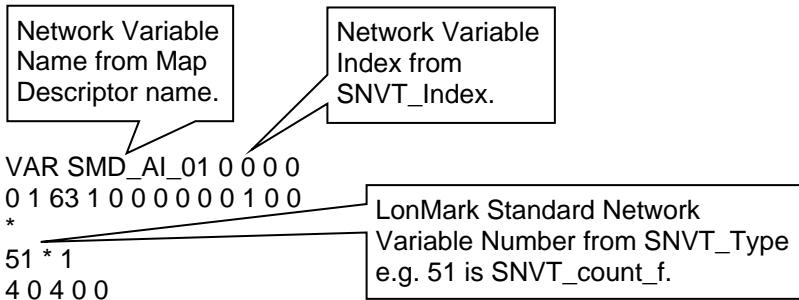

This is the Network Variable's entry in the configuration file:

Map_Descriptors	Map_Descriptor_Name	Data_Array_Name	Data_Array_Offset	Lon_Function	Function
	SMD_AI_01	,DA_AI_01	,0	,NVPO	,Server
<hr/>					
	,Node_Name	,SNVT_Index	,SNVT_Type		
	,Lon_srv_1	,0	,SNVT_count_f		

An example of a User Defined Network Variable Type (UNVT) Definition:

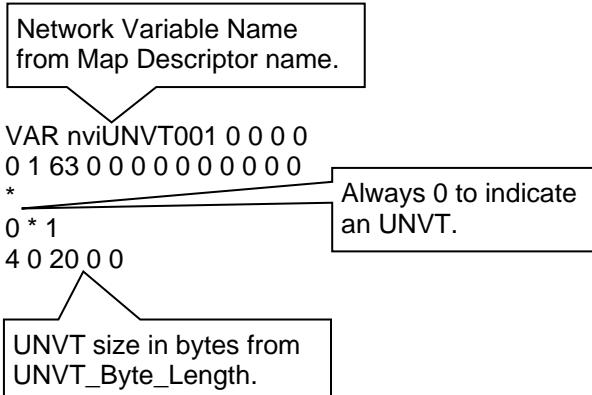

This is the Network Variable's entry in the configuration file:

Map_Descriptors	Map_Descriptor_Name	Data_Array_Name	Data_Array_Offset	Lon_Function	Function
	nviUNVT001	,DA_BYT	,0	,NVUI	,SERVER
<hr/>					
	,Node_Name	,SNVT_Type	,UNVT_Byte_Length		
	,Lon_1	,Not SNVT	,20		