

Driver Manual
FS-8704-26 SNMP
Version1 & Version2

APPLICABILITY & EFFECTIVITY

Effective for all systems manufactured after June 2023.



Driver Revision: 1.10
Document Revision: 2.D



fieldserver

MSA Safety
1000 Cranberry Woods Drive
Cranberry Township, PA 16066 USA
Website: www.MSAsafety.com

U.S. Support Information:

+1 408 964-4443
+1 800 727-4377
Email: smc-support@msasafety.com

EMEA Support Information:

+31 33 808 0590
Email: smc-support.emea@msasafety.com

Contents

| | | |
|----------|---|-----------|
| 1 | Description..... | 4 |
| 2 | Hardware Connections | 5 |
| 2.1 | Hardware Connection Tips / Hints..... | 5 |
| 3 | Data Array Parameters..... | 6 |
| 3.1.1 | Standard Configuration | 6 |
| 3.1.2 | Custom Configuration | 8 |
| 4 | Client Side Configuration | 9 |
| 4.1 | Client Side Connection Parameters | 9 |
| 4.2 | Client Side Node Parameters | 10 |
| 4.3 | Client Side Map Descriptor Parameters | 10 |
| 4.3.1 | FieldServer Specific Map Descriptor Parameters | 10 |
| 4.3.2 | Driver Related Map Descriptor Parameters | 11 |
| 4.4 | Map Descriptor Examples | 12 |
| 4.4.1 | Simple Get/Set Map Descriptors Example..... | 12 |
| 4.4.2 | Walk or BulkWalk Map Descriptors Example..... | 12 |
| 4.4.3 | Storing V1 Customer Map Descriptors Traps Example | 13 |
| 4.4.4 | Receiving Traps from an Agent as an SNMP Client | 13 |
| 5 | Server Side Configuration | 14 |
| 5.1 | Server Side Connection Parameters | 14 |
| 5.2 | Server Side Node Parameters..... | 15 |
| 5.3 | Server Side Standard Map Descriptor Parameters | 16 |
| 5.3.1 | FieldServer Specific Map Descriptor Parameters | 16 |
| 5.3.2 | Driver Related Map Descriptor Parameters | 16 |
| 5.3.3 | Binary Trap Map Descriptor Example | 17 |
| 5.3.4 | Analog Trap Map Descriptor Example | 17 |
| 5.3.5 | Emulating an MXL/XLS Device with Analogs | 17 |
| 5.4 | Custom Server Side Map Descriptors | 18 |
| 5.4.1 | FieldServer Related Map Descriptor Parameters | 18 |
| 5.4.2 | Driver Specific Map Descriptor Parameters | 18 |
| 5.4.3 | Basic OID Structure Map Descriptors Example | 19 |
| 5.4.4 | Simple Object Map Descriptor Example | 20 |
| 5.4.5 | Table, TableEntry and Objects in TableEntry Map Descriptor Example..... | 21 |
| 5.4.6 | String Object Map Descriptor Example..... | 23 |
| 5.4.7 | Trap/Notification Map Descriptor Example | 24 |
| 6 | Useful Features | 25 |
| 6.1 | Contents of Trap Messages | 25 |
| 6.1.1 | Trap Example..... | 26 |
| 6.2 | Using an .ini File to Set the Enterprise_ID and Enterprise_Name | 27 |
| 6.3 | Preloading Point Descriptions | 27 |
| 6.4 | Uploading a MIB File from FieldServer | 27 |
| 7 | Reference | 28 |
| 7.1 | Driver Error Messages..... | 28 |

1 Description

The SNMP-STD driver allows the FieldServer to transfer data to and from devices over Ethernet using the SNMP Version V1 or V2c protocol. The FieldServer can emulate a Server (SNMP Agent) or Client (NMS – Network Management Station).

The FieldServer provides a generic MIB (Management Information Base) file that sets out the OID (Object Identifiers) structure. The FieldServer Enterprise ID is 6347. A selection of standard MIB-2 OID's are supported to allow interaction with popular Network Management packages.

When configured as an SNMP Agent (Server) the SNMP-STD driver allows SNMP Get, GetNext (walk) and Set commands to access Data Arrays using the Integer type. The SNMP v1 protocol does not make provision for Floats.

The SNMP-STD driver can send SNMP traps. The structure for SNMP Traps is provided in the FieldServer's generic MIB file.

The FieldServer also support custom MIBs. It supports setting a custom enterprise ID, object names and custom traps or informs. In custom configurations, the FieldServer supports various data types as specified in **Section 5.4**.

When configured as a Client, the FieldServer can read objects from the Server using Get, GetNext(walk) or GetBulk commands. The GetBulk command is very useful to transfer large amounts of data. The FieldServer can update objects in Agent using the Set command.


The FieldServer can accept any trap or inform as long as all the objects in the message are encoded with a full OID.

The Client side of the driver is considered as a custom configuration.

| FieldServer Mode | Nodes | Comments |
|---|---|---|
| Maximum remote Nodes the driver Client can connect to | 100 (typical max recommendation) | Depends on update rate, system resources, network health, server response time etc. |
| Maximum remote Nodes that can connect to the Driver Server | 100 (typical max recommendation for poll response configuration and only 1 can also be a trap receiver) | Depends on update rate, system resources and network health etc. |
| Maximum local Client nodes the driver can emulate on one platform | 100 (typical max recommendation) | Depends on update rate, system resources, network health, server response time etc. |
| Maximum local Server Nodes the Driver can emulate on one platform | 254 | Virtual IP Addresses |
| Capable of Emulating local Server and Client at the same time? | No | |

2 Hardware Connections

The FieldServer is connected to the Ethernet using the UTP cable supplied. A typical hardware configuration is shown below:

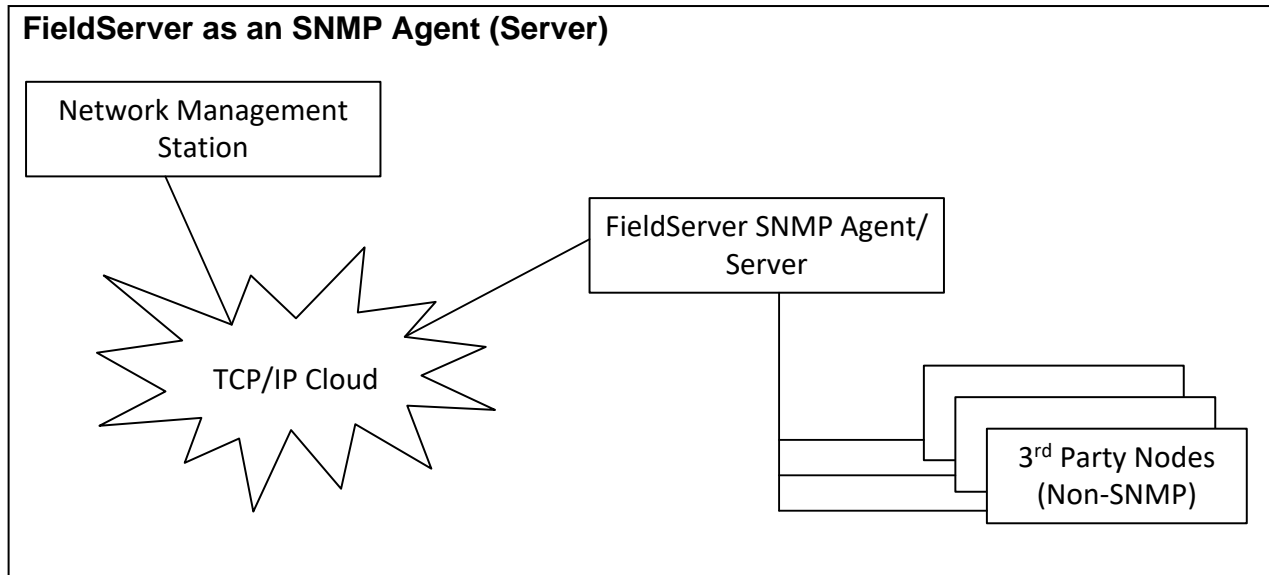

2.1 Hardware Connection Tips / Hints

- Ensure that the FieldServer and all Nodes to be monitored via SNMP have the same Netmask setting.
- Default IP ports
 - Port 161 – Poll/Walk commands
 - Port 162 – Traps

3 Data Array Parameters

Data Arrays are “protocol neutral” data buffers for storage of data to be passed between protocols. It is necessary to declare the data format of each of the Data Arrays to facilitate correct storage of the relevant data.

| Section Title | | |
|-------------------|--|--|
| Data_Arrays | | |
| Column Title | Function | Legal Values |
| Data_Array_Name | Provide name for Data Array. | Up to 15 alphanumeric characters |
| Data_Array_Format | Provide data format. Each Data Array can only take on one format. | Float, Bit, Byte, Uint16, Uint32, Sint16, Sint32 |
| Data_Array_Length | Number of Data Objects. Must be larger than the data storage area required by the Map Descriptors for the data being placed in this array. | 1-10000 |

Example

```
// Data Arrays

Data_Arrays
Data_Array_Name , Data_Format , Data_Array_Length
G_ALM_STAT_1 , Uint16 , 7
G_ALM_CNTR_1 , Uint16 , 6
BRN_CUR_ALM_1 , Uint16 , 253
LOCATION_1 , Byte , 128
AUX_CNT64_ , Uint32 , 2
DA_CONFIG , Bit , 1
```

3.1.1 Standard Configuration

A special Data Array naming convention is used to map FieldServer Data Arrays into the SNMP OID addressing scheme. Any Data Arrays that are to be visible via SNMP have to be named in the following way:

```
Data_Arrays
Data_Array_Name , Data_Format , Data_Array_Length
// Scalar Data Arrays
SNMP_AI , AI , 21
SNMP_AO , AO , 21
SNMP_AV , AV , 21
SNMP_BI , BI , 21
SNMP_BO , BO , 21
SNMP_BV , BV , 21
//Vector Data Arrays
SNMP_SV_1 , BV , 21
SNMP_AV_1 , AV , 21
SNMP_BV_1 , BV , 21
SNMP_SV_2 , BV , 21
SNMP_AV_2 , AV , 21
SNMP_BV_2 , BV , 21
```

Configuring the FieldServer

A Scalar data array should be used to represent data of the same type (e.g.: Analog values) in a single logical SNMP block. Vector data arrays should be used only if it is required to see data of the same type in multiple logical SNMP blocks. For example, suppose the FieldServer has to represent data (1000 Analog values in this example) from multiple sources (ID's 10 and 11 in this example).

To do this, one would declare vector Data Arrays SNMP_AV_10 & SNMP_AV_11, where 10 and 11 are identifiers (vector numbers) to represent source ID's.

SNMP OIDs for vector data arrays (assuming 500 in each array) will be:
 1.3.6.1.4.1.6347.2.52.1.1.10.1 - 1.3.6.1.4.1.6347.2.52.1.1.10.500
 and
 1.3.6.1.4.1.6347.2.52.1.1.11.1 - 1.3.6.1.4.1.6347.2.52.1.1.11.500

If one Scalar Array (SNMP_AV) had been used instead, the OID's would simply have been:
 1.3.6.1.4.1.6347.2.4.1.1.1 - 1.3.6.1.4.1.6347.2.4.1.1.1000

The Data_Format¹ and Data_Array_Length may be freely chosen. The Scalar Data Array needs to be determined as specified in the example above. The Vector Data Array name must be in SNMP_xV_y format, where x is the vector type (S-String, A-Analog, B-Binary) and y is the Integer number representing the vector number. Data will be mapped from Data Array Offset 1, e.g. OID 1 will be mapped to the specified Data Array at Offset 1, OID 3 will be mapped at Offset 3.

FieldServer OID's are based upon the Data Array name and length. The following table shows OID ranges for the Data Arrays declared in the previous table.

| Scalar Data_Array_Name, Data_Format, Data_Array_Length | Value OID range | Description OID range |
|--|--|--|
| SNMP_AI, AI, 21 | 1.3.6.1.4.1.6347.2.2.1.1.1-1.3.6.1.4.1.6347.2.2.1.1.20 | 1.3.6.1.4.1.6347.2.2.1.2.1-1.3.6.1.4.1.6347.2.2.1.2.20 |
| SNMP_AO, AO, 21 | 1.3.6.1.4.1.6347.2.3.1.1.1-1.3.6.1.4.1.6347.2.3.1.1.20 | 1.3.6.1.4.1.6347.2.3.1.2.1-1.3.6.1.4.1.6347.2.3.1.2.20 |
| SNMP_AV, AV, 21 | 1.3.6.1.4.1.6347.2.4.1.1.1-1.3.6.1.4.1.6347.2.4.1.1.20 | 1.3.6.1.4.1.6347.2.4.1.2.1-1.3.6.1.4.1.6347.2.4.1.2.20 |
| SNMP_BI, BI, 21 | 1.3.6.1.4.1.6347.2.5.1.1.1-1.3.6.1.4.1.6347.2.5.1.1.20 | 1.3.6.1.4.1.6347.2.5.1.2.1-1.3.6.1.4.1.6347.2.5.1.2.20 |
| SNMP_BO, BO, 21 | 1.3.6.1.4.1.6347.2.6.1.1.1-1.3.6.1.4.1.6347.2.6.1.1.20 | 1.3.6.1.4.1.6347.2.6.1.2.1-1.3.6.1.4.1.6347.2.6.1.2.20 |
| SNMP_BV, BV, 21 | 1.3.6.1.4.1.6347.2.7.1.1.1-1.3.6.1.4.1.6347.2.7.1.1.20 | 1.3.6.1.4.1.6347.2.7.1.2.1-1.3.6.1.4.1.6347.2.7.1.2.20 |

¹ The SNMP driver server transfers all data array values to requesting clients as signed integers or SInt32, except for ASCII characters which exchange in strings. The Data_Format for data arrays may still be freely chosen but be aware that value truncation and a change of sign of driver displayed values may take place when these values are transferred to the client.

| Vector Data_Array_Name, Data_Format, Data_Array_Length | Value OID range | Vector Description OID |
|---|---|---|
| SNMP_SV_1, BV, 21 | 1.3.6.1.4.1.6347.2.51.1.1.1.1- 1.3.6.1.4.1.6347.2.51.1.1.1.20 | 1.3.6.1.4.1.6347.2.51.1.2.1 |
| SNMP_SV_2, BV, 21 | 1.3.6.1.4.1.6347.2.51.1.1.2.1- 1.3.6.1.4.1.6347.2.51.1.1.2.20 | 1.3.6.1.4.1.6347.2.51.1.2.2 |
| SNMP_SV_x, BV, y | 1.3.6.1.4.1.6347.2.51.1.1.x.1- 1.3.6.1.4.1.6347.2.51.1.1.x.(y-1) | 1.3.6.1.4.1.6347.2.51.1.2.x |
| SNMP_AV_1, AV, 21 | 1.3.6.1.4.1.6347.2.52.1.1.1.1- 1.3.6.1.4.1.6347.2.52.1.1.1.20 | 1.3.6.1.4.1.6347.2.52.1.2.1.1 - 1.3.6.1.4.1.6347.2.52.1.2.1.20 |
| SNMP_AV_2, AV, 21 | 1.3.6.1.4.1.6347.2.52.1.1.2.1- 1.3.6.1.4.1.6347.2.52.1.1.2.20 | 1.3.6.1.4.1.6347.2.52.1.2.2.1- 1.3.6.1.4.1.6347.2.52.1.2.2.20 |
| SNMP_AV_x, AV, y | 1.3.6.1.4.1.6347.2.52.1.1.x.1- 1.3.6.1.4.1.6347.2.52.1.1.x.(y-1) | 1.3.6.1.4.1.6347.2.52.1.2.x.1- 1.3.6.1.4.1.6347.2.52.1.2.x.(y-1) |
| SNMP_BV_1, BV, 21 | 1.3.6.1.4.1.6347.2.53.1.1.1.1- 1.3.6.1.4.1.6347.2.53.1.1.1.20 | 1.3.6.1.4.1.6347.2.53.1.2.1.1- 1.3.6.1.4.1.6347.2.53.1.2.1.20 |
| SNMP_BV_2, BV, 21 | 1.3.6.1.4.1.6347.2.53.1.1.2.1- 1.3.6.1.4.1.6347.2.53.1.1.2.20 | 1.3.6.1.4.1.6347.2.53.1.2.2.1- 1.3.6.1.4.1.6347.2.53.1.2.2.20 |
| SNMP_BV_x, BV, y | 1.3.6.1.4.1.6347.2.53.1.1.x.1- 1.3.6.1.4.1.6347.2.53.1.1.x.(y-1) | 1.3.6.1.4.1.6347.2.53.1.2.x.1- 1.3.6.1.4.1.6347.2.53.1.2.x.(y-1) |

3.1.2 Custom Configuration

There is no special Data Array naming convention or format instructions.

| Data_Arrays | | |
|-----------------|-------------|-------------------|
| Data_Array_Name | Data_Format | Data_Array_Length |
| G_ALM_STAT_1 | , Uint16 | , 7 |
| G_ALM_CNTR_1 | , Uint16 | , 6 |
| BRN_CUR_ALM_1 | , Uint16 | , 253 |
| LOCATION_1 | , Byte | , 128 |
| AUX_CNT64_ | , Uint32 | , 2 |
| DA_CONFIG | , Bit | , 1 |

4 Client Side Configuration

For detailed information on FieldServer configuration, refer to the FieldServer Configuration Manual. The information that follows describes how to expand upon the factory defaults provided in the configuration files included with the FieldServer (see “.csv” sample files provided with the FieldServer).

This section documents and describes the parameters necessary for configuring the FieldServer to communicate with a SNMP Server such as a SNMP Agent application.

The configuration file tells the FieldServer about its interfaces, and the routing of data required. In order to enable the FieldServer for SNMP communications, the driver independent FieldServer buffers need to be declared in the “Data Arrays” section, the destination device addresses need to be declared in the “Client Side Nodes” section, and the data required from the Servers needs to be mapped in the “Client Side Map Descriptors” section. Details on how to do this can be found below.

NOTE: In the tables below, * indicates an optional parameter, with the bold legal value as default.

4.1 Client Side Connection Parameters

| Section Title | | | |
|---------------|--|--|---|
| Connections | Column Title | Function | Legal Values |
| | Adapter | Adapter Name. | N1, N2, WLAN ² |
| | Protocol | Specify protocol used. | SNMP-STD |
| | Public_Community* (Also known as SNMP_Community) | Specify the Server’s public community name if the FieldServer is supposed to be in a public domain. It will be used in polls (Get/Set) if there is no Private_Community specified. This is a case sensitive parameter. Any poll with a different community could be discarded by the Server. | Any string up to 255 characters, Public |
| | Private_Community* | Specify the Server’s private community name if it is different than Public_Community. The FieldServer will use this community in polls (Get/Set) requests. | Any string up to 255 characters. If undefined: value associated with Public_Community. |
| | Trap_Community* | Specify the Server’s trap community name if it is different than Public_Community. The FieldServer will discard any trap/inform received with an unknown community. It is case sensitive. | Any string up to 255 characters. If undefined: value associated with Public_Community. |
| | Application | This parameter should always be set to “custom”. | Custom, - |
| | SNMP_Protocol_Version* | Specify the SNMP protocol version supported by the Server. | V2c, V1 |
| | SNMP_Trap_Port* | Specify the trap port number if the remote server sends a trap/inform to a UDP port other than the standard (162) port. | 1-65534, 162 |

Example

```
// Client Side Connections
Connections
Adapter      , Protocol      , Application  , SNMP_Protocol_Version
N1           , SNMP-STD      , custom      , v2c
```

² Not all ports shown are necessarily supported by the hardware. Consult the appropriate Instruction manual for details of the ports available on specific hardware.

4.2 Client Side Node Parameters

| Section Title | | |
|----------------------|--|----------------------------------|
| Nodes | | |
| Column Title | Function | Legal Values |
| Node_Name | Provide name for Node. | Up to 32 alphanumeric characters |
| Adapter | Adapter Name. | N1, N2, WLAN ³ |
| Protocol | Specify protocol used. | SNMP-STD |
| IP_Address | Specify the Server Node's IP Address (SNMP Agent). | IP Address in decimal format |
| SNMP_Node_Version* | Specify the SNMP protocol version if the remote server supports a different version than specified on the connection. | V2c, V1 |
| SNMP_Node_Trap_Port* | Specify the trap port number if the remote server sends a trap/inform to a UDP port other than the standard (162) port and if different from the SNMP_Trap_Port specified on the connection. | 1-65534, 162 |
| Remote_Node_IP_Port* | Specify the poll/response port number if the remote server listens on a UDP port other than the standard (161) port. | 1-65534, 161 |

Example

```
// Client Side Nodes
Nodes
Node_Name , Node_ID , Protocol , Port
Panel1 , 1 , SNMP-STD , P1
```

4.3 Client Side Map Descriptor Parameters

4.3.1 FieldServer Specific Map Descriptor Parameters

| Column Title | Function | Legal Values |
|---------------------|---|--|
| Map_Descriptor_Name | Name of this Map Descriptor. | Up to 32 alphanumeric characters |
| Data_Array_Name | Name of Data Array where data is to be stored in the FieldServer. | One of the Data Array names from Section 3 |
| Data_Array_Offset | Starting location in Data Array. | 0 to (Data_Array_Length -1) as specified in Section 3 |
| Function | Function of Map Descriptor. | Server, Rdbc, Wrbc, Wrbx |

³ Not all ports shown are necessarily supported by the hardware. Consult the appropriate Instruction manual for details of the ports available on specific hardware.

4.3.2 Driver Related Map Descriptor Parameters

| Column Title | Function | Legal Values |
|------------------------|--|--|
| Node_Name | Name of Node to fetch data from. | One of the Node names specified in Section 4.2 |
| Length | Length of Map Descriptor. | 1 – (Data Array length – Data Array Offset) |
| Parent_Map_Descriptor* | Specify the name of the parent Map Descriptor that holds the previous OID integer. | Name of the previously created Map Descriptor, - |
| SNMP_OID* | Specify the Object Identifier. It could be the child number to the parent or the full OID. | 0 to any Integer or dot separated full OID, - |
| Data_Type | Specify the data type of the point in the MIB file. | OCTET STRING, INTEGER, Integer32, Counter, Counter32, Counter64, Gauge, Gauge32, Unsigned32, BITS, INDEX, INDEX_INTEGER, Table, TableEntry, NumberString ⁴ , Trap Store, Specific Trap Type |
| SNMP_Read_Method* | Specify the command that should be used to read data from Server. | Get , Walk, BulkWalk |
| Trap_Value_Index | Specify which value should be stored from trap message values. Index 0 means first value, 1 means second value, etc. | 0 - 255 |

⁴ Driver will convert a string to numbers before storing values and convert numbers to a string before sending. As there is no basic Float format in SNMP, NumberString can be used to transfer Floating point numbers.

4.4 Map Descriptor Examples

4.4.1 Simple Get/Set Map Descriptors Example

The following Map Descriptor will read the object identified by full OID 1.3.6.1.4.6347.1.1.3 every second and will store the data at offset 2 in DA_ScalarVar Data Array.

If the same Data Array location will be updated by another protocol, the FieldServer will issue a “Set” command to the SNMP server.

```
// Client Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name      , Data_Array_Offset      , Function      , Node_Name
Readn1ScalarObj3Name    , DA_SCALARVAR      , 2                        , rdbc          , SNMP_Server

, Length      , SNMP_OID      , Data_Type      , Scan_Interval
, 1           , 1.3.6.1.4.1.6347.1.1.3      , Integer32      , 1.000s
```

4.4.2 Walk or BulkWalk Map Descriptors Example

Using “Walk” or “BulkWalk” FieldServer can read all the objects under a specified OID.

Data returned by each poll will be stored on passive Map Descriptors. Passive Map Descriptors should be created to build an OID tree structure from the Server’s MIB file using the instructions under **Section 5.4.3**, **Section 5.4.4**, **Section 5.4.5** and **Section 5.4.6**.

```
// Client Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name      , Data_Array_Offset      , Function      , Node_Name
ReadEverything           , DA_POLLER            , 0                        , rdbc          , SNMP_Server

, Length      , SNMP_OID      , Scan_Interval      , SNMP_Read_Method
, 50          , All           , 5.000s             , BulkWalk
```

In the above example:

- **Length** – If it is a BulkWalk request, the driver will request the next 50 objects to be sent by the Server. If it is a simple walk request, this parameter will get ignored and the Server will only send 1 next object.
- **SNMP_OID** – OID to start with. “All” means the root of the OID tree i.e. 1.3. It could also be any OID, the driver will read the whole tree under this OID.

4.4.3 Storing V1 Customer Map Descriptors Traps Example

V1 traps are mostly vendor specific and each field in the trap message may have a vendor specific meaning. It is possible to store raw values from trap message and it can be transferred or used for custom logic.

The following set of Map Descriptors store the 'specific trap type' from the trap header and the first 3 variable bindings values from the trap message.

```
// Client Side Map Descriptors
```

| Map_Descriptor_Name | Data_Array_Name | Data_Array_Offset | Function | Node_Name |
|---------------------|------------------|-------------------|----------|-------------|
| v1trap_storage | DUMMY | 0 | Passive | SNMP_Server |
| trap_specific_type | DA_Specific_Type | 0 | Passive | SNMP_Server |
| OID1_VALUE | DA_OID1_VALUE | 0 | Passive | SNMP_Server |
| OID2_VALUE | DA_OID2_VALUE | 0 | Passive | SNMP_Server |
| OID3_VALUE | DA_OID3_VALUE | 0 | Passive | SNMP_Server |

| , Length | , Data_Type | , Parent_Map_Descriptor | , Trap_Value_Index |
|----------|----------------------|-------------------------|--------------------|
| , 1 | , Trap Store | , - | , - |
| , 1 | , Specific Trap Type | , v1trap_storage | , - |
| , 1 | , INTEGER | , v1trap_storage | , 0 |
| , 22 | , OBJECT IDENTIFIER | , v1trap_storage | , 1 |
| , 20 | , DisplayString | , v1trap_storage | , 2 |

4.4.4 Receiving Traps from an Agent as an SNMP Client

When configuring the FieldServer as an SNMP client, traps sent by an Agent to the Client will automatically update the related OID as long as the OID has been configured as a map descriptor somewhere in the FieldServer configuration. Consequently, it is not necessary to configure separate map descriptors for traps unless the OID's in question are not already configured. Should a GET request need to be configured to manage a trap that does not already have an associated OID in the configuration, then it is best to configure this trap using a passive map descriptor to receive the trap only (active GET requests may cause errors on Trap OID's if the Agent does not support it).

NOTE: The driver can support traps with full OIDs only⁵.

⁵ Some agents could send traps with relational OID/value pairs, for example: the value of an OID in a trap should be combined to other OID's in the trap (or a standard OID) to make an absolute OID. If the driver does not support it, the driver assumes each OID in an OID/value pair as an absolute OID.

5 Server Side Configuration

For detailed information on FieldServer configuration, refer to the FieldServer Configuration Manual. The information that follows describes how to expand upon the factory defaults provided in the configuration files included with the FieldServer (see “.csv” files provided with the FieldServer).

This section documents and describes the parameters necessary for configuring the FieldServer to communicate with a SNMP Client such as a Network Management application. Refer to **Section 6.1** for information on how to configure SNMP TRAPS.

The configuration file tells the FieldServer about its interfaces, and the routing of data required. In order to enable the FieldServer for SNMP communications, the driver independent FieldServer buffers need to be declared in the “Data Arrays” section, the FieldServer virtual node(s) needs to be declared in the “Server Side Nodes” section, and the data to be provided to the Clients needs to be mapped in the “Server Side Map Descriptors” section. Details on how to do this can be found below.

NOTE: In the tables below, * indicates an optional parameter, with the bold legal value as default.

5.1 Server Side Connection Parameters

| Section Title | | |
|--|---|--|
| Connections | | |
| Column Title | Function | Legal Values |
| Adapter | Adapter Name. | N1, N2, WLAN ⁶ |
| Protocol | Specify protocol used. | SNMP-STD |
| Public_Community* (Also known as SNMP_Community) | Specify the public community name. Any device accessing the FieldServer with this community name will have read-only privileges. This is a case sensitive parameter. If community in poll is not the same as public or private, poll will be discarded. | Any string up to 255 characters, Public |
| Private_Community* | Specify the private community name if it differs from the public_community. Any device accessing the FieldServer with this community name will have read-write privileges. This is a case sensitive parameter. | Any string up to 255 characters. If undefined: value associated with Public_Community. |
| Trap_Community* | Specify the trap community name if it differs from the public_community. This community name will be used in traps/informs generated by FieldServer. This is a case sensitive parameter. | Any string up to 255 characters. If undefined: value associated with Public_Community. |
| SNMP_Trap_Port* | Specify the UDP port number for the Server to send a trap/inform. | 1-65534, 162 |
| IP_Port* | Specify the UDP port number for the Server to accept polls on. | 1-65534, 161 |

Example

```
// Server Side Connections
Connections
Adapter      , Protocol      , Application  , SNMP_Protocol_Version
N1           , SNMP-STD    , custom      , v2c
```

⁶ Not all ports shown are necessarily supported by the hardware. Consult the appropriate Instruction manual for details of the ports available on specific hardware.

5.2 Server Side Node Parameters

NOTE: Required only if sending Traps or for custom configuration.

| Section Title | | |
|--------------------------------|---|--|
| Remote_Client_Node_Descriptors | | |
| Column Title | Function | Legal Values |
| Node_Name | Provide name for node. | Up to 32 alphanumeric characters |
| Adapter | Adapter Name. | N1, N2, WLAN ⁷ |
| Protocol | Specify protocol used. | SNMP-STD |
| IP_Address | Specify the Client Node's IP Address (Receiver of Traps). | IP Address in decimal format. |
| Virtual_IP | <p>If Virtual_IP is full IP Address (e.g.192.168.1.30), it will be added as it is. Otherwise it will be considered as an offset to base adapter IP for first time, and auto increment thereafter. For example, suppose Virtual_IP is 10 and unit's IP is 192.168.1.101:</p> <p>The first virtual IP will be 192.168.1.111 Second virtual IP will be 192.168.1.112</p> <p>Virtual_IP value 0 or - will not create any virtual IP.</p> <p>NOTE: All Virtual IPs should be on the same sub network as of base adapter network. If base adapter IP is 192.168.2.203, netmask is 255.255.255.0 and Virtual_IP is 192.168.1.29. Then netmask should be changed (say 255.255.0.0) to put both IPs on same sub network.</p> | <p>-, Any IP Address e.g. 192.168.1.45 offset to base IP e.g. 1, 2, 3 ...</p> <p>NOTE: 0 or - will not create any virtual IP.</p> |
| Create_MIB* | Specify if MIB file should be created from this node. The MIB file uses the following naming convention: f<ip>_<nn>.mib where <ip> is node's host IP Address (in decimal dot notation format) and <nn> is node name. Refer to Section 6.4 for instructions on how to upload a MIB file from the FieldServer. | No, Yes |

Example

```
// Server Side Nodes
Remote_Client_Node_Descriptors
Node_Name      , Node_ID      , Protocol      , Adapter      , IP_Address    , Create_MIB
SNMP_Server    , 1          , SNMP-STD     , N1          , 192.168.1.17 , Yes
```

⁷ Not all ports shown are necessarily supported by the hardware. Consult the appropriate Instruction manual for details of the ports available on specific hardware.

5.3 Server Side Standard Map Descriptor Parameters

NOTE: Required only if sending Traps.

Server Side Map Descriptors are not required by SNMP for Get, Get_Next or Set requests, since the mapping of FieldServer Data Arrays into the SNMP OID addressing scheme follows the method outlined in **Section 3**. Server Side Map Descriptors are required to configure SNMP TRAPS only.

5.3.1 FieldServer Specific Map Descriptor Parameters

| Column Title | Function | Legal Values |
|---------------------|---|---|
| Map_Descriptor_Name | Name of this Map Descriptor. | Up to 32 alphanumeric characters |
| Data_Array_Name | Name of Data Array where data is to be stored in the FieldServer. | One of the Data Array names from Section 3 |
| Data_Array_Offset | Starting location in Data Array. | 0 to maximum as specified in Section 3 |
| Function | Function of Client Map Descriptor. | SNMP_TRAP |

5.3.2 Driver Related Map Descriptor Parameters

| Column Title | Function | Legal Values | | | | | | | | | | | | | | | | | | | | |
|---------------|---|---|-----------|--------------|--------------|---|------------|---|-----------|---|--------|---|-------|----|---------|----|-------|----|---------|----|-----|----|
| Node_Name | Name of Node or panel for which this Map Descriptor holds points. | One of the Node names specified in Section 5.2 | | | | | | | | | | | | | | | | | | | | |
| Length | Length of Map Descriptor. | 1 – (Data Array length – Data Array Offset) | | | | | | | | | | | | | | | | | | | | |
| Trap_Type* | Specify the trap type that will be encoded in the Trap message whenever point is in Off-Normal state. Trap type Normal will be encoded in the trap message while the point is in normal state. | <table> <tr> <td>Trap_Type</td> <td>Encode value</td> </tr> <tr> <td>Alarm</td> <td>6</td> </tr> <tr> <td>High Alarm</td> <td>7</td> </tr> <tr> <td>Low Alarm</td> <td>8</td> </tr> <tr> <td>Normal</td> <td>9</td> </tr> <tr> <td>Fault</td> <td>10</td> </tr> <tr> <td>Trouble</td> <td>10</td> </tr> <tr> <td>Error</td> <td>11</td> </tr> <tr> <td>Warning</td> <td>12</td> </tr> <tr> <td>Cov</td> <td>13</td> </tr> </table> | Trap_Type | Encode value | Alarm | 6 | High Alarm | 7 | Low Alarm | 8 | Normal | 9 | Fault | 10 | Trouble | 10 | Error | 11 | Warning | 12 | Cov | 13 |
| Trap_Type | Encode value | | | | | | | | | | | | | | | | | | | | | |
| Alarm | 6 | | | | | | | | | | | | | | | | | | | | | |
| High Alarm | 7 | | | | | | | | | | | | | | | | | | | | | |
| Low Alarm | 8 | | | | | | | | | | | | | | | | | | | | | |
| Normal | 9 | | | | | | | | | | | | | | | | | | | | | |
| Fault | 10 | | | | | | | | | | | | | | | | | | | | | |
| Trouble | 10 | | | | | | | | | | | | | | | | | | | | | |
| Error | 11 | | | | | | | | | | | | | | | | | | | | | |
| Warning | 12 | | | | | | | | | | | | | | | | | | | | | |
| Cov | 13 | | | | | | | | | | | | | | | | | | | | | |
| Cov_Normal* | This is applicable to Digital points only. Specify the normal value for digital point. When the value changes to or from Normal, a Trap will be sent. | 0, 1 | | | | | | | | | | | | | | | | | | | | |
| Cov_Hi_Alm* | Specify High Alarm threshold. | 0.0, Any float/integer value | | | | | | | | | | | | | | | | | | | | |
| Cov_Hi_Warn* | Specify High Warning threshold. | 0.0, Any float/integer value | | | | | | | | | | | | | | | | | | | | |
| Cov_Lo_Warn* | Specify Low Warning threshold. | 0.0, Any float/integer value | | | | | | | | | | | | | | | | | | | | |
| Cov_Lo_Alm* | Specify Low Alarm threshold. | 0.0, Any float/integer value | | | | | | | | | | | | | | | | | | | | |
| Cov_Deadband* | Specify the deadband value which must be exceeded for Alarm or Warning states to toggle (prevents chatter). A Trap will be sent only if the value change exceeds the deadband or the state changes. | 0.0, Any float/integer value | | | | | | | | | | | | | | | | | | | | |

5.3.3 Binary Trap Map Descriptor Example

The following Map Descriptors will generate a Trap whenever value/state changes from/to normal.

```
// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Function , Trap_Type
Trap_Range_BI , SNMP_BI , 3 , SNMP_Trap , Alarm
Trap_Range_BIb , SNMP_BI , 5 , SNMP_Trap , Alarm

, Node_Name , Length , Cov_Normal
, Mngr_1 , 2 , 0
, Mngr_1 , 1 , 1
```

A Trap of type Alarm (6) will be generated when the value changes from the specified COV_Normal value, and a Trap of Type Normal (9) will be generated when the value returns to the specified value.

Trap of type Alarm (6) will be generated.

5.3.4 Analog Trap Map Descriptor Example

The following Map Descriptor will generate a Trap whenever a value changes by the deadband (5) or the point's status changes (Normal, Warning, Alarm).

```
// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Function , Trap_Type
Trap_Range_AI2 , SNMP_AI , 2 , SNMP_Trap , Alarm

, Node_Name , Length , Cov_Deadband , Cov_Hi_Warn , Cov_Hi_Alm
, Mngr_1 , 1 , 5 , 50 , 100
```

5.3.5 Emulating an MXL/XLS Device with Analogs

The following list of Map Descriptors emulates an MXL Server:

```
// Server Side Map Descriptors

Map_Descriptor
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Function , Node_Name , Block_Number , Length , Msg_Type
SD_Analog_Volts1 , Volts , 0 , Passive , Panel1 , 1 , 252 , Analog_Volts
SD_Analog_Sense1 , Sense , 0 , Passive , Panel1 , 1 , 252 , Analog_Sense
SD_Analog_Thres1 , Thres , 0 , Passive , Panel1 , 1 , 252 , Analog_Thres
```

In the above example:

- **Data_Array_Name** – Use Float Data Arrays for the analog Map Descriptors to get the full analog value.

5.4 Custom Server Side Map Descriptors

5.4.1 FieldServer Related Map Descriptor Parameters

| Column Title | Function | Legal Values |
|---------------------|---|---|
| Map_Descriptor_Name | Name of this Map Descriptor. Name of this Map Descriptor is used as the object name for the MIB file. | Up to 32 alphanumeric characters |
| Data_Array_Name | Name of Data Array where data is to be stored in the FieldServer. | One of the Data Array names from Section 3 |
| Data_Array_Offset | Starting location in Data Array. | 0 to maximum as specified in Section 3 |
| Function | Function of Client Map Descriptor. | SNMP_TRAP |

5.4.2 Driver Specific Map Descriptor Parameters

| Section Title | | |
|------------------------|---|--|
| Map Descriptors | | |
| Column Title | Function | Legal Values |
| Node_Name | Name of the Remote Client Node to which Trap will be sent. | One of the Node names specified in Section 5.2 |
| Length | Length of Map Descriptor. | 1 – (Data Array length – Data Array Offset) |
| SNMP_OID | Specify the Object Identifier. One Map Descriptor is required for each OID specified as an integer. | 0 to any Integer |
| Access_Level | Specify if the OID is read only or read/write. If not specified, it defaults to read only. | Read-only , Read-write, - |
| Parent_Map_Descriptor* | Specify the name of the parent Map Descriptor that holds the previous OID integer. | Name of the previously created Map Descriptor, - |
| Data_Type | Specify the data type of the point in the MIB file. | OCTET STRING, INTEGER, Integer32, Counter, Counter32, Counter64, Gauge, Gauge32, Unsigned32, BITS, INDEX, INDEX_INTEGER, Table, TableEntry, Trap, TrapVar, NumberString ⁸ |
| SNMP_TRAP_MD | Specify the name of the TrapVar Map Descriptor to which this trap Map Descriptor is linked. | One of the Map Descriptors with data type set to TrapVar configured previously |
| Inform_Request* | Specify if this is an Inform Request or not. Inform Requests are traps required to be acknowledged. | Yes ⁹ , No |
| Description* | Specify the description about the Map Descriptor. This is used as the 'Description' clause in the MIB file. | Text up to 199 Characters. Default is "" |

⁸ Driver will convert a string to numbers before storing values and convert numbers to a string before sending. As there is no basic Float format in SNMP, NumberString can be used to transfer Floating point numbers.

⁹ When set to yes, a MIB file is auto generated and stored in the FieldServer.

5.4.3 Basic OID Structure Map Descriptors Example

For the following MIB file structure the support for iso.org.dod.internet.private.(1.3.6.1.) OID is built-in:

```

verisIndustries OBJECT IDENTIFIER ::= { enterprises 40845 } -- 1.3.6.1.4.1.40845 Veris Private Enterprise
Number
  verisEnergy OBJECT IDENTIFIER ::= { verisIndustries 1 } -- 1.3.6.1.4.1.40845.1
    bcpmE30 OBJECT IDENTIFIER ::= { verisEnergy 30 } -- 1.3.6.1.4.1.40845.1.30
      panels OBJECT IDENTIFIER ::= { bcpmE30 1 } -- 1.3.6.1.4.1.40845.1.30.1
        panel1 OBJECT IDENTIFIER ::= { panels 1 } -- 1.3.6.1.4.1.40845.1.30.1.1
          p1Alarms OBJECT IDENTIFIER ::= { panel1 1 } -- 1.3.6.1.4.1.40845.1.30.1.1.1
            p1VoltageInputs OBJECT IDENTIFIER ::= { panel1 2 } --
            1.3.6.1.4.1.40845.1.30.1.1.2
              p1AuxiliaryInputs OBJECT IDENTIFIER ::= { panel1 3 } -- 1.3.6.1.4.1.40845.1.30.1.1.3
  
```

The customized configuration is shown below:

```

// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Function , Node_Name
private , DA_CONFIG , 0 , Server , Agent1
enterprise , DA_CONFIG , 0 , Server , Agent1
verisIndustries , DA_CONFIG , 0 , Server , Agent1
verisEnergy , DA_CONFIG , 0 , Server , Agent1
bcpmE30 , DA_CONFIG , 0 , Server , Agent1
Panels , DA_CONFIG , 0 , Server , Agent1
Panel1 , DA_CONFIG , 0 , Server , Agent1
p1Alarms , DA_CONFIG , 0 , Server , Agent1
p1VoltageInputs , DA_CONFIG , 0 , Server , Agent1
P1AuxiliaryInputs , DA_CONFIG , 0 , Server , Agent1

, Length , SNMP_OID , Parent_Map_Descriptor , Data_Type
, 1 , 4 , - , -
, 1 , 1 , private , -
, 1 , 40845 , enterprise , -
, 1 , 1 , verisIndustries , -
, 1 , 30 , verisEnergy , -
, 1 , 1 , bcpmE30 , -
, 1 , 1 , panels , -
, 1 , 1 , panel1 , -
, 1 , 2 , panel1 , -
, 1 , 3 , panel1 , -
  
```

5.4.4 Simple Object Map Descriptor Example

The following section of an MIB file shows simple child (i.e. last in tree) OIDs of p1Alarms:

```

p1GlobalAlarmStatus OBJECT IDENTIFIER ::= { p1Alarms 1 }
p1TotalLatchingChannelsInAlarm OBJECT-TYPE
    SYNTAX      Unsigned32
    MAX-ACCESS  read-only
    STATUS      current
    DESCRIPTION  "Total Number of Aux and Branch Channels in Latching Alarm"
    ::= { p1GlobalAlarmStatus 5 }

p1TotalNonLatchingChannelsInAlarm OBJECT-TYPE
    SYNTAX      Unsigned32
    MAX-ACCESS  read-only
    STATUS      current
    DESCRIPTION  "Total Number of Aux and Branch Channels in Non-Latching Alarm"
    ::= { p1GlobalAlarmStatus 6 }
    
```

The following three Map Descriptors must be defined for this section of the MIB file:

```

// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name      , Data_Array_Offset      , Function
p1GlobalAlarmStatus      , DA_CONFIG          , 0                        , Server
p1TotalLatchingChannelsInAlarm , G_ALM_STAT_1      , 4                        , Server
P1TotalNonLatchingChannelsInAlarm , G_ALM_STAT_1      , 5                        , Server

, Node_Name      , Length      , SNMP_OID      , Parent_Map_Descriptor      , Data_Type
, Agent1        , 1            , 1              , p1Alarms                    , -
, Agent1        , 1            , 5              , p1GlobalAlarmStatus         , Unsigned32
, Agent1        , 1            , 6              , p1TotalLatchingChannelsInAlarm , Unsigned32
    
```

5.4.5 Table, TableEntry and Objects in TableEntry Map Descriptor Example

The following section for an MIB file shows a table of p1Alarms:

```
p1AuxVoltageAndCurrentAlarmTable OBJECT-TYPE
    SYNTAX      SEQUENCE OF P1AuxVoltageAndCurrentAlarmTableEntry
    MAX-ACCESS  not-accessible
    STATUS      current
    DESCRIPTION "Individual Auxiliary Phase Alarms: Index 1, 2, 3, 4 = Phase A, B, C, N"
    ::= { p1Alarms 3 }
```

The following Map Descriptor implements the table:

```
// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name  , Data_Array_Offset  , Function
p1AuxVoltageAndCurrentAlarmTable  , DA_CONFIG          , 0                  , Server

, Node_Name      , Length  , SNMP_OID  , Parent_Map_Descriptor  , Data_Type
, Agent1         , 1       , 3         , p1Alarms                , Table
```

The following section in the MIB file shows a table entry:

```
p1AuxVoltageAndCurrentAlarmTableEntry OBJECT-TYPE
    SYNTAX      P1AuxVoltageAndCurrentAlarmTableEntry
    MAX-ACCESS  not-accessible
    STATUS      current
    DESCRIPTION "Individual Auxiliary Phase Alarms: Index 1, 2, 3, 4 = Phase A, B, C, N"
    INDEX      {
                p1AuxAlarmIndex
            }
    ::= { p1AuxVoltageAndCurrentAlarmTable 1 }
```

The following Map Descriptor implements the table entry:

```
// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name  , Data_Array_Offset  , Function  , Node_Name
p1AuxVoltageAndCurrentAlarmTableEntry  , DA_CONFIG          , 0                  , Server    , Agent1

, Length  , SNMP_OID  , Parent_Map_Descriptor  , Data_Type
, 1       , 1         , p1AuxVoltageAndCurrentAlarmTable  , TableEntry
```

Configuring the FieldServer

The following section in the MIB file shows a table entry that doesn't need a defined Map Descriptor:

```
P1AuxVoltageAndCurrentAlarmTableEntry ::= SEQUENCE {
    p1AuxAlarmIndex -- index 1, 2, 3, 4 = phase A, B, C, N
        Unsigned32,
    p1AuxAlarmPhase -- index 1, 2, 3, 4 = phase A, B, C, N
        Unsigned32,
    p1VoltagePhaseAlarmStatus -- [241-243] voltage alarms
        BITS,
    p1AuxCurrentAlarmStatus -- [220-223] current alarms
        BITS,
    p1AuxHighHighAlarmCount -- [343-346]
        Counter32,
    p1AuxHighAlarmCount -- [389-392]
        Counter32,
    p1AuxLowAlarmCount -- [435-438]
        Counter32,
    p1AuxLowLowAlarmCount -- [481-484]
        Counter32,
    p1AuxOffStateAlarmCount -- [527-530]
        Counter32
}
```

For the following example each entry in tableEntry has been defined as an individual object and needs a Map Descriptor for each object:

```
p1AuxAlarmIndex OBJECT-TYPE -- index 1, 2, 3, 4 = phase A, B, C, N
SYNTAX      Unsigned32 (1..4)
MAX-ACCESS  not-accessible
STATUS      current
DESCRIPTION "Auxiliary Phase Number Index: 1, 2, 3, 4 = phase A, B, C, N"
 ::= { p1AuxVoltageAndCurrentAlarmTableEntry 1 }

p1AuxAlarmPhase OBJECT-TYPE -- index 1, 2, 3, 4 = phase A, B, C, N (same as
Index, but readable)
SYNTAX      Unsigned32 (1..4)
MAX-ACCESS  read-only
STATUS      current
DESCRIPTION "Auxiliary Phase Number Index: 1, 2, 3, 4 = phase A, B, C, N"
 ::= { p1AuxVoltageAndCurrentAlarmTableEntry 2 }
```

The following two Map Descriptors are defined by index in the table but have different names and might not be connected to any real time data. In some MIB files there could be only single index entry. Correspondingly Map descriptors will be as follows:

```
// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name , Data_Array_Name , Data_Array_Offset , Function , Node_Name
p1AuxAlarmIndex , DA_CONFIG , 0 , Server , Agent1
p1AuxAlarmPhase , DA_CONFIG , 0 , Server , Agent1

, Length , SNMP_OID , Parent_Map_Descriptor , Data_Type
, 4 , 1 , p1AuxVoltageAndCurrentAlarmTableEntry , INDEX
, 4 , 2 , p1AuxVoltageAndCurrentAlarmTableEntry , INDEX
```

Other objects defined in a table entry might be simple objects.

Looking at the last two objects from tableEntry as an example:

```
p1AuxLowLowAlarmCount OBJECT-TYPE -- [481-484]
    SYNTAX      Counter32
    MAX-ACCESS   read-only
    STATUS       current
    DESCRIPTION  "Count of Auxiliary Current Low Low Alarms"
    ::= { p1AuxVoltageAndCurrentAlarmTableEntry 8 }

p1AuxOffStateAlarmCount OBJECT-TYPE -- [527-530]
    SYNTAX      Counter32
    MAX-ACCESS   read-only
    STATUS       current
    DESCRIPTION  "Count of Auxiliary Current Alarm Off State Transitions"
    ::= { p1AuxVoltageAndCurrentAlarmTableEntry 9 }
```

Corresponding Map Descriptors will be as follows:

```
// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name      , Data_Array_Offset      , Function      , Node_Name
p1AuxLowLowAlarmCount    , AUX_VC_ALM_1        , 21                      , Server        , Agent1
p1AuxOffStateAlarmCount  , AUX_VC_ALM_1        , 25                      , Server        , Agent1

, Length      , SNMP_OID      , Parent_Map_Descriptor      , Data_Type
, 4           , 8             , p1AuxVoltageAndCurrentAlarmTableEntry , Counter32
, 4           , 9             , p1AuxVoltageAndCurrentAlarmTableEntry , Counter32
```

5.4.6 String Object Map Descriptor Example

The MIB file below shows a string object entry:

```
p1LocationString OBJECT-TYPE -- [7-70]
    SYNTAX      DisplayString (SIZE(128))
    MAX-ACCESS   read-write
    STATUS       current
    DESCRIPTION  "Null terminated Text String Describing Physical Installation"
    ::= { p1ProductInformation 5 }
```

The corresponding Map Descriptor will be as follows. Note parent map descriptor p1ProductInformation should be defined before this Map Descriptor.

Although the Map Descriptor length is 128, the driver will only serve characters until the null character in the LOCATION_1 Data Array. The null character will not be included in the response string.

```
// Server Side Map Descriptors

Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name      , Data_Array_Offset      , Function      , Node_Name
p1LocationString        , LOCATION_1          , 0                      , Server        , Agent1

, Length      , SNMP_OID      , Parent_Map_Descriptor      , Data_Type
, 128         , 5             , p1ProductInformation      , DisplayString
```

5.4.7 Trap/Notification Map Descriptor Example

The MIB file below shows the definition of a trap:

```
p1Traps OBJECT IDENTIFIER ::= { p1Alarms 0 }
```

The corresponding Map Descriptor will be:

```
// Server Side Map Descriptors
Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name      , Data_Array_Offset      , Function      , Node_Name
p1Traps                  , DA_CONFIG          , 0                      , Server        , Agent1

, Length      , SNMP_OID      , Parent_Map_Descriptor      , Data_Type
, 1           , 0             , p1Alarms                   , TRAP
```

A next entry in the MIB file declares the trap to include p1AuxAlarmPhase and p1VoltagePhaseStatus as trap variables:

```
p1VoltagePhaseAlarmStatusTrap NOTIFICATION-TYPE -- [241-243] voltage alarms A, B,
C. Return phase index & status register.
OBJECTS
{
  p1AuxAlarmPhase,
  p1VoltagePhaseAlarmStatus
}
STATUS      current
DESCRIPTION "Voltage Alarm Status Bit Map: 0 HighLatching, 1 LowLatching,
8 HighNonLatching"
::= { p1Traps 3 }
```

The corresponding Map Descriptors will be as follows:

```
// Server Side Map Descriptors
Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name      , Data_Array_Offset      , Function      , Node_Name
p1VoltagePhaseAlarmStatusTrap , DA_CONFIG          , 0                      , Server        , Agent1
p1AuxAlarmIndex          , AUX_VC_ALM_1       , 0                      , Server        , Agent1
p1VoltagePhaseAlarmStatus , AUX_VC_ALM_1       , 1                      , Server        , Agent1

, Length      , SNMP_OID      , Parent_Map_Descriptor      , Data_Type
, 1           , 3             , p1Traps                   , TRAP
, 1           , 1             , VoltagePhaseAlarmStatusTrap , TrapVar
, 4           , 2             , VoltagePhaseAlarmStatusTrap , TrapVar
```

Once the trap and trap variable Map Descriptors have been defined, a Map Descriptor is needed to trigger the trap.

The following Map Descriptor will trigger the trap whenever any value changes in Data Array AUX_VC_ALM_1 offset 1 thru 4.

This Map Descriptor will trigger p1VoltagePhaseAlarmStatusTrap that has been defined above and it will include two variables in the trap.

```
Map_Descriptors
Map_Descriptor_Name      , Data_Array_Name      , Data_Array_Offset      , Function
p1VoltagePhaseAlarmStatus , AUX_VC_ALM_1         , 1                      , SNMP_Trap

, Node_Name      , Length      , SNMP_Trap_MD
, Agent1         , 4           , p1VoltagePhaseAlarmStatusTrap
```


6 Useful Features

6.1 Contents of Trap Messages

Each Trap has a Specific-Trap and 4 OIDs for four bound variables (the payload). Systems that use traps are typically set up to watch for OID's in the payloads. The Specific-Trap is set according to the Map Descriptor's Trap_Type parameter.

The four bound variables are as specified in standard MIB file as:

VARIABLES {notificationPointType, notificationPointIndex, notificationPointDescription, notificationPointValue}

| Variable | OID |
|--|--------------------------|
| notificationPointType OBJECT-TYPE SYNTAX INTEGER (analogInput(1), analogOutput(2), analogValue(3), binaryInput(4), binaryOutput(5), binaryValue(6)) ACCESS read-only STATUS current DESCRIPTION "Identifies the Point Type in a Notification." ::= {notificationFields 1 } | 1.3.6.1.4.6347.2.1.1.0 , |
| notificationPointIndex OBJECT-TYPE SYNTAX INTEGER ACCESS read-only STATUS current DESCRIPTION "Identifies the Point Index in a Notification." ::= {notificationFields 2 } | 1.3.6.1.4.6347.2.1.2.0 , |
| notificationPointDescription OBJECT-TYPE SYNTAX OCTET STRING ACCESS read-only STATUS current DESCRIPTION "Description of the Point in a Notification." ::= {notificationFields 3 } | 1.3.6.1.4.6347.2.1.3.0 , |
| notificationPointValue OBJECT-TYPE SYNTAX INTEGER ACCESS read-only STATUS current DESCRIPTION "Value of the Point in a Notification." ::= {notificationFields 4 } | 1.3.6.1.4.6347.2.1.4.0 , |

6.1.1 Trap Example

This Trap was sent for Binary Input 3 (named as “BI value 3”) when the value changed to 1. The Specific Trap for this Trap is 6 which is “Alarm” The OID’s for the 4 bound variables are as follows:

| OID | Format | Value | Description |
|--------------------------|-------------|------------|--------------------------------------|
| 1.3.6.1.4.1.6347.2.1.1.0 | Integer | 4 | Type object (4=Binary Input) |
| 1.3.6.1.4.1.6347.2.1.2.0 | Integer | 3 | Object number |
| 1.3.6.1.4.1.6347.2.1.3.0 | OctetString | BI value 3 | Object name preloaded in config file |
| 1.3.6.1.4.1.6347.2.1.4.0 | Integer | 1 | Current Object value |

The following snapshot shows this Trap in Wireshark capture:

The screenshot shows a Wireshark capture of an SNMP trap packet. The packet list pane shows three packets, with packet 10 selected. The packet details pane shows the following structure:

- User Datagram Protocol, Src Port: 44817 (44817), Dst Port: snmptrap (162)
- Simple Network Management Protocol
 - version: version-1 (0)
 - community: public
 - data: trap (4)
 - trap
 - enterprise: 1.3.6.1.4.1.6347 (iso.3.6.1.4.1.6347)
 - agent-addr: 192.168.1.212 (192.168.1.212)
 - generic-trap: enterprisespecific (6)
 - specific-trap: 6
 - time-stamp: 324000
 - variable-bindings: 4 items
 - 1.3.6.1.4.1.6347.2.1.1.0: object Name: 1.3.6.1.4.1.6347.2.1.1.0 (iso.3.6.1.4.1.6347.2.1.1.0) value (Integer32): 4
 - 1.3.6.1.4.1.6347.2.1.2.0: object Name: 1.3.6.1.4.1.6347.2.1.2.0 (iso.3.6.1.4.1.6347.2.1.2.0) value (Integer32): 3
 - 1.3.6.1.4.1.6347.2.1.3.0: 42492076616c75652033 object Name: 1.3.6.1.4.1.6347.2.1.3.0 (iso.3.6.1.4.1.6347.2.1.3.0) value (Octetstring): 42492076616c75652033
 - 1.3.6.1.4.1.6347.2.1.4.0: object Name: 1.3.6.1.4.1.6347.2.1.4.0 (iso.3.6.1.4.1.6347.2.1.4.0) value (Integer32): 1

The packet bytes pane shows the raw data in hexadecimal and ASCII. The ASCII part shows the community name "public" and the object name "BI value 3".

6.2 Using an .ini File to Set the Enterprise_ID and Enterprise_Name

The vendor.ini file can be used to change the SNMP_enterprise_id and SNMP_enterprise_name if desired. A file with the following format must be created and downloaded to the FieldServer:

```
SNMP_enterprise_id = 6347
SNMP_enterprise_name = FieldServertechnologies
```

NOTE: When using vendor.ini, also update FServer.mib file. Replace all instances of FieldServertechnologies with new enterprise name and id 6347 to new id.

6.3 Preloading Point Descriptions

The following example shows how to preload description strings for SNMP points:

| Preloads | Data_Array_Name | , Preload_Data_Index | , Preload_Data_Format | , Preload_Object_Name |
|----------|--|----------------------|-----------------------|-----------------------|
| | // Analog Input/Output/value description | | | |
| | SNMP_AI | , 3 | , String | , AI value 3 Desc |
| | SNMP_AO | , 4 | , String | , AO value 4 Desc |
| | SNMP_AV | , 5 | , String | , AV value 5 Desc |
| | // Analog vector1 description | | | |
| | SNMP_AV_1 | , 3 | , String | , AVector1 val3 Desc |
| | SNMP_AV_1 | , 5 | , String | , AVector1 val5 Desc |

6.4 Uploading a MIB File from FieldServer

- Determine the name of the MIB file by going to the FieldServer's FS GUI page
- Click User Messages and then on the Driver tab to see the name of the MIB file that was generated.
- Once the name of the MIB file is known, Enter the IP Address followed by '\` and the name of the MIB file into the web browser address bar.
 - For example: 192.168.2.101\192.168.2.101_SNMP_Server.csv

7 Reference

7.1 Driver Error Messages

| Error # | Msg Screen | Screen message | Meaning | Suggested Solution |
|-------------|------------|--|--|---|
| SNMP-STD#01 | ERROR | SNMP-STD#01: Bad Node_ID - forcing to 1 | Node_ID is not in range 1-255. Driver defaulting it to 1. | Update configuration file to assign unique Node_ID in range 1-255. Node_ID's are used when Node_Status bits are prepared. |
| SNMP-STD#02 | DRIVER | SNMP-STD#02 : Could not read SNMP response version | The driver found an error in the message structure preventing it from extracting the SNMP version number. | If this message is received rarely and data is being transferred correctly then ignore it. If it is repeated or affects data transfer then take a log and call tech Support. This message is usually preceded by a message which provides more specific information as to why the parse failed. |
| SNMP-STD#03 | DRIVER | SNMP-STD#03 : Version. Expected=1 Rcvd=%d | This driver only supports SNMP version #1. | |
| SNMP-STD#4A | DRIVER | SNMP-STD#4A : Extract Int Failed. Index=%d | The driver is extracting an integer value from the SNMP message but the field was incorrectly formatted. | |
| SNMP-STD#4B | DRIVER | SNMP-STD#4B : Expected INT. Found NULL. Index=%d | | |
| SNMP-STD#05 | DRIVER | SNMP-STD#05 : Parse Failed. MD=%s | The driver is attempting to process a SNMP message that is not correctly formatted; contains an error or contains unsupported SNMP elements. Immediately after the message has been printed the driver does a hexadecimal dump of the message. | |

| Error # | Msg Screen | Screen message | Meaning | Suggested Solution |
|-------------|------------|--|---|--|
| SNMP-STD#06 | DRIVER | SNMP-STD#06: Can't send to Agent/Trap Dest. %s at %s | The FieldServer cannot reach the specified remote Node. The message prints the Node name and the IP Address. This message is most commonly printed when an incorrect IP Address has been specified or when the remote Node is off or in an Error State. | Check the specified IP Address or remote device if it is healthy and connected to network. |
| SNMP-STD#07 | DRIVER | SNMP-STD#07 : Invalid SNMP PDU type 0x%x | An unsupported PDU Type was received by the Server Supported PDU Types: GET/SET/GET-NEXT/TRAP | Refer to msg #05 for follow up actions. |
| SNMP-STD#08 | DRIVER | SNMP-STD:#08 : Bad community string | The SNMP message contains a badly formatted community string or the community string is absent. | If this message occurs occasionally, ignore it. Otherwise take a log and call tech support. |
| SNMP-STD#09 | DRIVER | SNMP:#09 ERR. Couldn't respond to Get Request for OID: | The driver can only serve data for configured OID points. | Ignore this message if it occurs once per full walk test. If this message occurs frequently and for any other request either configure FieldServer or remote device. |
| SNMP-STD#10 | DRIVER | SNMP-STD#10 : Store Int. DA=%s:%d value=%d gen=%d SNMP-STD#10: Store ! String DA=%s:%d value=%d | The driver is storing data. The message indicates where the data was stored. It is intended as a debugging tool. | This message is for information only No Action required. |
| SNMP-STD#11 | DRIVER | SNMP-STD#11: Unsupported data_type: 0x%x | The driver is storing data but the data type is not supported. | Check the Driver fact for supported Data Types and correct the configuration of the remote client/agent. |

| Error # | Msg Screen | Screen message | Meaning | Suggested Solution |
|-------------|------------|--|--|---|
| SNMP-STD#12 | DRIVER | SNMP-STD#12 : No SNMP-STD DA's configured. | SNMP-STD Data Arrays are missing. There won't be any communication between FieldServer and remote Client. | Declare the Data Arrays as described in Section 3 . |
| SNMP-STD#13 | ERROR | DRV->SNMP-STD#13 : Standard Data Arrays must be of Complex Data Object type. Set Data_Format to AI, AO, AV, BI, BO or BV | The Data format of the SNMP Data Array is incorrect. | Set correct Data_Format as described in Section 3 . |
| SNMP-STD#14 | DRIVER | SNMP-STD#14: Couldn't parse msg: found %#x at %d | The Server received a message containing an unsupported bound variable, e.g. OPAQUE, TRAP. The driver prints a hex dump of the offending message. | Ensure that the remote SNMP client is correctly configured. Capture a diagnostic log and call technical support. |
| SNMP-STD#15 | DRIVER | SNMP-STD#15: Invalid Msg | The driver has received a message from a SNMP client which is not correctly formatted or which contains bound variables/features not supported by the driver. This particular error message is printed when the SNMP message does not begin with 0x30. | If this message is received rarely and data is being transferred correctly then ignore it. If it is repeated or affects data transfer then take a log and call tech Support. This message is usually preceded by a message which provides more specific information as to why the parse failed. |
| SNMP-STD#16 | DRIVER | SNMP-ST#16: Message length error | The SNMP message indicates that a message length is different to the number of bytes received. | |
| SNMP-STD#17 | DRIVER | SNMP-STD#17: Could not get Request ID | The SNMP message number is badly formatted or absent. | |
| SNMP-STD#18 | DRIVER | SNMP-STD#18: Could not get Error Status | The SNMP error status field is badly formatted or absent. | |
| SNMP-STD#19 | DRIVER | SNMP-STD#19: Could not get Error Index | The SNMP error id field is badly formatted or absent | |

| Error # | Msg Screen | Screen message | Meaning | Suggested Solution |
|-------------|------------|--|---|---|
| SNMP-STD#20 | DRIVER | SNMP-STD#20: Expected SNMP_STD_TYPE_SEQ | The message header is correctly formatted but as the driver continues parsing the message it can't find the bound variables. | |
| SNMP-STD#21 | ERROR | DRV->SNMP-STD#21 : Out of udp sockets on port=%d | The FieldServer has no UDP socket or cannot bind it to a particular port. It is possible that the FieldServer is running out of memory. | Take a diagnostic log and call technical support. |
| SNMP-STD#22 | | DRV->SNMP-STD#22 : Out of udp sockets | | |
| SNMP-STD#23 | | DRV->SNMP-STD#23 : Socket binding error on port=%d | | |
| SNMP-STD#51 | DRIVER | SNMP-STD#51: Not enough space on DA=%s, reqd length=%d | Data array is not long enough. | This message is printed by the client side of the driver. The Client side of the driver is implemented only to test the Server side. Configure the FieldServer as a Server. |
| SNMP-STD#52 | DRIVER | SNMP-STD#52 : Received set/get/getnext (%d) request | The Client side of the driver has received a request. It should only receive responses. | |
| SNMP-STD#53 | DRIVER | SNMP-STD#53: Ignored received request (%d) | | |
| SNMP-STD#54 | DRIVER | SNMP-STD#54: Not a valid SNMP response | The Client side of driver has received a message which is not a valid SNMP response. | |
| SNMP-STD#55 | DRIVER | SNMP-STD#55: Encoded msg length (%d) > (%d) bytes received | Partial message is received or length was not correctly formatted in message. | |
| SNMP-STD#56 | DRIVER | SNMP-STD#56: Response report err=%d MD=%s | A response from the remote device reports an error. The message is good but inside the message there is a field reporting an error. | |
| SNMP-STD#57 | DRIVER | SNMP-STD#57: Incorrect variable binding format | The driver has received a message which is incorrectly formatted or contains unsupported bound variables/features. This particular error message is printed when the SNMP message does not begin with 0x30. | |

| Error # | Msg Screen | Screen message | Meaning | Suggested Solution |
|-------------|------------|--|--|---|
| SNMP-STD#58 | DRIVER | SNMP-STD#58: Can't parse msg: found %#x at %d | A response to a poll from the FieldServer contains a bound variable that is not supported or expected. For example, an IP_ADDRESS and OPAQUE variable or a TRAP. Immediately after this message the driver prints a hex dump of the offending message. | This message is printed by the client side of the driver. The Client side of the driver is implemented only to test the Server side. Configure the FieldServer as a Server. |
| SNMP-STD#59 | DRIVER | SNMP-STD#59 : Could not read SNMP response version | The driver found an error in the message structure preventing it from extracting the SNMP version number. | |
| SNMP-STD#60 | DRIVER | SNMP-STD#60: Bad community string | The SNMP message contains a badly formatted community string or the community string is absent. | |
| SNMP-STD#61 | DRIVER | SNMP-STD#61: Version. Expected=1 Rcvd=%d | This driver only supports SNMP version #1. | |